

Documentation | EN

BK3xx0 and LC3100

Bus Coupler for PROFIBUS-DP



Table of contents

1 Foreword	5
1.1 Notes on the documentation	5
1.2 Safety instructions	6
1.3 Documentation issue status	7
2 Product overview	8
2.1 BK3000, BK3010, BK3100, BK3110, BK3120, LC3100.....	9
2.2 BK3150	11
2.3 BK3500 and BK3520 (optical fibers)	12
2.4 The Beckhoff Bus Terminal system	13
2.5 PROFIBUS - Introduction	14
2.5.1 PROFIBUS DP.....	14
2.5.2 PROFIBUS DPV1	16
3 Mounting and wiring	17
3.1 Instructions for ESD protection	17
3.2 Dimensions	17
3.3 Installation on mounting rails.....	18
3.4 Disposal	19
3.5 Connection	20
3.5.1 Connection system.....	20
3.5.2 Wiring	21
3.5.3 Potential groups, insulation testing and PE.....	23
3.5.4 Power supply.....	25
3.5.5 PROFIBUS cabling	28
3.6 Notes on operation in areas subject to an explosion hazard	32
3.6.1 ATEX - Special conditions (standard temperature range).....	32
3.6.2 ATEX - Special conditions (extended temperature range).....	33
3.6.3 IECEx - Special conditions.....	34
3.6.4 Continuative documentation for ATEX and IECEx.....	35
3.6.5 cFMus - Special conditions	36
3.6.6 Continuative documentation for cFMus.....	37
4 Parameterization and commissioning	38
4.1 Start-up behaviour of the Bus Coupler	38
4.2 The Bus Coupler's UserPrmData	38
4.3 Technical data - overview	41
4.4 Configuration	41
4.4.1 Configuration - CfgData	41
4.4.2 Configuration of the Coupler Modules.....	41
4.4.3 Configuration of Complex Modules	42
4.4.4 Configuration of Digital Modules	44
4.4.5 GSD Files.....	45
4.4.6 Downloads for PROFIBUS.....	45
4.4.7 KS2000 - Introduction	47
4.4.8 Configuration via TwinCAT	48

4.4.9	Configuration with Siemens S7 controller	50
5	PROFIBUS DP communication	55
5.1	DataExchange - cyclic data exchange	55
5.1.1	Process data, process image	55
5.1.2	K-bus Cycle	57
5.2	DPV1 - acyclic data transfer	60
5.2.1	DPV1 Interface	60
5.2.2	Assignment of the DPV1 slot number	61
5.2.3	DPV1 at the coupler	62
6	Diagnostics and error handling	65
6.1	LEDs	65
6.2	DP diagnostics	68
6.2.1	DP Diagnostic Data (DiagData)	68
6.2.2	Errors during DP Start-up	71
6.2.3	Reaction to PROFIBUS Error	73
6.3	K-bus diagnosis	73
6.3.1	K-bus interruption	73
6.3.2	Terminal Diagnostics	74
7	Extended functions	76
7.1	2-byte PLC Interface	76
7.2	Word Alignment	76
7.3	Deactivating the CfgData Check	77
7.4	Multi-Configuration Mode	77
7.5	Changing the Size of the Process Data	80
7.6	Bus Coupler versions in multi-configuration mode	82
8	Appendix	88
8.1	General operating conditions	88
8.2	Approvals	89
8.3	Bibliography	90
8.4	List of Abbreviations	90
8.5	Support and Service	92

1 Foreword

1.1 Notes on the documentation

Intended audience

This description is only intended for the use of trained specialists in control and automation engineering who are familiar with the applicable national standards.

It is essential that the documentation and the following notes and explanations are followed when installing and commissioning these components.

It is the duty of the technical personnel to use the documentation published at the respective time of each installation and commissioning.

The responsible staff must ensure that the application or use of the products described satisfy all the requirements for safety, including all the relevant laws, regulations, guidelines and standards.

Disclaimer

The documentation has been prepared with care. The products described are, however, constantly under development.

We reserve the right to revise and change the documentation at any time and without prior announcement.

No claims for the modification of products that have already been supplied may be made on the basis of the data, diagrams and descriptions in this documentation.

Trademarks

Beckhoff®, TwinCAT®, TwinCAT/BSD®, TC/BSD®, EtherCAT®, EtherCAT G®, EtherCAT G10®, EtherCAT P®, Safety over EtherCAT®, TwinSAFE®, XFC®, XTS® and XPlanar® are registered trademarks of and licensed by Beckhoff Automation GmbH. Other designations used in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owners.

Patent Pending

The EtherCAT Technology is covered, including but not limited to the following patent applications and patents: EP1590927, EP1789857, EP1456722, EP2137893, DE102015105702 with corresponding applications or registrations in various other countries.

The logo for EtherCAT, featuring the word "EtherCAT" in a bold, black, sans-serif font. A red arrow points from the top of the "A" towards the right, ending above the "T". A registered trademark symbol (®) is located to the right of the "T".

EtherCAT® is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.

Copyright

© Beckhoff Automation GmbH & Co. KG, Germany.

The reproduction, distribution and utilization of this document as well as the communication of its contents to others without express authorization are prohibited.

Offenders will be held liable for the payment of damages. All rights reserved in the event of the grant of a patent, utility model or design.

1.2 Safety instructions

Safety regulations

Please note the following safety instructions and explanations!
Product-specific safety instructions can be found on following pages or in the areas mounting, wiring, commissioning etc.

Exclusion of liability

All the components are supplied in particular hardware and software configurations appropriate for the application. Modifications to hardware or software configurations other than those described in the documentation are not permitted, and nullify the liability of Beckhoff Automation GmbH & Co. KG.

Personnel qualification

This description is only intended for trained specialists in control, automation and drive engineering who are familiar with the applicable national standards.

Description of instructions

In this documentation the following instructions are used.
These instructions must be read carefully and followed without fail!

DANGER

Serious risk of injury!

Failure to follow this safety instruction directly endangers the life and health of persons.

WARNING

Risk of injury!

Failure to follow this safety instruction endangers the life and health of persons.

CAUTION

Personal injuries!

Failure to follow this safety instruction can lead to injuries to persons.

NOTE

Damage to environment/equipment or data loss

Failure to follow this instruction can lead to environmental damage, equipment damage or data loss.



Tip or pointer

This symbol indicates information that contributes to better understanding.

1.3 Documentation issue status

Version	Stand
4.5.0	<ul style="list-style-type: none"> • Technical data updated • Chapter <i>Disposal</i> added
4.4.0	<ul style="list-style-type: none"> • Technical data updated • Chapter <i>Notes on operation in areas subject to an explosion hazard</i> extended • Download links updated • New title page
4.3.0	<ul style="list-style-type: none"> • Design of the safety instructions adapted to IEC 82079-1 • Technical data updated • Chapter <i>Instructions for ESD protection</i> added • ATEX added • Document structure overworked
4.2.0	<ul style="list-style-type: none"> • Mounting and wiring updated
4.1.0	<ul style="list-style-type: none"> • PROFIBUS-Connection corrected
4.0.0	<ul style="list-style-type: none"> • Migration
3.5.1	<ul style="list-style-type: none"> • Notes regarding compliance with UL requirements added
3.5	<ul style="list-style-type: none"> • BK3150 with firmware version B0 added
3.03	<ul style="list-style-type: none"> • Corrections in English translation
3.02	<ul style="list-style-type: none"> • GSD files updated for BK3110, BK3120, BK3520
3.01	<ul style="list-style-type: none"> • Configuration examples for operation under Siemens S7 extended
3.0	<ul style="list-style-type: none"> • For BK3010 with firmware version B9 • For BK3110 with firmware version B9 • For BK3120 with firmware version B9 • For BK3500 with firmware version B9 • For BK3520 with firmware version B9 • For LC3100 with firmware version B9

2 Product overview

Bus Couplers for PROFIBUS DP

Bus Coupler	Description	Bus interface
BK3000 [▶ 9]	Standard Bus Coupler	D-Sub-Stecker
BK3010 [▶ 9]	Economy Bus Coupler	D-Sub-Stecker
BK3100 [▶ 9]	Standard Bus Coupler	D-Sub-Stecker
BK3110 [▶ 9]	Economy Bus Coupler	D-Sub-Stecker
BK3120 [▶ 9]	Economy Plus Bus Coupler	D-Sub-Stecker
BK3150 [▶ 11]	Compact Bus Coupler	D-Sub-Stecker
BK3500 [▶ 12]	Standard Bus Coupler with optical fiber connection	HP Simplex connectors
BK3520 [▶ 12]	Economy Plus Bus Coupler with optical fiber connection	HP Simplex connectors
LC3100 [▶ 9]	Low Cost Bus Coupler	spring-loaded terminals

2.1 BK3000, BK3010, BK3100, BK3110, BK3120, LC3100

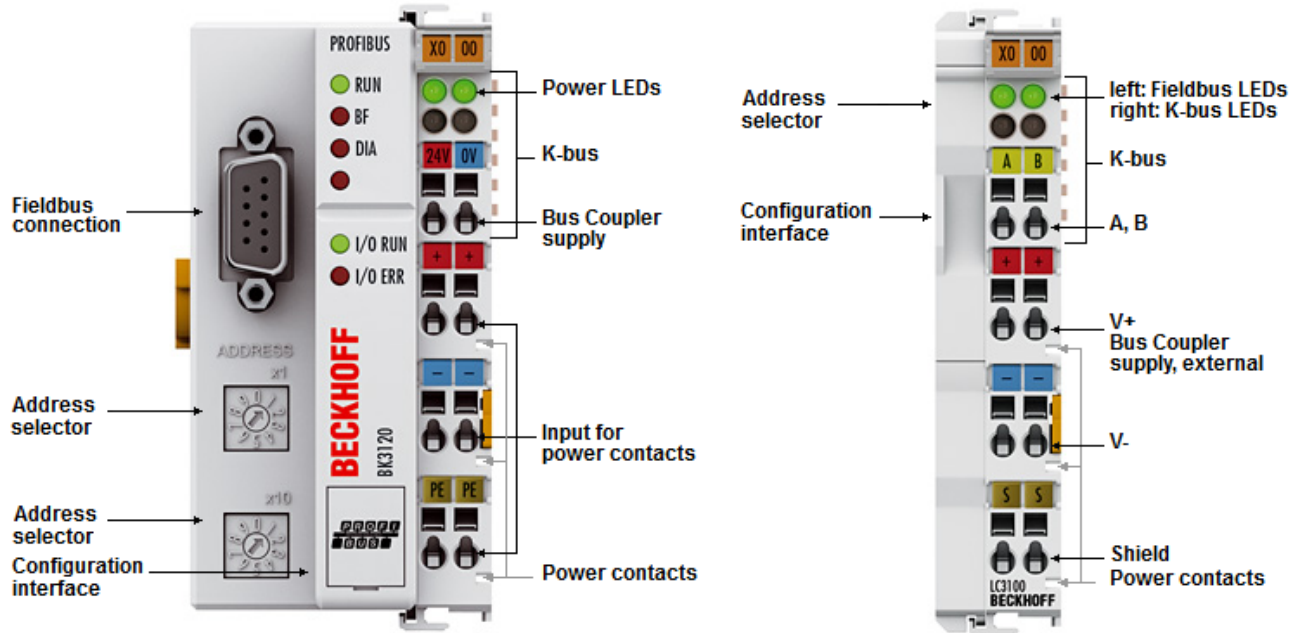


Fig. 1: BK3120 and LC3100 - Bus Couplers for PROFIBUS DP

Technical data

Type	BK3120
Number of Bus Terminals	64 (255 with K-bus extension)
Digital peripheral signals	max. 1020 inputs/outputs
Analog peripheral signals	max. 64 inputs/outputs
Configuration possibility	Via the KS2000 configuration software or the controller
Max. number of bytes (inputs and outputs)	128 bytes
Baud rate (automatic detection)	up to max. 12 Mbaud
Bus connection	1 x D-sub plug, 9-pin with shielding
Power supply	24 V _{DC} (-15 % / +20 %)
Input current	70 mA + (total K bus current)/4, max. 500 mA
Starting current	2.5 x continuous current
Recommended fuse	maximum 10 A
K-bus current up to	1750 mA
Power contact voltage	maximum 24 V _{DC}
Power contact current load	maximum 10 A
Electrical isolation	Power contact / supply / fieldbus
Dielectric strength	500 V (power contact / supply / fieldbus)
Weight	approx. 170 g
Permissible ambient temperature (operation)	-25°C ... +60°C
Permissible ambient temperature (storage)	-25°C ... +85°C
Permissible relative humidity	95% (no condensation)
Vibration/shock resistance	conforms to EN 60068-2-6 / EN 60068-2-27
EMC immunity / emission	conforms to EN 61000-6-2 / EN 61000-6-4
Protection class / Installation position	IP20 / variable
Approvals / markings	CE, UKCA, cULus, EAC, GL, ATEX [▶ 33], IECEx [▶ 34], cFMus [▶ 36]
Ex markings	ATEX: II 3 G Ex nA IIC T4 Gc II 3 D Ex tc IIIC T135 °C Dc IECEx: Ex nA IIC T4 Gc Ex tc IIIC T135 °C Dc cFMus: Class I, Division 2, Groups A, B, C, D Class I, Zone 2, AEx ec IIC T4 Gc

*) Real applicable approvals/markings see type plate on the side (product marking).

Type	BK3000, BK3010	BK3100, BK3110	LC3100
Number of Bus Terminals	64		64
Digital peripheral signals	BK3000, BK3100: 512 inputs/outputs BK3010, BK3110: 256 inputs/outputs		256 inputs/outputs
Analog peripheral signals	BK3000, BK3100: 128 inputs/outputs BK3010, BK3110: -		-
Configuration possibility	Via the KS2000 configuration software or the controller		
Max. number of bytes (inputs and outputs)	BK3000: 244 bytes	BK3100: 64 bytes (DP and FMS operation) 128 bytes (DP operation only)	32 bytes
	BK3010: 32 bytes	BK3110: 32 bytes	
Baud rate (automatic detection)	up to max. 1.5 Mbaud	up to max. 12 Mbaud	
Bus connection	1 x D-sub plug, 9-pin with shielding		spring-loaded terminals
Power supply	24 V _{DC} (-15 % / +20 %)		
Input current	70 mA + (total K-bus current)/4, 500 mA max. (BK3x00) 70 mA + (total K-bus current)/4, 200 mA max. (BK3x10)		70 mA + (total K bus current)/4, max. 200 mA
Starting current	2.5 x continuous current		
Recommended fuse	maximum 10 A		
K-bus current up to	1750 mA (BK3x00) 500 mA (BK3x10)	500 mA	
Power contact voltage	maximum 24 V _{DC}		
Power contact current load	maximum 10 A		
Electrical isolation	Power contact / supply / fieldbus		Power supply / fieldbus
Dielectric strength	500 V (power contact / supply / fieldbus)		500 V (supply / fieldbus)
Weight	approx. 170 g	approx. 150 g	approx. 100 g
Permissible ambient temperature (operation)	0°C ... +55°C		0°C ... +55°C
Permissible ambient temperature (storage)	-25°C ... +85°C		
Permissible relative humidity	95% (no condensation)		
Vibration/shock resistance	conforms to EN 60068-2-6 / EN 60068-2-27		
EMC immunity / emission	conforms to EN 61000-6-2 / EN 61000-6-4		
Protection class	IP20		
Installation position	variable		
Approvals / markings*	CE, UKCA, cULus, EAC, GL, ATEX [▶ 32]		CE, UKCA, cULus, EAC, ATEX [▶ 32]
Ex marking	ATEX: II 3 G Ex nA IIC T4 Gc		

*) Real applicable approvals/markings see type plate on the side (product marking).

2.2 BK3150

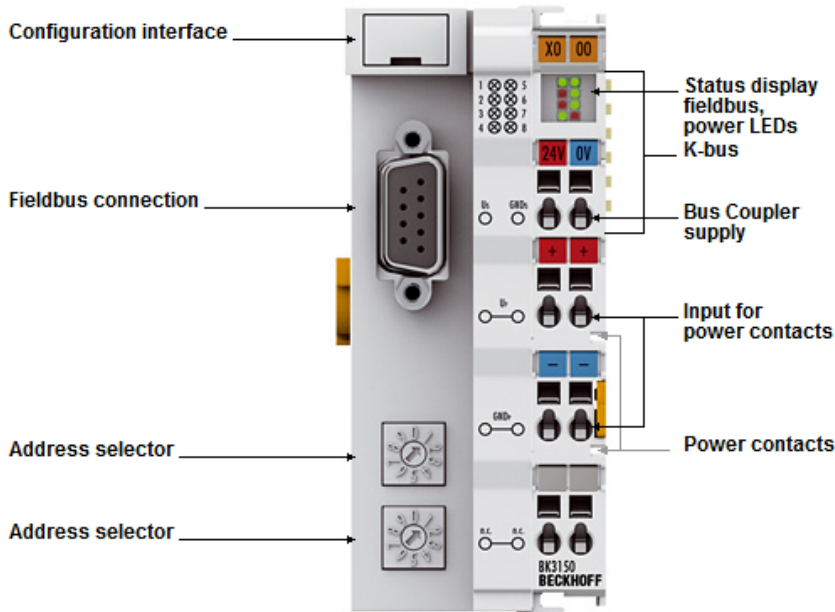


Fig. 2: BK3150 - Bus Coupler for PROFIBUS DP

Technical data

Type	BK3150
Number of Bus Terminals	64 (255 with K-bus extension)
Digital peripheral signals	256 inputs/outputs (BK3x10)
Analog peripheral signals	128 inputs/outputs (BK3x00)
Configuration possibility	Via the KS2000 configuration software or the controller
Max. number of bytes (inputs and outputs)	128 bytes (DP operation only)
Baud rate (automatic detection)	up to max. 12 Mbaud
Bus connection	1 x D-sub plug, 9-pin with shielding
Power supply (Us)	24 V _{DC} (-15% /+20%) Use a 4 A fuse or an <i>NEC Class 2</i> power supply to meet the UL requirements!
Input current (Us)	70 mA + (total K bus current)/4, max. 320 mA
Starting current (Us)	2.5 x continuous current
K-bus current (5 V)	up to hardware version 04: 1000 mA from hardware version 05: 1750 mA
Power contact voltage (Up)	maximum 24 V _{DC}
Power contacts current load (Up)	maximum 10 A
Recommended backup fuse (Up)	maximum 10 A
Electrical isolation	Power contact / supply / fieldbus
Dielectric strength	500 V (power contact / supply / fieldbus)
Weight	approx. 100 g
Permissible ambient temperature (operation)	-25°C ... +60°C
Permissible ambient temperature (storage)	-25°C ... +85°C
Permissible relative humidity	95% (no condensation)
Vibration / shock resistance	conforms to EN 60068-2-6 / EN 60068-2-27
EMC immunity / emission	conforms to EN 61000-6-2 / EN 61000-6-4
Protection class	IP20
Installation position	variable
Approvals / Markings*	CE, UKCA, cULus, EAC, ATEX [▶ 33]
Ex markings	ATEX: II 3 G Ex nA IIC T4 Gc

*) Real applicable approvals/markings see type plate on the side (product marking).

2.3 BK3500 and BK3520 (optical fibers)

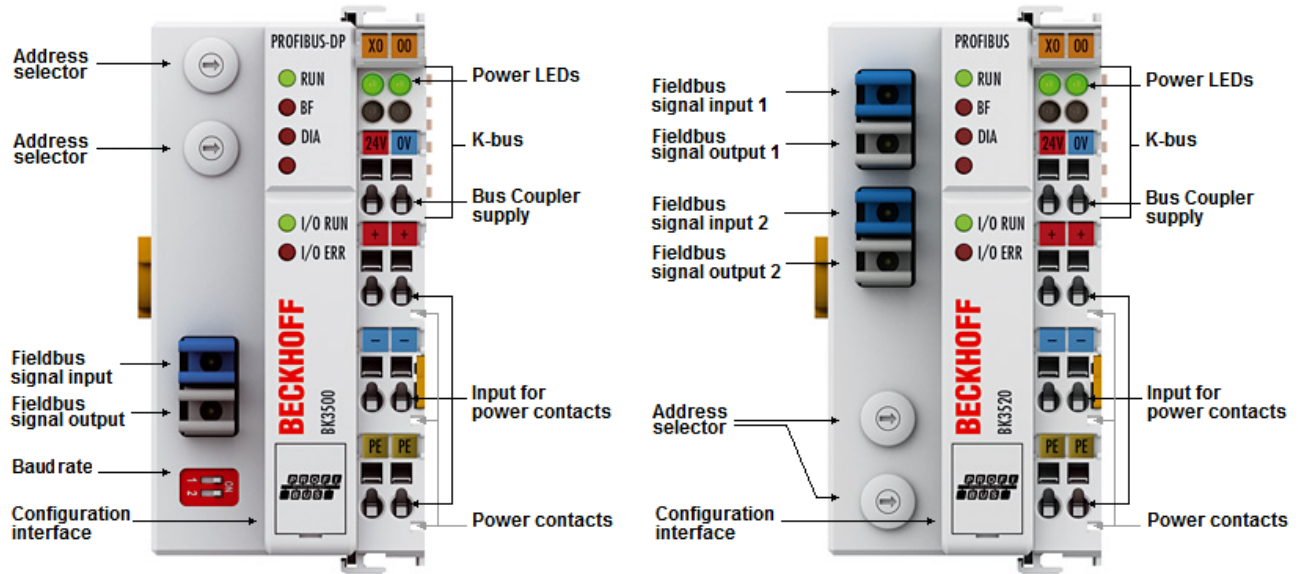


Fig. 3: BK3500 and BK3520 - Bus Couplers with optical fiber connection for PROFIBUS DP

Technical data

Type	BK3500	BK3520
Number of Bus Terminals	64	64 (255 with K-bus extension)
Digital peripheral signals	max. 512 inputs/outputs	max. 1020 inputs/outputs
Analog peripheral signals	max. 64 inputs/outputs	max. 64 inputs/outputs
Configuration possibility	Via the KS2000 configuration software or the controller	
Max. number of bytes (inputs and outputs)	128 bytes	128 bytes
Baud rates	up to max. 1.5 Mbaud (manual setting)	up to max. 12 Mbaud (automatic detection)
Bus connection	1 x optical fiber with 2 HP Simplex connectors	2 x optical fibers with 2 HP Simplex connectors each
Power supply	24 V _{DC} (-15% /+20%)	
Input current	70 mA + (total K-bus current)/4, 500 mA, 500 mA max.	
Starting current	2.5 x continuous current	
Recommended fuse	maximum 10 A	
K-bus power supply up to	1750 mA	
Power contact voltage	maximum 24 V _{DC}	
Power contact current load	maximum 10 A	
Electrical isolation	Power contact / supply / fieldbus	
Dielectric strength	500 V (power contact / supply / fieldbus)	
Weight	approx. 170 g	approx. 170 g
Permissible ambient temperature (operation)	0°C ... +55°C	
Permissible ambient temperature (storage)	-25°C ... +85°C	
Permissible relative humidity	95% (no condensation)	
Vibration / shock resistance	conforms to EN 60068-2-6 / EN 60068-2-27	
EMC immunity / emission	conforms to EN 61000-6-2 / EN 61000-6-4	
Protection class	IP20	
Installation position	variable	
Approvals / Markings*	CE, UKCA, cULus, EAC, ATEX [▶ 32]	
Ex markings	ATEX: II 3 G Ex nA IIC T4 Gc	

*) Real applicable approvals/markings see type plate on the side (product marking).

2.4 The Beckhoff Bus Terminal system

Up to 256 Bus Terminals, with 1 to 16 I/O channels per signal form

The Bus Terminal system is the universal interface between a fieldbus system and the sensor / actuator level. A unit consists of a Bus Coupler as the head station, and up to 64 electronic series terminals, the last one being an end terminal. Up to 255 Bus Terminals can be connected via the K-Bus extension. For each technical signal form, terminals are available with one, two, four or eight I/O channels, which can be mixed as required. All the terminal types have the same mechanical construction, so that difficulties of planning and design are minimized. The height and depth match the dimensions of compact terminal boxes.

Decentralized wiring of each I/O level

Fieldbus technology allows more compact forms of controller to be used. The I/O level does not have to be brought to the controller. The sensors and actuators can be wired decentrally, using minimum cable lengths. The controller can be installed at any location within the plant.

Industrial PCs as controllers

The use of an Industrial PC as the controller means that the operating and observing element can be implemented in the controller's hardware. The controller can therefore be located at an operating panel, in a control room, or at some similar place. The Bus Terminals form the decentralized input/output level of the controller in the control cabinet and the subsidiary terminal boxes. The power sector of the plant is also controlled over the bus system in addition to the sensor/actuator level. The Bus Terminal replaces the conventional series terminal as the wiring level in the control cabinet. The control cabinet can have smaller dimensions.

Bus Couplers for all usual bus systems

The Beckhoff Bus Terminal system unites the advantages of a bus system with the possibilities of the compact series terminal. Bus Terminals can be driven within all the usual bus systems, thus reducing the controller parts count. The Bus Terminals then behave like conventional connections for that bus system. All the performance features of the particular bus system are supported.

Mounting on standardized mounting rails

The installation is standardized thanks to the simple and space-saving mounting on a standardized mounting rail (EN 60715, 35 mm) and the direct wiring of actuators and sensors, without cross connections between the terminals. The consistent labelling scheme also contributes.

The small physical size and the great flexibility of the Bus Terminal system allow it to be used wherever a series terminal is also used. Every type of connection, such as analog, digital, serial or the direct connection of sensors can be implemented.

Modularity

The modular assembly of the terminal strip with Bus Terminals of various functions limits the number of unused channels to a maximum of one per function. The presence of two channels in one terminal is the optimum compromise of unused channels and the cost of each channel. The possibility of electrical isolation through potential feed terminals also helps to keep the number of unused channels low.

Display of the channel state

The integrated LEDs show the state of the channel at a location close to the sensors and actuators.

K-Bus

The K-Bus is the data path within a terminal strip. The K-Bus is led through from the Bus Coupler through all the terminals via six contacts on the terminals' side walls. The end terminal terminates the K-Bus. The user does not have to learn anything about the function of the K-Bus or about the internal workings of the terminals and the Bus Coupler. Many software tools that can be supplied make project planning, configuration and operation easy.

Potential feed terminals for isolated groups

The operating voltage is passed on to following terminals via three power contacts. You can divide the terminal strip into arbitrary isolated groups by means of potential feed terminals. The potential feed terminals play no part in the control of the terminals, and can be inserted at any locations within the terminal strip.

Up to 64 Bus Terminals can be used in a terminal block, with optional K-Bus extension for up to 256 Bus Terminals. This count does include potential feed terminals, but not the end terminal.

Bus Couplers for various fieldbus systems

Various Bus Couplers can be used to couple the electronic terminal strip quickly and easily to different fieldbus systems. It is also possible to convert to another fieldbus system at a later time. The Bus Coupler performs all the monitoring and control tasks that are necessary for operation of the connected Bus Terminals. The operation and configuration of the Bus Terminals is carried out exclusively by the Bus Coupler. Nevertheless, the parameters that have been set are stored in each Bus Terminal, and are retained in the event of voltage drop-out. Fieldbus, K-Bus and I/O level are electrically isolated.

If the exchange of data over the fieldbus is prone to errors or fails for a period of time, register contents (such as counter states) are retained, digital outputs are cleared, and analog outputs take a value that can be configured for each output when commissioning. The default setting for analog outputs is 0 V or 0 mA. Digital outputs return in the inactive state. The timeout periods for the Bus Couplers correspond to the usual settings for the fieldbus system. When converting to a different bus system it is necessary to bear in mind the need to change the timeout periods if the bus cycle time is longer.

The interfaces

A Bus Coupler has six different methods of connection. These interfaces are designed as plug connectors and as spring-loaded terminals.

2.5 PROFIBUS - Introduction

2.5.1 PROFIBUS DP

In PROFIBUS DP systems a master (PLC, PC, etc.) usually communicates with many slaves (I/Os, drives, etc.); only the master actively accesses the bus (by sending unsolicited telegrams), while a DP slave only sends telegrams when requested by the master.

DP StartUp

Before the master and slave can cyclically exchange data, the parameter and configuration data is transmitted from the master to the slaves during the DP StartUp phase. After the parameter and configuration data has been sent, the master interrogates the slave's diagnostic data until the slave indicates that it is ready for data exchange. Depending on the scope of the calculations the slave has to carry out as a result of receiving parameter and configuration data, it may take several seconds before it is ready for data exchange. For this reason the slave possesses the following states.

Parameter data

The parameter data is sent from the master to the slave in the SetPrmLock request telegram. The SetPrmLock response telegram does not contain any data, and therefore consists of a single byte, the short acknowledgement. The parameter data consists of DP parameters (e.g. the setting of the DP watchdog or

checking the IdentNumber (unique to each DP device)), of DPV1-/DPV2 parameters and of application-specific parameters that only have to be transmitted once during the StartUp. If an error is found in the parameter data, this is indicated in the diagnostic data, and the slave either remains in or enters the WAIT-PRM state.

Configuration data

The configuration data is sent from the master to the slave in the ChkCfg request telegram. The ChkCfg response telegram does not contain any data, and therefore consists of a single byte, the short acknowledgement. The configuration data describes the assignment of the DP modules to the cyclic I/O data that is to be exchanged between the master and slave via the Data_Exchange telegram in the cyclic data exchange phase. The sequence of the DP modules added to a slave in the DP configuration tool determines the sequence of the associated I/O data in the Data_Exchange telegram.

Diagnostic data

The diagnostic data is requested by the master using a SlaveDiag request telegram without any data. The slave replies with the diagnostic data in a SlaveDiag response telegram. The diagnostic data consists of the standard DP diagnostics (e.g. the state of the slave, the IdentNumber) and of application-specific diagnostic data.

Cyclic data exchange

At the core of the PROFIBUS DP protocol is the cyclic data exchange, during which the master exchanges I/O data with each slave within a PROFIBUS DP cycle. This involves the master sending the outputs to each slave with a DataExchange request telegram, while the slave replies with the inputs in a DataExchange response telegram. This means that all the output and/or input data is transmitted in one telegram, in which the DP configuration (the sequence of DP modules) specifies the assignment of the output and/or input data to the slave's actual process data.

Diagnosis during cyclic data exchange

A slave can send a diagnostics signal to the master during cyclic data exchange. In this case, the slave sets a flag in the DataExchange response telegram, whereby the master recognizes that there is new diagnostic data in the slave. It then fetches that data in the SlaveDiag telegram. The diagnostic data is therefore not available at the same time as the cyclic I/O data, but always delayed by at least one DP cycle.

Synchronisation with Sync and Freeze

The Sync and Freeze commands in the GlobalControl request telegram (broadcast telegram) allow the master to synchronise the activation of the outputs (Sync) or the reading of the inputs (Freeze) in a number of slaves. When the Sync command is used, the slaves are first switched into Sync mode (a process that is acknowledged in the diagnostic data). The I/O data is then exchanged sequentially with the slaves in the DataExchange telegram. Transmitting the Sync command in the GlobalControl telegram then has the effect of causing the slaves to generate the most recently received outputs. In Freeze operation a Freeze command is first sent in the GlobalControl telegram, in response to which all the slaves latch their inputs. These are then fetched sequentially by the master in the DataExchange telegram.

States in the master

The master distinguishes between the CLEAR state (all outputs are set to the Fail_Safe value) and the OPERATE state (all outputs have the process value). The Master is usually switched into the CLEAR mode when, for instance, the PLC enters STOP.

Class 1 and Class 2 DP Masters

The Class 1 master refers to the controller that carries out cyclic I/O data exchange with the slaves, while a Class 2 master is a B&B device that generally only has read access to the slaves' I/O data.

2.5.2 PROFIBUS DPV1

PROFIBUS DPV1 refers primarily to the read and write telegrams, with which data sets in the slave are acyclically accessed. A distinction between a Class 1 (C1) and a Class 2 (C2) master is also made for DPV1. The acyclic Class 1 or Class 2 connections differ in that the acyclic C1 connection is established with the DP startup of the cyclic DP mode. Acyclic DPV1 C1 read and write telegrams can be sent from the master to the slave from the state WAIT-CFG of the slave. In contrast, the C2 connection is established separately, usually by a second C2 master. For example, a manufacturer-specific project configuration and diagnostics tool can access the slave data independent of the cyclic DP connection.

When two masters are used, however, it must always be borne in mind that these share bus access (a token is exchanged), so that time relationships are less favorable than in the case of a single master system.

3 Mounting and wiring

3.1 Instructions for ESD protection

NOTE

Destruction of the devices by electrostatic discharge possible!

The devices contain components at risk from electrostatic discharge caused by improper handling.

- Please ensure you are electrostatically discharged and avoid touching the contacts of the device directly.
- Avoid contact with highly insulating materials (synthetic fibers, plastic film etc.).
- Surroundings (working place, packaging and personnel) should be grounded probably, when handling with the devices.
- Each assembly must be terminated at the right hand end with a KL9010 bus end terminal, to ensure the protection class and ESD protection.

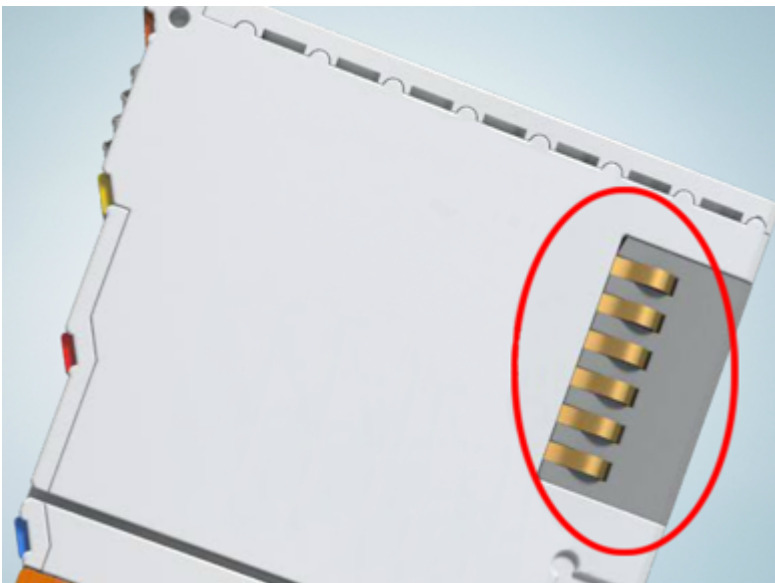


Fig. 4: Spring contacts of the Beckhoff I/O components

3.2 Dimensions

The Beckhoff Bus Terminal system is characterized by low physical volume and high modularity. When planning a project, it must be assumed that at least one Bus Coupler and a number of Bus Terminals will be used. The dimensions of the Bus Couplers are independent of the fieldbus system.

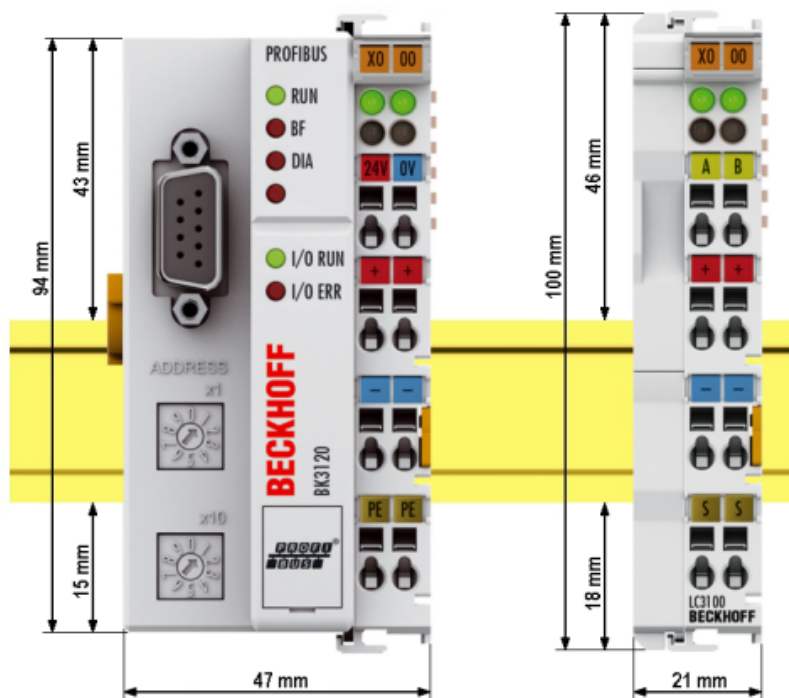


Fig. 5: Dimensions, using BK3120 and LC3100 as examples

The total width in practical cases is composed of the width of the Bus Coupler with the KL9010 Bus End Terminal and the width of the Bus Terminals in use. Depending on function, the Bus Terminals are 12 mm or 24 mm wide. The front wiring increases the total height of 68 mm by about 5 mm to 10 mm, depending on the wire thickness.

Mechanical data	BK3000, BK3010, BK3100, BK3110, BK3120, BK3500, BK3520	BK3150	LC3100
Material	polycarbonate, polyamide (PA 6.6)		
Dimensions (W x H x D)	50 mm x 100 mm x 68 mm	44 mm x 100 mm x 68 mm	21 mm x 100 mm x 68 mm
Mounting	on 35 mm mounting rail according to EN 60715 with locking mechanism		
Stackable by	double groove-tongue connection		
Labelling	Standard terminal block labelling and text slide (8 mm x 47 mm, not BK3150)		

3.3 Installation on mounting rails

The Bus Coupler and all the Bus Terminals can be clipped, with a light press, onto a 35 mm mounting rail. A locking mechanism prevents the individual housings from being pulled off again. For removal from the mounting rail the orange colored tension strap releases the latching mechanism, allowing the housing to be pulled off the rail without any force.

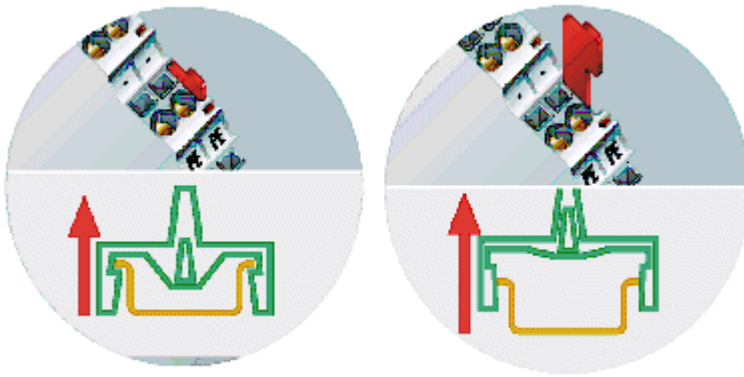


Fig. 6: Release the locking mechanism by pulling the orange tab

Up to 64 Bus Terminals can be attached to the Bus Coupler on the right hand side. When plugging the components together, be sure to assemble the housings with groove and tongue against each other. A properly working connection cannot be made by pushing the housings together on the mounting rail. When correctly assembled, no significant gap can be seen between the attached housings.

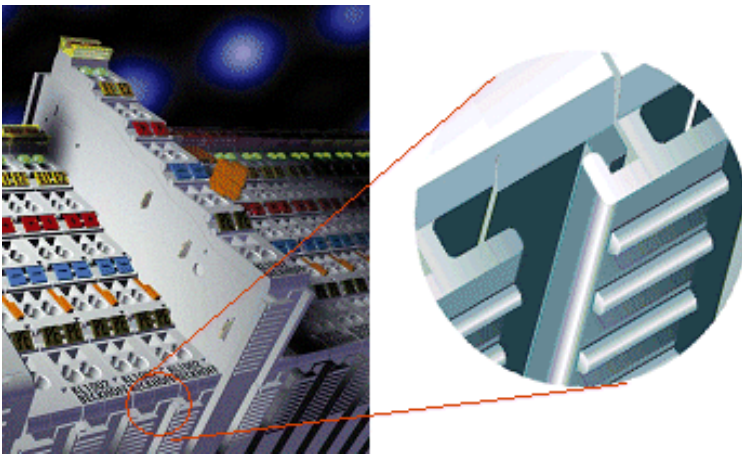


Fig. 7: Groove and tongue of the housings

NOTE

Bus Terminals should only be pulled or plugged in switched-off state.

Insertion and removal of Bus Terminals is only permitted when switched off. The electronics in the Bus Terminals and in the Bus Coupler are protected to a large measure against damage, but incorrect function and damage cannot be ruled out if they are plugged in under power.

3.4 Disposal



Products marked with a crossed-out wheeled bin shall not be discarded with the normal waste stream. The device is considered as waste electrical and electronic equipment. The national regulations for the disposal of waste electrical and electronic equipment must be observed.

3.5 Connection

3.5.1 Connection system

⚠ WARNING

Risk of electric shock and damage of device!

Bring the bus terminal system into a safe, powered down state before starting installation, disassembly or wiring of the bus terminals!

Overview

The bus terminal system offers different connection options for optimum adaptation to the respective application:

- The terminals of ELxxxx and KLxxxx series with standard wiring include electronics and connection level in a single enclosure.
- The terminals of ESxxxx and KSxxxx series feature a pluggable connection level and enable steady wiring while replacing.
- The High Density Terminals (HD Terminals) include electronics and connection level in a single enclosure and have advanced packaging density.

Standard wiring (ELxxxx / KLxxxx)



Fig. 8: Standard wiring

The terminals of ELxxxx and KLxxxx series have been tried and tested for years. They feature integrated screwless spring force technology for fast and simple assembly.

Pluggable wiring (ESxxxx / KSxxxx)



Fig. 9: Pluggable wiring

The terminals of ESxxxx and KSxxxx series feature a pluggable connection level. The assembly and wiring procedure is the same as for the ELxxxx and KLxxxx series. The pluggable connection level enables the complete wiring to be removed as a plug connector from the top of the housing for servicing. The lower section can be removed from the terminal block by pulling the unlocking tab. Insert the new component and plug in the connector with the wiring. This reduces the installation time and eliminates the risk of wires being mixed up.

The familiar dimensions of the terminal only had to be changed slightly. The new connector adds about 3 mm. The maximum height of the terminal remains unchanged.

A tab for strain relief of the cable simplifies assembly in many applications and prevents tangling of individual connection wires when the connector is removed.

Conductor cross sections between 0.08 mm² and 2.5 mm² can continue to be used with the proven spring force technology.

The overview and nomenclature of the product names for ESxxxx and KSxxxx series has been retained as known from ELxxxx and KLxxxx series.

High Density Terminals (HD Terminals)



Fig. 10: High Density Terminals

The terminals from these series with 16 terminal points are distinguished by a particularly compact design, as the packaging density is twice as large as that of the standard 12 mm bus terminals. Massive conductors and conductors with a wire end sleeve can be inserted directly into the spring loaded terminal point without tools.

● Wiring HD Terminals

i The High Density Terminals of the ELx8xx and KLx8xx series doesn't support pluggable wiring.

Ultrasonically “bonded” (ultrasonically welded) conductors

● Ultrasonically “bonded” conductors

i It is also possible to connect the Standard and High Density Terminals with ultrasonically “bonded” (ultrasonically welded) conductors. In this case, please note the tables concerning the [wire-size width](#) [▶ 22]!

3.5.2 Wiring

⚠ WARNING

Risk of electric shock and damage of device!

Bring the bus terminal system into a safe, powered down state before starting installation, disassembly or wiring of the bus terminals!

Terminals for standard wiring ELxxxx/KLxxxx and for pluggable wiring ESxxxx/KSxxxx

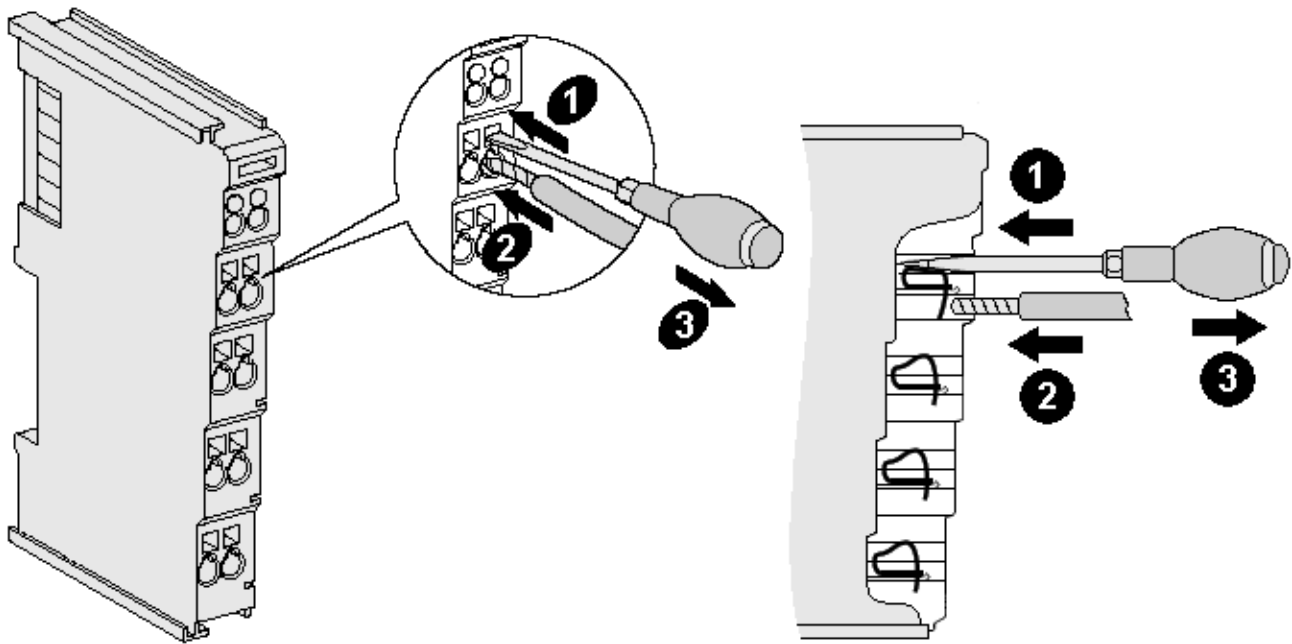


Fig. 11: Connecting a cable on a terminal point

Up to eight terminal points enable the connection of solid or finely stranded cables to the bus terminal. The terminal points are implemented in spring force technology. Connect the cables as follows:

1. Open a terminal point by pushing a screwdriver straight against the stop into the square opening above the terminal point. Do not turn the screwdriver or move it alternately (don't toggle).
2. The wire can now be inserted into the round terminal opening without any force.
3. The terminal point closes automatically when the pressure is released, holding the wire securely and permanently.

See the following table for the suitable wire size width.

Terminal housing	ELxxxx, KLxxxx	ESxxxx, KSxxxx
Wire size width (single core wires)	0.08 ... 2.5 mm ²	0.08 ... 2.5 mm ²
Wire size width (fine-wire conductors)	0.08 ... 2.5 mm ²	0.08 ... 2.5 mm ²
Wire size width (conductors with a wire end sleeve)	0.14 ... 1.5 mm ²	0.14 ... 1.5 mm ²
Wire stripping length	8 ... 9 mm	9 ... 10 mm

High Density Terminals (HD Terminals [▶ 21]) with 16 terminal points

The conductors of the HD Terminals are connected without tools for single-wire conductors using the direct plug-in technique, i.e. after stripping the wire is simply plugged into the terminal point. The cables are released, as usual, using the contact release with the aid of a screwdriver. See the following table for the suitable wire size width.

Terminal housing	High Density Housing
Wire size width (single core wires)	0.08 ... 1.5 mm ²
Wire size width (fine-wire conductors)	0.25 ... 1.5 mm ²
Wire size width (conductors with a wire end sleeve)	0.14 ... 0.75 mm ²
Wire size width (ultrasonically "bonded" conductors)	only 1.5 mm ² (see notice [▶ 21])
Wire stripping length	8 ... 9 mm

3.5.3 Potential groups, insulation testing and PE

Potential groups

A Beckhoff Bus Terminal block usually has three different potential groups:

- The fieldbus interface is electrically isolated (except for individual Low Cost couplers) and forms the first potential group.
- Bus Coupler / Bus Terminal Controller logic, K-bus and terminal logic form a second electrically isolated potential group.
- The inputs and outputs are supplied via the power contacts and form further potential groups.

Groups of I/O terminals can be consolidated to further potential groups via potential supply terminals or separation terminals.

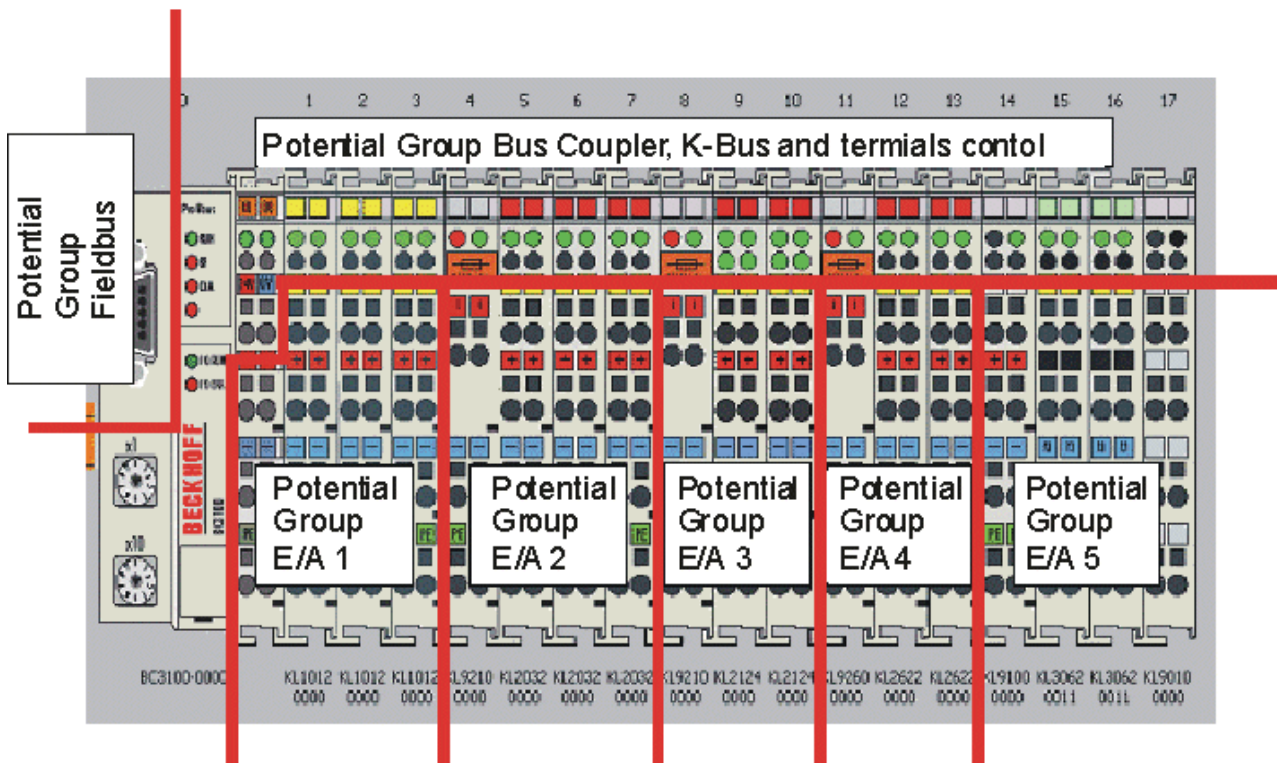


Fig. 12: Potential groups of a Bus Terminal block

Insulation testing

The connection between Bus Coupler / Bus Terminal Controller and Bus Terminals is realized automatically by latching the components. The transfer of the data and the supply voltage for the intelligent electronics in the Bus Terminals is performed by the K-bus. The supply of the field electronics is performed through the power contacts. Plugging together the power contacts creates a supply rail. Since some Bus Terminals (e.g. analog Bus Terminals or 4-channel digital Bus Terminals) are not looped through these power contacts or not completely the Bus Terminal contact assignments must be considered.

The potential feed terminals interrupt the power contacts, and represent the start of a new supply rail. The Bus Coupler / Bus Terminal Controller can also be used for supplying the power contacts.

PE power contacts

The power contact labelled PE can be used as a protective earth. For safety reasons this contact mates first when plugging together, and can ground short-circuit currents of up to 125 A.

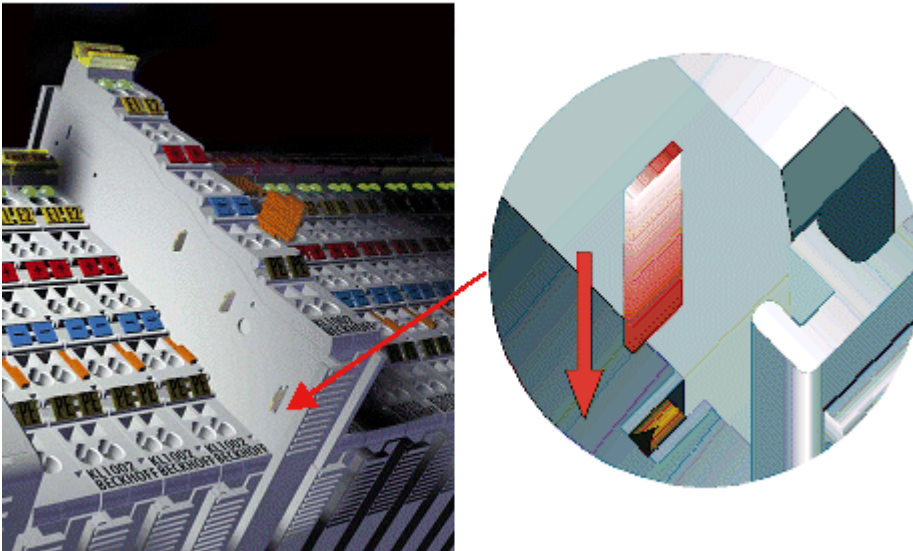


Fig. 13: Power contact on the left

It should be noted that, for reasons of electromagnetic compatibility, the PE contacts are capacitively coupled to the mounting rail. This can both lead to misleading results and to damaging the terminal during insulation testing (e.g. breakdown of the insulation from a 230 V power consuming device to the PE conductor). The PE supply line at the Bus Coupler / Bus Terminal Controller must be disconnected for an insulation test. In order to uncouple further feed locations for the purposes of testing, the feed terminals can be pulled at least 10 mm out from the connected group of other terminals. In that case, the PE conductors do not have to be disconnected.

The power contact with the label PE must not be used for other potentials.

3.5.4 Power supply

Supply of Bus Coupler / Bus Terminal Controller and Bus Terminals (Us)

⚠ WARNING

Risk of electric shock and damage of device!

Bring the bus terminal system into a safe, powered down state before starting installation, disassembly or wiring of the bus terminals!

3.5.4.1 BKxx00, BKxx10, BKxx20 and LCxxxx

The Bus Couplers / Bus Terminal Controllers require an operating voltage of 24 V_{DC}.

The connection is made by means of the upper spring-loaded terminals labelled 24 V and 0 V. This supply voltage is used for the electronic components of the Bus Coupler and Bus Terminal Controllers and (via the K-bus) the electronic components of the Bus Terminals. It is galvanically separated from the field level voltage.

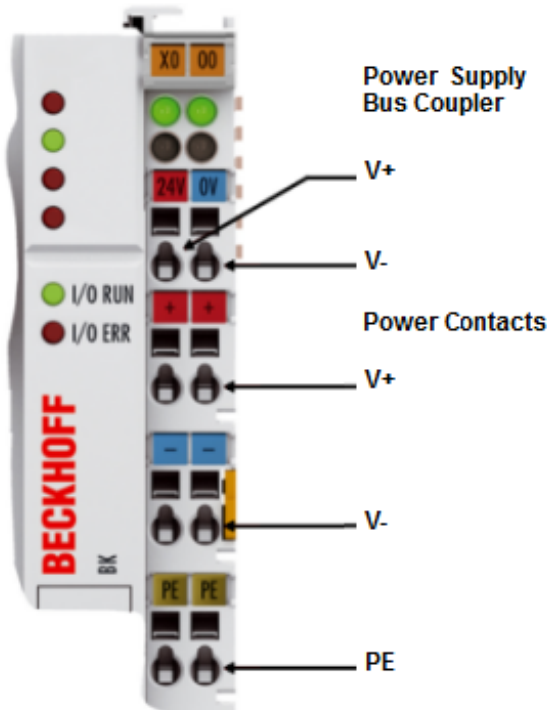


Fig. 14: Power supply connections for BKxx00, BKxx10, BKxx20 and LCxxxx

3.5.4.2 BKxx50 and BKxx51

The Bus Couplers / Bus Terminal Controllers require an operating voltage of 24 V_{DC}. Use a 4 A fuse or a Class 2 power supply to comply with the UL requirements.

The connection is made by means of the upper spring-loaded terminals labelled *Us* and *GNDs*. This supply voltage is used for the electronic components of the Bus Coupler and Bus Terminal Controllers and (via the K-bus) the electronic components of the Bus Terminals. It is galvanically separated from the field level voltage.

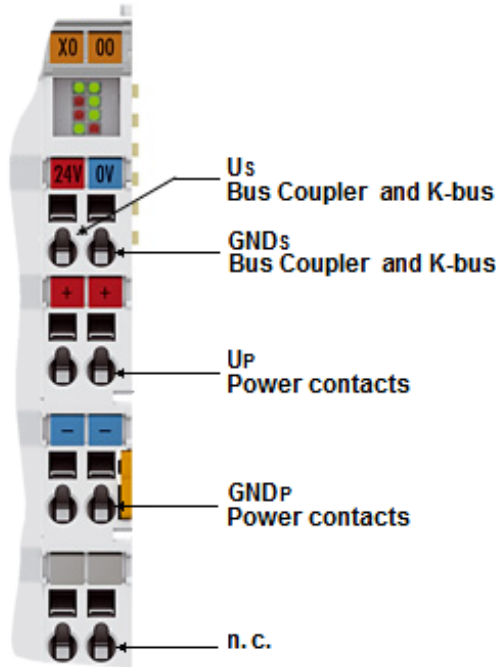


Fig. 15: Power supply connections for BKxx50 and BKxx51

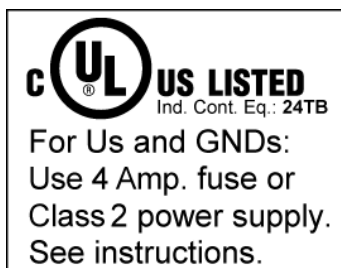


Fig. 16: UL identification

⚠ CAUTION	
	<p>Note the UL requirements for the power supply.</p> <p>To comply with the UL requirements, the 24 V_{DC} supply voltage for <i>Us</i> must originate</p> <ul style="list-style-type: none"> • from an isolated source protected by a fuse of max. 4A (according to UL248) or • from a voltage supply complying with NEC class 2. <p>An NEC class 2 voltage source must not be connected in series or parallel with another NEC class 2 voltage source!</p>
⚠ CAUTION	
	<p>No unlimited voltage sources!</p> <p>To comply with the UL requirements, <i>Us</i> must not be connected with unlimited voltage sources.</p>

3.5.4.3 Configuration and Programming Interface

The standard Bus Couplers have an RS232 interface at the bottom of the front face. The miniature plug connector can be connected to a PC using a connecting cable and the KS2000 configuration software. The interface permits the Bus Terminals to be configured, for example adjusting the amplification factors of the analog channels. The interface can also be used to change the assignments of the bus terminal data to the process image in the Bus Coupler. The functionality of the configuration interface can also be reached via the fieldbus using string communication facility.

3.5.4.4 Electrical isolation

The Bus Couplers / Bus Terminal Controllers operate with three independent potential groups. The supply voltage feeds the K-bus electronics and the K-bus itself. The supply voltage is also used to generate the operating voltage for the fieldbus interface.

Note: All the Bus Terminals are electrically isolated from the K-bus. The K-bus is thus electrically isolated from everything else.

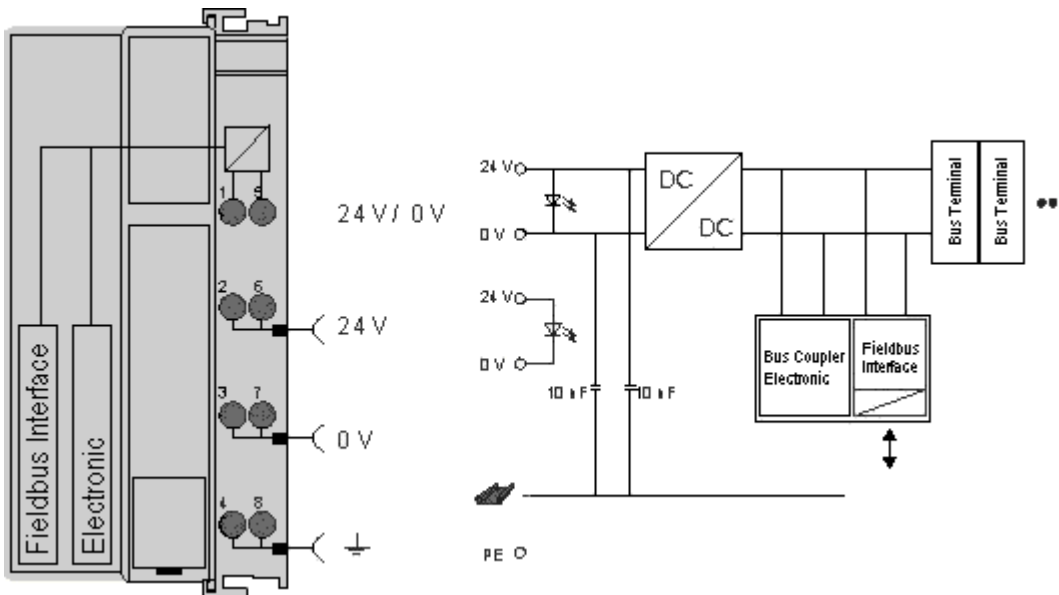


Fig. 17: Potential connection diagram of an EKxxxx

3.5.4.5 Power contacts

Power contacts supply (Up)

The bottom six connections with spring-loaded terminals can be used to feed the supply for the peripherals. The spring-loaded terminals are joined in pairs to a power contact. The power supply for the power contacts has no connection to the power supply for the Bus Couplers / Bus Terminal Controllers.

The spring-loaded terminals are designed for wires with cross-sections between 0.08 mm² and 2.5 mm².

The assignment in pairs and the electrical connection between feed terminal contacts allows the connection wires to be looped through to various terminal points. The current load from the power contact must not exceed 10 A for long periods. The current carrying capacity between two spring-loaded terminals is identical to that of the connecting wires.

Power contacts

Three spring contacts of the power contact connections can be found on the right of the Bus Coupler / Bus Terminal Controller. The spring contacts are hidden in slots so that they cannot be accidentally touched. By attaching a Bus Terminal the blade contacts on the left hand side of the Bus Terminal are connected to the spring contacts. The tongue & groove design of the top and bottom of the Bus Coupler / Bus Terminal Controller and Bus Terminals enables secure fitting of the power contacts.

3.5.5 PROFIBUS cabling

3.5.5.1 PROFIBUS Connection

M12 round connector

The M12 socket is inverse-coded and has five pins. Pin 1 transfers 5 V_{DC}, pin 3 transfers GND for the active termination resistor. These must never be misused for other functions, as this can lead to destruction of the device.

Pins 2 and 4 transfer the PROFIBUS signals. These must never be swapped over, as this will prevent communication. Pin 5 transfers the shield, which is capacitively connected to the base of the Fieldbus Box.

Pin assignment M12 socket (-B310)

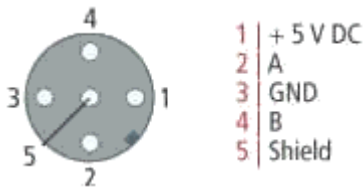


Fig. 18: Pin assignment M12 socket (-B310)

Pin assignment M12 socket/plug connector (-B318)

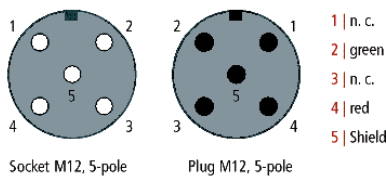


Fig. 19: Pin assignment M12 socket/plug connector (-B318)

Nine-pin D-Sub

Pin 6 transfers 5 V_{DC}, pin 5 transfers GND for the active termination resistor. These must never be misused for other functions, as this can lead to destruction of the device.

Pins 3 and 8 transfer the PROFIBUS signals. These must never be swapped over, as this will prevent communication.

Pin assignment of the PROFIBUS D-sub socket

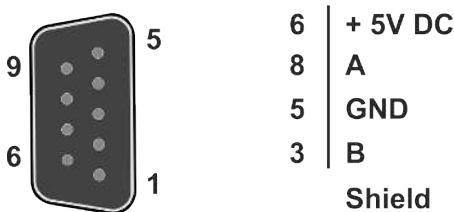


Fig. 20: Pin assignment of the PROFIBUS D-sub socket

PROFIBUS wire colors

PROFIBUS line	M12	D-Sub
B red	Pin 4	Pin 3
A green	Pin 2	Pin 8

Connection of the Fieldbus Box modules

The Fieldbus Box modules are connected either directly or via a T-piece (or Y-piece).

The B318 series features a socket and a plug connector, i.e. this is where the PROFIBUS is routed in the module. The supply voltage (+5 V_{DC}) for the termination resistor is only present at the socket. The termination resistor ZS1000-1610 is only available as a plug connector.

The incoming PROFIBUS line should always end with a socket.

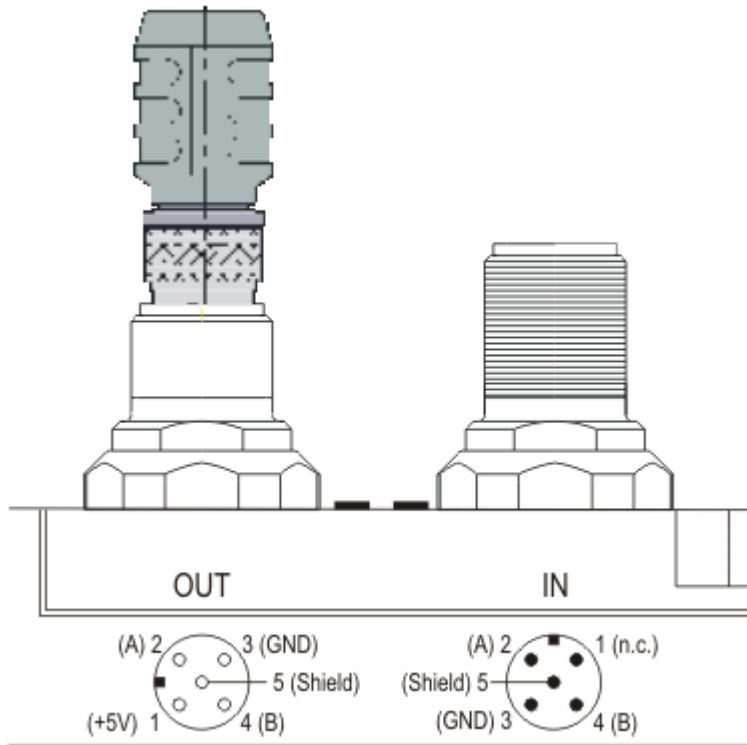


Fig. 21: Pin assignment socket/plug connector Fieldbus Box modules

Two T-pieces are available:

- ZS1031-2600 with +5 V_{DC} transfer for supplying the termination resistor
- ZS1031-2610 without +5 V_{DC} transfer

3.5.5.2 PROFIBUS cabling

Physical aspects of the data transmission are defined in the PROFIBUS standard (see PROFIBUS layer 1: Physical Layer).

The types of area where a fieldbus system can be used is largely determined by the choice of the transmission medium and the physical bus interface. In addition to the requirements for transmission security, the expense and work involved in acquiring and installing the bus cable is of crucial significance. The PROFIBUS standard therefore allows for a variety of implementations of the transmission technology while retaining a uniform bus protocol.

Cable-based transmission

This version, which accords with the American EIA RS-485 standard, was specified as a basic version for applications in production engineering, building management and drive technology. A twisted copper cable with one pair of conductors is used. Depending on the intended application area (EMC aspects should be considered) the screening may be omitted.

Two types of conductor are available, with differing maximum conductor lengths (see the RS-485 table).

RS485 - Fundamental properties

RS-485 transmission according to the PROFIBUS standard	
Network topology	Linear bus, active bus terminator at both ends, stubs are possible.
Medium	Screened twisted cable, screening may be omitted, depending upon the environmental conditions (EMC).
Number of stations	32 stations in each segment with no repeater. Can be extended to 127 stations with repeater
Max. bus length without repeater	100 m at 12 Mbit/s 200 m at 1500 Kbit/s, up to 1.2 km at 93.75 kbit/s
Max. bus length with repeater	Line amplifiers, or repeaters, can increase the bus length up to 10 km. The number of repeaters possible is at least 3, and, depending on the manufacturer, may be up to 10.
Transmission speed (adjustable in steps)	9.6 kbit/s; 19.2 kbit/s; 93.75 kbit/s; 187.5 kbit/s; 500 kbit/s; 1500 kbit/s; 12 Mbit/s
Connector	9-pin D-Sub connector for IP20 M12 round connector for IP65/67

Cabling for PROFIBUS DP and PROFIBUS FMS

Note the special requirements on the data cable for baud rates greater than 1.5 Mbaud. The correct cable is a basic requirement for correct operation of the bus system. If a simple 1.5 Mbaud cable is used, reflections and excessive attenuation can lead to some surprising phenomena. It is possible, for instance, for a connected PROFIBUS station not to achieve a connection, but for it to be included again when the neighboring station is disconnected. Or there may be transmission errors when a specific bit pattern is transmitted. The result of this can be that when the equipment is not operating, PROFIBUS works without faults, but that there are apparently random bus errors after start-up. Reducing the baud rate (< 93.75 kbaud) corrects this faulty behavior.

If reducing the baud rate does not correct the error, then in many cases this can indicate a wiring fault. The two data lines may be crossed over at one or more connectors, or the termination resistors may not be active, or they may be active at the wrong locations.

● Recommended cables

i Installation is made a great deal more straightforward if preassembled cables from Beckhoff are used! Wiring errors are avoided, and commissioning is more rapidly completed. The Beckhoff range includes fieldbus cables, power supply cables, sensor cables and accessories such as termination resistors and T-pieces. Connectors and cables for field assembly are nevertheless also available.

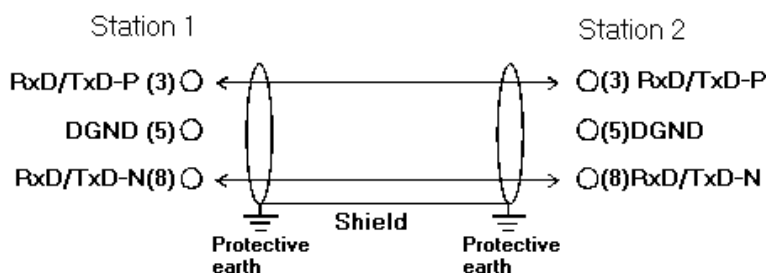


Fig. 22: PROFIBUS cable assignment

● Termination resistors

i In systems with more than two stations all devices are wired in parallel. The PROFIBUS cable must be terminated with resistances at both ends, in order to avoid reflections and associated transfer problems.

Distances

The bus cable is specified in EN 50170. This yields the following lengths for a bus segment.

Baud rate in kbits/sec	9.6	19.2	93.75	187.5	500	1500	12000
Cable length in m	1200	1200	1200	1000	400	200	100

Stubs up to 1500 kbaud <6.6 m; at 12 Mbaud stub segments should not be used.

Bus segments

A bus segment consists of at most 32 devices. 126 devices are permitted in a PROFIBUS network. Repeaters are required to refresh the signal in order to achieve this number. Each repeater is counted as one device.

IP-Link is the subsidiary bus system for Fieldbus Boxes, whose topology is a ring structure. There is an IP master in the coupler modules (IP230x-Bxxx or IP230x-Cxxx) to which up to 120 extension modules (IExxxx) may be connected. The distance between two modules may not exceed 5 m. When planning and installing the modules, remember that because of the ring structure the IP-Link master must be connected again to the last module.

Installation guidelines

When assembling the modules and laying the cables, observe the technical guidelines provided by the PROFIBUS User Organization (PROFIBUS Nutzerorganisation e.V.) for PROFIBUS DP/FMS (see <https://www.profibus.com>).

Checking the PROFIBUS wiring

A PROFIBUS cable (or a cable segment when using repeaters) can be checked with a few simple resistance measurements. The cable should meanwhile be removed from all stations:

1. Resistance between A and B at the start of the lead: approx. 110 Ohm
2. Resistance between A and B at the end of the lead: approx. 110 Ohm
3. Resistance between A at the start and A at the end of the lead: approx. 0 Ohm
4. Resistance between B at the start and B at the end of the lead: approx. 0 Ohm
5. Resistance between screen at the start and screen at the end of the lead: approx. 0 Ohm

If these measurements are successful, the cable is okay. If, in spite of this, bus malfunctions still occur, this is usually a result of EMC interference. Observe the installation notes from the PROFIBUS User Organization (<https://www.profibus.com>).

3.6 Notes on operation in areas subject to an explosion hazard

3.6.1 ATEX - Special conditions (standard temperature range)

⚠ WARNING

Observe the special conditions for the intended use of Beckhoff fieldbus components with standard temperature range in potentially explosive areas (directive 2014/34/EU)!

- The certified components are to be installed in a suitable housing that guarantees a protection class of at least IP54 in accordance with EN 60079-15! The environmental conditions during use are thereby to be taken into account!
- For dust (only the fieldbus components of certificate no. KEMA 10ATEX0075 X Issue 9): The equipment shall be installed in a suitable enclosure providing a degree of protection of IP54 according to EN 60079-31 for group IIIA or IIIB and IP6X for group IIIC, taking into account the environmental conditions under which the equipment is used!
- If the temperatures during rated operation are higher than 70°C at the feed-in points of cables, lines or pipes, or higher than 80°C at the wire branching points, then cables must be selected whose temperature data correspond to the actual measured temperature values!
- Observe the permissible ambient temperature range of 0 to 55°C for the use of Beckhoff fieldbus components standard temperature range in potentially explosive areas!
- Measures must be taken to protect against the rated operating voltage being exceeded by more than 40% due to short-term interference voltages!
- The individual terminals may only be unplugged or removed from the Bus Terminal system if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!
- The connections of the certified components may only be connected or disconnected if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!
- The fuses of the KL92xx/EL92xx power feed terminals may only be exchanged if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!
- Address selectors and ID switches may only be adjusted if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!

Standards

The fundamental health and safety requirements are fulfilled by compliance with the following standards:

- EN 60079-0:2012+A11:2013
- EN 60079-15:2010
- EN 60079-31:2013 (only for certificate no. KEMA 10ATEX0075 X Issue 9)

Marking

The Beckhoff fieldbus components with standard temperature range certified according to the ATEX directive for potentially explosive areas bear one of the following markings:



II 3G KEMA 10ATEX0075 X Ex nA IIC T4 Gc Ta: 0 ... +55°C
 II 3D KEMA 10ATEX0075 X Ex tc IIIC T135°C Dc Ta: 0 ... +55°C
 (only for fieldbus components of certificate no. KEMA 10ATEX0075 X Issue 9)

or



II 3G KEMA 10ATEX0075 X Ex nA nC IIC T4 Gc Ta: 0 ... +55°C
 II 3D KEMA 10ATEX0075 X Ex tc IIIC T135°C Dc Ta: 0 ... +55°C
 (only for fieldbus components of certificate no. KEMA 10ATEX0075 X Issue 9)

3.6.2 ATEX - Special conditions (extended temperature range)

⚠ WARNING

Observe the special conditions for the intended use of Beckhoff fieldbus components with extended temperature range (ET) in potentially explosive areas (directive 2014/34/EU)!

- The certified components are to be installed in a suitable housing that guarantees a protection class of at least IP54 in accordance with EN 60079-15! The environmental conditions during use are thereby to be taken into account!
- For dust (only the fieldbus components of certificate no. KEMA 10ATEX0075 X Issue 9): The equipment shall be installed in a suitable enclosure providing a degree of protection of IP54 according to EN 60079-31 for group IIIA or IIIB and IP6X for group IIIC, taking into account the environmental conditions under which the equipment is used!
- If the temperatures during rated operation are higher than 70°C at the feed-in points of cables, lines or pipes, or higher than 80°C at the wire branching points, then cables must be selected whose temperature data correspond to the actual measured temperature values!
- Observe the permissible ambient temperature range of -25 to 60°C for the use of Beckhoff fieldbus components with extended temperature range (ET) in potentially explosive areas!
- Measures must be taken to protect against the rated operating voltage being exceeded by more than 40% due to short-term interference voltages!
- The individual terminals may only be unplugged or removed from the Bus Terminal system if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!
- The connections of the certified components may only be connected or disconnected if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!
- The fuses of the KL92xx/EL92xx power feed terminals may only be exchanged if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!
- Address selectors and ID switches may only be adjusted if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!

Standards

The fundamental health and safety requirements are fulfilled by compliance with the following standards:

- EN 60079-0:2012+A11:2013
- EN 60079-15:2010
- EN 60079-31:2013 (only for certificate no. KEMA 10ATEX0075 X Issue 9)

Marking

The Beckhoff fieldbus components with extended temperature range (ET) certified according to the ATEX directive for potentially explosive areas bear the following marking:



II 3G KEMA 10ATEX0075 X Ex nA IIC T4 Gc Ta: -25 ... +60°C
 II 3D KEMA 10ATEX0075 X Ex tc IIIC T135°C Dc Ta: -25 ... +60°C
 (only for fieldbus components of certificate no. KEMA 10ATEX0075 X Issue 9)

or



II 3G KEMA 10ATEX0075 X Ex nA nC IIC T4 Gc Ta: -25 ... +60°C
 II 3D KEMA 10ATEX0075 X Ex tc IIIC T135°C Dc Ta: -25 ... +60°C
 (only for fieldbus components of certificate no. KEMA 10ATEX0075 X Issue 9)

3.6.3 IECEx - Special conditions

⚠ WARNING

Observe the special conditions for the intended use of Beckhoff fieldbus components in potentially explosive areas!

- For gas: The equipment shall be installed in a suitable enclosure providing a degree of protection of IP54 according to IEC 60079-15, taking into account the environmental conditions under which the equipment is used!
- For dust (only the fieldbus components of certificate no. IECEx DEK 16.0078X Issue 3):
The equipment shall be installed in a suitable enclosure providing a degree of protection of IP54 according to EN 60079-31 for group IIIA or IIIB and IP6X for group IIIC, taking into account the environmental conditions under which the equipment is used!
- The equipment shall only be used in an area of at least pollution degree 2, as defined in IEC 60664-1!
- Provisions shall be made to prevent the rated voltage from being exceeded by transient disturbances of more than 119 V!
- If the temperatures during rated operation are higher than 70°C at the feed-in points of cables, lines or pipes, or higher than 80°C at the wire branching points, then cables must be selected whose temperature data correspond to the actual measured temperature values!
- Observe the permissible ambient temperature range for the use of Beckhoff fieldbus components in potentially explosive areas!
- The individual terminals may only be unplugged or removed from the Bus Terminal system if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!
- The connections of the certified components may only be connected or disconnected if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!
- Address selectors and ID switches may only be adjusted if the supply voltage has been switched off or if a non-explosive atmosphere is ensured!
- The front hatch of certified units may only be opened if the supply voltage has been switched off or a non-explosive atmosphere is ensured!

Standards

The fundamental health and safety requirements are fulfilled by compliance with the following standards:

- EN 60079-0:2011
- EN 60079-15:2010
- EN 60079-31:2013 (only for certificate no. IECEx DEK 16.0078X Issue 3)

Marking

Beckhoff fieldbus components that are certified in accordance with IECEx for use in areas subject to an explosion hazard bear the following markings:

Marking for fieldbus components of certificate no. IECEx DEK 16.0078X Issue 3:	IECEx DEK 16.0078 X
	Ex nA IIC T4 Gc
	Ex tc IIIC T135°C Dc

Marking for fieldbus components of certificates with later issues:	IECEx DEK 16.0078 X
	Ex nA IIC T4 Gc

3.6.4 Continuative documentation for ATEX and IECEx

NOTE



Continuative documentation about explosion protection according to ATEX and IECEx

Pay also attention to the continuative documentation

Ex. Protection for Terminal Systems

Notes on the use of the Beckhoff terminal systems in hazardous areas according to ATEX and IECEx,

that is available for [download](#) within the download area of your product on the Beckhoff homepage www.beckhoff.com!

3.6.5 cFMus - Special conditions

⚠ WARNING

Observe the special conditions for the intended use of Beckhoff fieldbus components in potentially explosive areas!

- The equipment shall be installed within an enclosure that provides a minimum ingress protection of IP54 in accordance with ANSI/UL 60079-0 (US) or CSA C22.2 No. 60079-0 (Canada).
- The equipment shall only be used in an area of at least pollution degree 2, as defined in IEC 60664-1.
- Transient protection shall be provided that is set at a level not exceeding 140% of the peak rated voltage value at the supply terminals to the equipment.
- The circuits shall be limited to overvoltage Category II as defined in IEC 60664-1.
- The Fieldbus Components may only be removed or inserted when the system supply and the field supply are switched off, or when the location is known to be non-hazardous.
- The Fieldbus Components may only be disconnected or connected when the system supply is switched off, or when the location is known to be non-hazardous.

Standards

The fundamental health and safety requirements are fulfilled by compliance with the following standards:

M20US0111X (US):

- FM Class 3600:2018
- FM Class 3611:2018
- FM Class 3810:2018
- ANSI/UL 121201:2019
- ANSI/ISA 61010-1:2012
- ANSI/UL 60079-0:2020
- ANSI/UL 60079-7:2017

FM20CA0053X (Canada):

- CAN/CSA C22.2 No. 213-17:2017
- CSA C22.2 No. 60079-0:2019
- CAN/CSA C22.2 No. 60079-7:2016
- CAN/CSA C22.2 No.61010-1:2012

Marking

Beckhoff fieldbus components that are certified in accordance with cFMus for use in areas subject to an explosion hazard bear the following markings:

FM20US0111X (US): **Class I, Division 2, Groups A, B, C, D**
 Class I, Zone 2, AEx ec IIC T4 Gc

FM20CA0053X (Canada): **Class I, Division 2, Groups A, B, C, D**
 Ex ec T4 Gc

3.6.6 Continuative documentation for cFMus

NOTE**Continuative documentation about explosion protection according to cFMus**

Pay also attention to the continuative documentation

Control Drawing I/O, CX, CPX

Connection diagrams and Ex markings,

that is available for [download](#) within the download area of your product on the Beckhoff homepage www.beckhoff.com!

4 Parameterization and commissioning

4.1 Start-up behaviour of the Bus Coupler

Immediately after being switched on, the Bus Coupler checks, in the course of a self-test, all the functions of its components and the communication on the K-bus/E-bus. The red I/O LED blinks while this is happening. After completion of the self-test, the Bus Coupler starts to test the attached Bus Terminals (the "Bus Terminal Test"), and reads in the configuration. The Bus Terminal configuration is used to generate an internal structure list, which is not accessible from outside. In case of an error, the Bus Coupler enters the *Stop* state. Once the start-up has completed without error, the Bus Coupler enters the *fieldbus start* state.

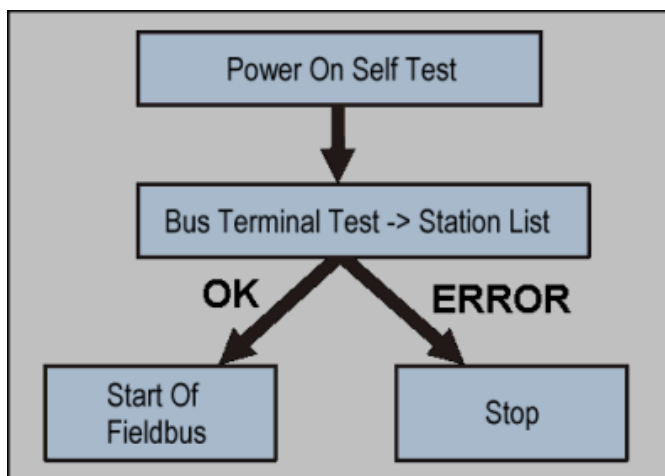


Fig. 23: Start-up behaviour of the Bus Coupler

The Bus Coupler can be made to enter the normal operating state by switching it on again once the fault has been rectified.

4.2 The Bus Coupler's UserPrmData

The following settings can be made in the Bus Coupler's UserPrmData. So that a more easily understood [GSD file \[▶ 45\]](#) is obtained in 90% of applications, some of the settings are only contained in text form in the [Extended GSD file \[▶ 45\]](#), and these are indicated in the last column by *Extended*. The standard settings are contained both in the standard and the [extended GSD file \[▶ 45\]](#).

Byte	Bit	Value	Description	GSD file
0	7	0 _{bin}	MSAC_C1 connection is not active (default)	Standard
		1 _{bin}	MSAC_C1 connection is active (see DPV1 [▶ 60])	
1	0	0 _{bin}	CfgData checking is active (default)	Extended
		1 _{bin}	CfgData checking deactivated (see Deactivating the CfgData checking [▶ 77])	
2	3	0 _{bin}	Diagnostic data is transferred in a form compatible with the BK3100	Extended
		1 _{bin}	Diagnostic data is transferred in a form compatible with DPV1 (default)	
3	3	0 _{bin}	K-bus cycle counter is not active (default)	Extended
		1 _{bin}	K-bus cycle counter is active (see K-bus cycle [▶ 57])	
3	4	0 _{bin}	Multi-configuration mode is not active (default)	Extended
		1 _{bin}	Multi-configuration mode is active (see Multi-configuration mode [▶ 77])	
3	5	0 _{bin}	Dummy output byte not active (default)	Extended
		1 _{bin}	Dummy output byte is active (see K-bus cycle [▶ 57])	
3	6	0 _{bin}	MCM startup "Static diagnostics" In multi-configuration mode, the coupler sets the <i>Stat_Diag</i> bit in the diagnostic data if the configuration is not consistent, and does not yet enter data exchange (default).	Extended
		1 _{bin}	MCM startup "Data exchange without K-bus" In multi-configuration mode the coupler also enters data exchange even when the configuration is not consistent, although K-bus cycles are not yet executed (see Multi-configuration mode [▶ 77])	
5	0	0 _{bin}	2-byte PLC interface not activated (default)	Extended
		1 _{bin}	2-byte PLC interface is active (see 2-byte PLC interface [▶ 76])	
7	0	0 _{bin}	Response to K-bus error: Manual K-bus reset (default) (see K-bus interruption [▶ 73])	Standard
		1 _{bin}	Response to K-bus error: automatic K-bus reset	
7	1	0 _{bin}	Terminal diagnosis is not active (default) (see Terminal diagnosis [▶ 74])	Standard
		1 _{bin}	Terminal diagnosis is active	
7	4	0 _{bin}	Diagnostic data for digital terminals included in process image (default) (see Terminal diagnosis [▶ 74])	Standard
		1 _{bin}	Diagnostic data of digital terminals not in the process image (default)	
9	2	0 _{bin}	Analog modules are mapped in compact form (only showing the input and/or output user data) (this is the default, only relevant when CfgData checking has been deactivated, otherwise the terminals are set by means of the CfgData) (see Deactivation of CfgData checking [▶ 77])	Extended
		1 _{bin}	Analog modules are mapped in complex form (with control/status for register access and with the same data length in inputs and outputs) (only relevant when CfgData checking has been deactivated, otherwise the terminals are set by means of the CfgData)	
9	3	0 _{bin}	Representation in INTEL format	Standard
		1 _{bin}	Representation in Motorola format (default)	
9	4	0 _{bin}	K-bus mode slow FreeRun (default) (see K-bus cycle [▶ 57])	Standard
		1 _{bin}	K-bus mode fast FreeRun	
9	5	0 _{bin}	WORD alignment inactive (default)	Extended
		1 _{bin}	WORD alignment active (see WORD alignment [▶ 76])	
9	6	0 _{bin}	K-bus mode is synchronous (see K-bus cycle [▶ 57])	Standard
		1 _{bin}	K-bus mode FreeRun (default)	

Byte	Bit	Value	Description	GSD file
10	0-1	00 _{bin}	Reaction to PROFIBUS error: K-bus cycle is abandoned (default, digital outputs become 0, complex outputs are set to a configured substitute value) (see Reaction to PROFIBUS errors [► 73])	Standard
		01 _{bin}	Reaction to PROFIBUS error: K-bus outputs become 0	
		10 _{bin}	Reaction to PROFIBUS error: K-bus outputs remain unchanged	
10	2-3	00 _{bin}	Reaction to K-bus error: DP data exchange is abandoned (default) (see K-bus interruption [► 73])	Standard
		01 _{bin}	Reaction to K-bus error: DP inputs set to 0	
		10 _{bin}	Reaction to K-bus error: DP inputs remain unchanged	
11	3-6	X	Maximum length of the diagnostic data. Allowed values: 16, 24, 32, 40, 48, 56, 64 (see Terminal diagnosis [► 74])	Extended
12	0-1	0 _{bin}	If K-bus mode is synchronous: Standard synchronous mode (default) (see K-bus cycle [► 57])	Extended
		01 _{bin}	If K-bus mode is synchronous: synchronous mode with optimized input update (one cycle)	
		10 _{bin}	If K-bus mode is synchronous: synchronous mode with optimized input update (two cycles)	
12	4-7	0 _{bin}	Maximum DP buffer lengths not changed	Extended
12	4-7	15	The maximum DP buffer lengths are changed using the values from UserPrmData 37-40 (see Multi-configuration mode [► 77])	Extended
13	0-7	X	Delay time (in µs) high byte (see K-bus cycle [► 57])	Extended
14	0-7	X	Delay time (in µs) low byte (see K-bus cycle [► 57])	Extended
15-30	0-7	X	Assignment of Bus Terminals 1 to 64 (see Multi-configuration mode [► 77])	Extended
31-36	0-7	-	Reserved	Extended
37	0-7	X	Maximum length of the input data (see Multi-configuration mode [► 77])	Extended
38	0-7	X	Maximum length of the output data (see Multi-configuration mode [► 77])	Extended
39	0-7	X	Maximum length of the diagnostic data (see Multi-configuration mode [► 77])	Extended
40	0-7	X	Maximum length of the configuration data (see Multi-configuration mode [► 77])	Extended
41-56	0-7	X	Assignment of terminals 65 to 128 (see Multi-configuration mode [► 77])	Extended

4.3 Technical data - overview

Description	BK3010	BK3110	BK3120	BK3150	BK3500	BK3520	LC3100	BC3100
Number of Bus Terminals	64	64	255	255	64	255	64	64
Baud rate [Mbaud]	1,5	12	12	12	1,5	12	12	12
Physical basis	RS 485	RS 485	RS 485	RS 485	Optical fibers	Optical fibers	RS 485	RS 485
UserPrm Data								
DPV1 Services	x	x	x	x	x	x	x	x
Multi-configuration mode	x	x	x	x	x	x	x	
Word Align			x	x	x	x		
Byte oriented Bus Terminals			x	x	x	x		x
Distributed control								
PLC IEC 6 1131-3								x

4.4 Configuration

4.4.1 Configuration - CfgData

The CfgData is generated from the modules inserted in the DP configuration tool. When modules are added, the following rules are to be observed:

Sequence of DP modules to be added in the DP configuration tool
Modules for the coupler's functions [▶ 41]
Complex function modules [▶ 42]
Digital function modules [▶ 44]

For TwinCAT applications, these rules are followed by the TwinCAT system manager. It adds the terminals or IE modules in the sequence in which they are plugged in, and the modules for functions are added automatically if the corresponding function is activated in the [UserPrmData](#) [[▶ 38](#)].

4.4.2 Configuration of the Coupler Modules

The DP modules for the following Bus Coupler functions are to be added first in the DP configuration tool if the associated function is activated (if the function is not activated, the corresponding DP module is not to be added):

Function module	Activation of the function
2-byte PLC Interface	The 2-byte PLC interface is activated via the UserPrmData [▶ 38] (byte 5, bit 0). By default it is not active.
K-bus cycle counter	The K-bus cycle counter [▶ 57] is activated via the UserPrmData [▶ 38] (byte 3, bit 3). By default it is not active.
Dummy output byte	The dummy output byte [▶ 57] is activated via the UserPrmData [▶ 38] (byte 3, bit 5). By default it is not active.

4.4.3 Configuration of Complex Modules

After the DP modules for the activated functions of the Bus Coupler have been added to the Bus Coupler in the DP configuration tool, the next step is for the complex terminals (KL15xx, KL25xx, KL3xxx, KL4xxx, KL5xxx, KL6xxx, KL8xxx) to be added in the sequence in which they are plugged in, regardless of whether digital terminals are plugged in between the complex terminals, or of how many there may be:

Complex function module	Description	Associated CfgData (as hex code)
KL1501	KL1501	0xB4 (in GSD file)
		0xB5 (alternatively)
		0xF2 (alternatively)
KL2502	KL2502	0xB5 (in GSD file)
		0xB2, 0xB2 (alternatively)
		0xF2 (alternatively)
KL2521	KL2521	0xB2 (in GSD file)
		0xF1 (alternatively)
KL3351 compact	KL3351 - only the 16 bit input value is transmitted	0x51 (in GSD file)
		0x50, 0x50 (alternatively)
KL3351 complex	KL3351 - 24 bits of input/output are transmitted, so that access can be had to the terminal's registers in addition to transmission of the 16 bit input value	0xB5 (in GSD file)
		0xB2, 0xB2 (alternatively)
		0xF2 (alternatively)
KL3361	KL3361	0xFB (in GSD file)
KL3xx2 compact	All KL3xx2 - only the 16 bit input value of each channel is transmitted	0x51 (in GSD file)
		0x50, 0x50 (alternatively)
KL3xx2 complex	Old KL3xx2 - 24 bits of input/output are transmitted for each channel, so that access can be had to the terminal's registers in addition to transmission of the 16 bit input value	0xB5 (in GSD file)
		0xB2, 0xB2 (alternatively)
		0xF2 (alternatively)
KL3xx4 compact	All KL3xx4 - only the 16 bit input value of each channel is transmitted	0x53 (in GSD file)
		0x51, 0x51 (alternatively)
		0x50, 0x50, 0x50, 0x50 (alternatively)
KL3xx4 complex	Old KL3xx4 - 24 bits of input/output are transmitted for each channel, so that access can be had to the terminal's registers in addition to transmission of the 16 bit input value	0xBB (in GSD file)
		0xB5, 0xB5 (alternatively)
		0xB2, 0xB2, 0xB2, 0xB2 (alternatively)
		0xF5 (alternatively)
KL4xx2 compact	All KL4xx2 - only the 16 bit output value of each channel is transmitted	0x61 (in GSD file)
		0x60, 0x60 (alternatively)
KL4xx2 complex	Old KL4xx2 - 24 bits of input/output are transmitted for each channel, so that access can be had to the terminal's registers in addition to transmission of the 16 bit input value	0xB5 (in GSD file)
		0xB2, 0xB2 (alternatively)
		0xF2 (alternatively)
KL4xx4 compact	All KL4xx4 - only the 16 bit output value of each channel is transmitted	0x63 (in GSD file)
		0x61, 0x61 (alternatively)
		0x60, 0x60, 0x60, 0x60 (alternatively)
KL4xx4 complex	Old KL4xx4 - 24 bits of input/output are transmitted for each channel, so that access can be had to the terminal's registers in addition to transmission of the 16 bit input value	0xBB (in GSD file)
		0xB5, 0xB5 (alternatively)
		0xB2, 0xB2, 0xB2, 0xB2 (alternatively)
		0xF5 (alternatively)

Complex function module	Description	Associated CfgData (as hex code)
KL5001 compact	KL5001 - only the 32 bit input value is transmitted	0x93 (in GSD file)
		0xD1 (alternatively)
KL5001 complex	KL5001 - 40 bits of input/output are transmitted, so that access can be had to the terminal's registers in addition to transmission of the 40 bit input value	0xB4 (in GSD file)
		0xB5 (alternatively)
		0xF2 (alternatively)
KL5051	KL5051	0xB5 (in GSD file)
		0xF2 (alternatively)
KL5101	KL5101	0xB5 (in GSD file)
		0xF2 (alternatively)
KL5111	KL5111	0xB5 (in GSD file)
		0xF2 (alternatively)
KL5121	KL5121	0xB5 (in GSD file)
		0xF2 (alternatively)
KL5151	KL5151	0xB5 (in GSD file)
		0xF2 (alternatively)
KL5302	KL5302	0xB5 (in GSD file)
		0xF2 (alternatively)
KL6001	KL6001	0xB5 (in GSD file)
		0xF2 (alternatively)
KL6011	KL6011	0xB5 (in GSD file)
		0xF2 (alternatively)
KL6021	KL6021	0xB5 (in GSD file)
		0xF2 (alternatively)
KL6051 compact	KL6051 - only the 32 input bits and 32 output bits are transmitted	0xB3 (in GSD file)
		0xF1 (alternatively)
KL6051 complex	KL6051 - 48 input bits and 48 output bits are transmitted, so that in addition to the 40 input bits and the 40 output bits, access can also be had to the terminal's registers	0xB5 (in GSD file)
		0xF2 (alternatively)
KL6061	KL6061	0xBA (in GSD file)
		0xF5 (alternatively)
KL6201 (PAB 6)	KL6201 - 6 bytes input and output process data is transferred (ASI slaves 1-11)	0x35 (in GSD file)
KL6201 (PRM PAB 6)	KL6201 - 6 bytes parameter interface and 6 bytes input and output process data is transferred (ASI slaves 1-11)	0xF2,0x35 (in GSD file)
KL6201 (PAB 16)	KL6201 - 16 bytes input and output process data is transferred (ASI slaves 1-31)	0x3F (in GSD file)
KL6201 (PRM PAB 16)	KL6201 - 6 bytes parameter interface and 16 bytes input and output process data is transferred (ASI slaves 1-31)	0xF2,0x3F (in GSD file)
KL6801	KL6801	0xB5 (in GSD file)
		0xF2 (alternatively)
KL8001	KL8001	0xBB (in GSD file)
		0xF5 (alternatively)

4.4.4 Configuration of Digital Modules

After the DP modules for the activated functions of the Bus Coupler and the complex terminals (KL15xx, KL25xx, KL3xxx, KL4xxx, KL5xxx, KL6xxx, KL8xxx) have been added to the Bus Coupler in the DP configuration tool in the sequence in which they are plugged in, the digital terminals follow. In the case of digital terminals, it is only necessary for the total of the digital inputs and outputs of the modules that have been added to agree with the number of digital inputs and outputs that are plugged in:

Sample

4 x KL1408 = 32 digital input bits

2 x KL2408 = 16 digital output bits

3 x KL1114 = 12 digital input bits

2 x KL2114 = 8 digital output bits

4 x KL1012 = 8 digital input bits

1 x KL2012 = 2 digital output bits

=> 52 digital input bits and 26 digital output bits

The following combinations of DP modules could, for instance, now be added in the DP configuration tool to the Bus Coupler:

Alternative 1

8 digital input bits

8 digital input bits

8 digital input bits

8 digital input bits

8 digital input bits

8 digital input bits

8 digital input bits

8 digital output bits

8 digital output bits

8 digital output bits

8 digital output bits

Alternative 2

56 digital input bits

32 digital output bits

Other alternatives are possible, provided the total of digital inputs is 56 bits (the next number larger than 52 divisible by 8) and that the sum of the digital outputs is 32 bits (the next number larger than 26 divisible by 8).

4.4.5 GSD Files

GSD files are required for integrating the PROFIBUS couplers in DP configuration tools.

GSD files can be found in the chapter [Downloads for PROFIBUS \[▶ 45\]](#)

Note regarding GSD file

i The GSD file contains a maximum of 244 bytes of input, output and configuration data. These are the maximum values. Below are the default of values and the setting options.

DP buffer	Default	Maximum size
Inputs	128	244
Outputs	128	244
Diagnostic Data	64	64
Configuration data	64	244

The sizes can be adjusted through the [PrmData \[▶ 77\]](#). The length is changed in 8-byte steps.

Sample

If it is desired to increase the size of the input data, other sizes must be reduced to compensate.

If we have 20 x 4 channel KL3314 thermocouples, then in compact mapping we find 20 Bus Terminals * 4 channels * 2 bytes per channel = 20 * 4 * 2 = 160 bytes

160 bytes is larger than the 128 byte default figure - settings must therefore be modified.

Set PrmData byte 12 bits 4-7 to 15_{dec} or 0xF_{hex}, set byte for 37 to 160 (input data) and byte 38 to 96 (output data).

4.4.6 Downloads for PROFIBUS

Images

Bus Coupler/ Bus Terminal Controller	Usage	Date	Download
All	Image 1 for fieldbus configuration software	1995-12-07	Busklemn.bmp
All	Image 2 for fieldbus configuration software	1997-11-11	Busklems.bmp

Standard

Bus Coupler/ Bus Terminal Controller	Usage	Language	Date	Download
BK3000	Common for all PROFIBUS master	german	2009-05-15	BK30becf.GSG
BK3000	Common for all PROFIBUS master	english	2009-05-15	BK30becf.GSE
BK3010	Common for all PROFIBUS master	german	2009-05-15	BK3010.GSG
BK3010	Common for all PROFIBUS master	english	2009-05-15	BK3010.GSE
BK3100	Common for all PROFIBUS master	german	2009-05-15	BK31bece.GSG
BK3100	Common for all PROFIBUS master	english	2009-05-15	BK31bece.GSE
BK3110	Common for all PROFIBUS master	german	2009-05-15	B311BECE.GSG
BK3110	Common for all PROFIBUS master	english	2009-05-15	B311BECE.GSE
BK3100	Special version for pure PROFIBUS DP operation	english	2009-05-15	BK3100_DP.GSE
BK3120	Common for all PROFIBUS master	german	2009-05-15	B312bece.GSG
BK3120	Common for all PROFIBUS master	english	2009-05-15	B312bece.GSE
BK3150	Common for all PROFIBUS master	german	2009-05-15	B315bece.GSG
BK3150	Common for all PROFIBUS master	english	2009-05-15	B315bece.GSE
BK3500	Common for all PROFIBUS master	german	2009-05-15	BK3500.GSG
BK3500	Common for all PROFIBUS master	english	2009-05-15	BK3500.GSE
BK3520	Common for all PROFIBUS master	german	2009-05-15	B352bece.GSG
BK3520	Common for all PROFIBUS master	english	2009-05-15	B352bece.GSE
LC3100	Common for all PROFIBUS master	german	2009-05-15	LC3100.GSG
LC3100	Common for all PROFIBUS master	english	2009-05-15	LC3100.GSE
BC3100	Common for all PROFIBUS master	german	2009-05-15	BC3100.GSG
BC3100	Common for all PROFIBUS master	english	2009-05-15	BC3100.GSE
BC3150	Common for all PROFIBUS master	german	2008-10-17	BC3150.GSG
BC3150	Common for all PROFIBUS master	english	2008-10-17	BC3150.GSE
BX3100	Common for all PROFIBUS master	german	2008-10-17	BX3100.GSG
BX3100	Common for all PROFIBUS master	english	2008-10-17	BX3100.GSE

Slot-oriented mapping

Bus Coupler/ Bus Terminal Controller	Usage	Language	Date	Download
BK3120	Common for all PROFIBUS master from firmware C0 *	german	2016-08-09	E312BECE.GSG
BK3120	Common for all PROFIBUS master from firmware C0 *	english	2016-08-09	E312BECE.GSE
BK3150	Common for all PROFIBUS master from firmware B8 *	german	2016-08-09	E315BECE.GSG
BK3150	Common for all PROFIBUS master from firmware B8 *	english	2016-08-09	E315BECE.GSE
EK3100	Common for all PROFIBUS master from firmware 01(V00.07)	english/ german	2017-05-24	EK3100DAA.ZIP
EK3100	Common for all PROFIBUS master from firmware 02(V00.11)	english/ german	2019-09-20	EK3100DAA02.zip
EK3100, EK9xxx	Driver for USB interface for Web Diagnostics	-	2015-10-02	EK9XXX_RNDIS6.ZIP
EK3100, EK9xxx	Driver for USB interface for Web Diagnostics, Windows 10	-	2018-02-15	EK9XXX_RNDIS6_WIN10.ZIP

i *) Firmware update

You can obtain the current firmware at support@beckhoff.com. To load the firmware onto the Bus Coupler / Bus Terminal Controller you need the [KS2000](#) configuration software and the appropriate cable.

4.4.7 KS2000 - Introduction

The *KS2000* configuration software permits configuration, commissioning and parameterization of bus couplers, of the affiliated bus terminals and of Fieldbus Box Modules. The connection between bus coupler / Fieldbus Box Module and the PC is established by means of the serial configuration cable or the fieldbus.



Fig. 24: KS2000 configuration software

Configuration

You can configure the Fieldbus stations with the Configuration Software KS2000 offline. That means, setting up a terminal station with all settings on the couplers and terminals resp. the Fieldbus Box Modules can be prepared before the commissioning phase. Later on, this configuration can be transferred to the terminal station in the commissioning phase by means of a download. For documentation purposes, you are provided with the breakdown of the terminal station, a parts list of modules used and a list of the parameters you have modified. After an upload, existing fieldbus stations are at your disposal for further editing.

Parameterization

KS2000 offers simple access to the parameters of a fieldbus station: specific high-level dialogs are available for all bus couplers, all intelligent bus terminals and Fieldbus Box modules with the aid of which settings can be modified easily. Alternatively, you have full access to all internal registers of the bus couplers and intelligent terminals. Refer to the register description for the meanings of the registers.

Commissioning

The KS2000 software facilitates commissioning of machine components or their fieldbus stations: Configured settings can be transferred to the fieldbus modules by means of a download. After a *login* to the terminal station, it is possible to define settings in couplers, terminals and Fieldbus Box modules directly *online*. The same high-level dialogs and register access are available for this purpose as in the configuration phase.

The KS2000 offers access to the process images of the bus couplers and Fieldbus Box modules.

- Thus, the coupler's input and output images can be observed by monitoring.
- Process values can be specified in the output image for commissioning of the output modules.

All possibilities in the *online mode* can be used in parallel with the actual fieldbus mode of the terminal station. The fieldbus protocol always has the higher priority in this case.

4.4.8 Configuration via TwinCAT

The TwinCAT automation software is a complete automation solution for PC-compatible computers. TwinCAT turns any compatible PC into a real-time controller, an IEC 61131-3 Multi-PLC, NC positioning system, the corresponding programming environment and user interface. TwinCAT supports several different PROFIBUS DP PC cards. Beckhoff recommends the PROFIBUS DP PCI master card FC3101, which can also be obtained as a two-channel version (FC3102).

TwinCAT*System-Manager

The TwinCAT System Manager Tool is used to configure the FC310x PROFIBUS DP PCI card. The System Manager provides a representation of the number of programs of the TwinCat PLC systems, the configuration of the axis control and of the connected I/O channels as a structure, and organizes the mapping of the data traffic.



Fig. 25: TwinCAT System Manager

For applications without TwinCAT PLC or NC, the TwinCAT System Manager configures the programming interfaces for a wide range of application programs:

- ActiveX control (ADS-OCX) for e.g. Visual Basic, Visual C++, Delphi, etc.
- DLL interface (ADS-DLL) for e.g. Visual C++ projects
- Script interface (ADS script DLL) for e.g. VBScript, JScript, etc.

The TwinCAT System Manager has the following properties:

- Bit-wise connection between server process images and I/O channels
- Standard data formats such as arrays and structures
- User defined data formats
- Continuous variable linking
- Drag and Drop
- Import and export at all levels

Procedure when configuring the PROFIBUS DP input/output modules

1. The corresponding PROFIBUS DP master PC card is selected first, and inserted into the I/O configuration.

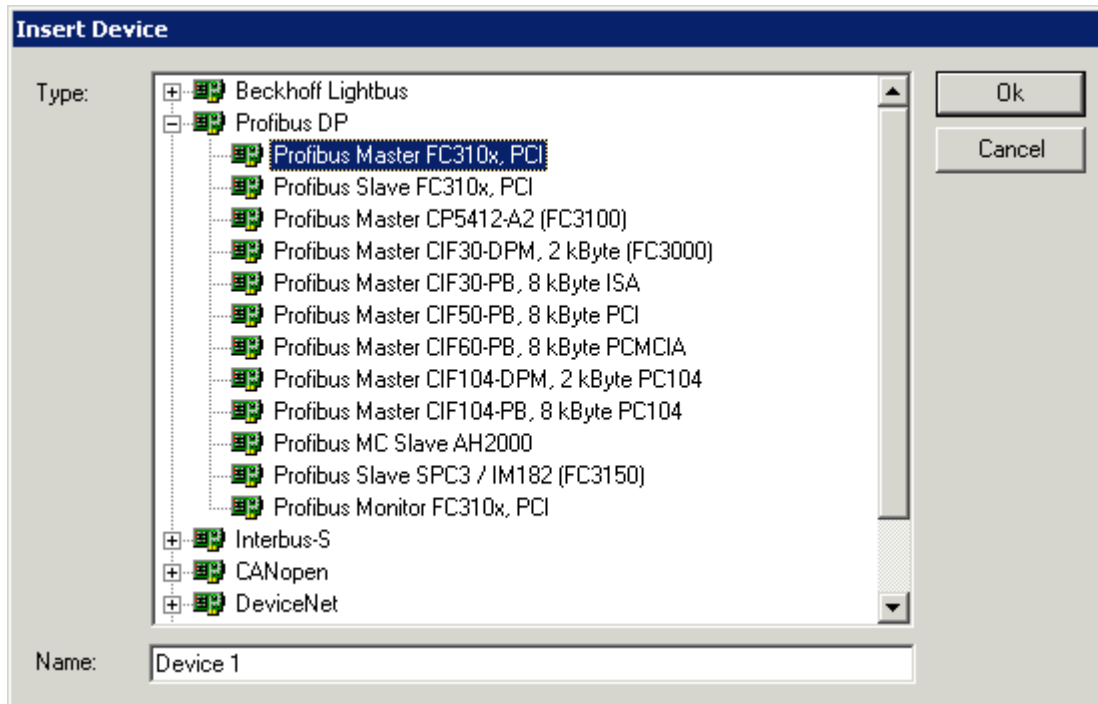


Fig. 26: Configuration of the PROFIBUS DP I/O modules - selection of the PROFIBUS DP master PC card

2. Following the master card, the bus nodes are then inserted:

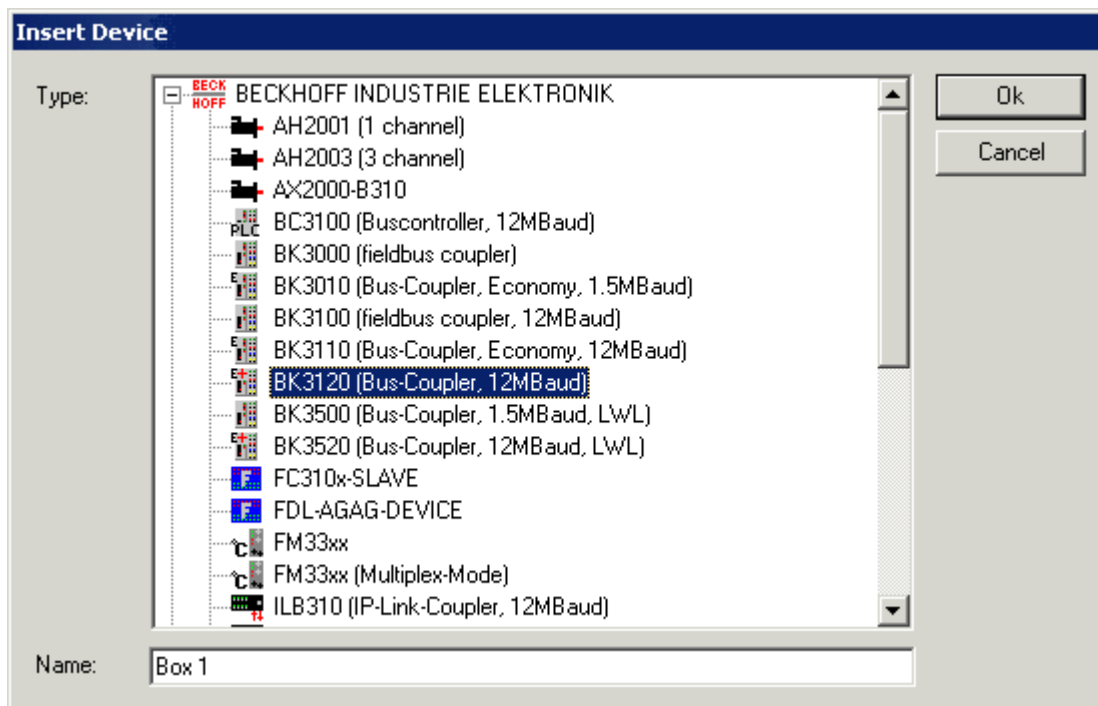


Fig. 27: Configuration of the PROFIBUS DP I/O modules - inserting the bus nodes

3. The appropriate Bus Terminals are now inserted at the PROFIBUS DP Bus Coupler.

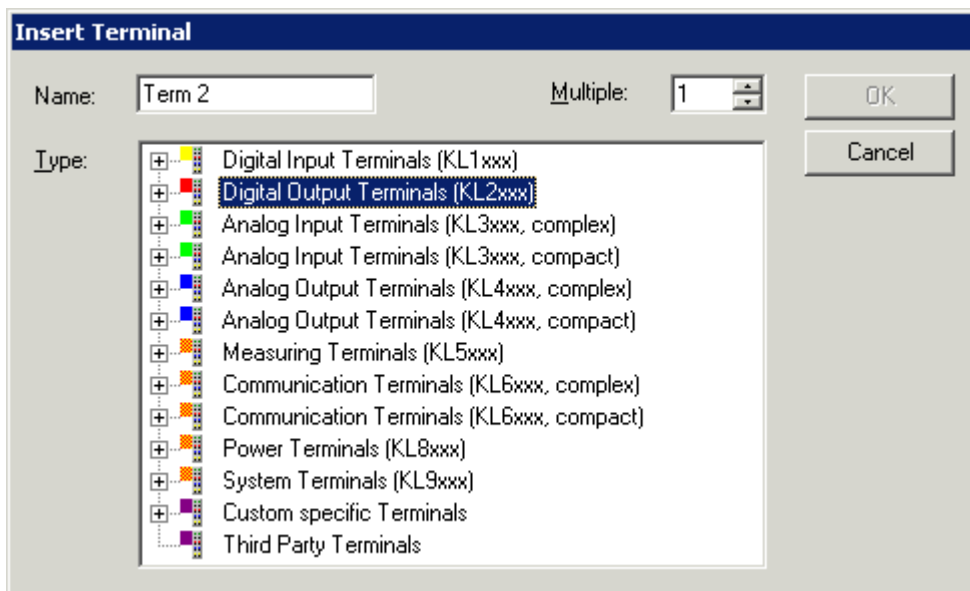


Fig. 28: Configuration of the PROFIBUS DP I/O modules - appending the Bus Terminals

4.4.9 Configuration with Siemens S7 controller

4.4.9.1 Configuration: Siemens S7 Controller

Inserting the images

In order to assign an image to the devices in the Siemens software, they must be copied into the *Step7 \ S7Data \ NcBmp* directory.




Fig. 29: Busklemn.bmp




Fig. 30: Busklems.bmp

Inserting the GSD files

- Go to *Extras \ Install new GSD* in the hardware catalog for your Step7.
- Select the directory in which the Beckhoff GSD is located, and import the files.
- It can then be found in the hardware catalog under *PROFIBUS DP \ Further field devices \ I/O*.

4.4.9.2 Configuration: Siemens S7 Controller BK3120

Parameter data for the BK3120

Settings

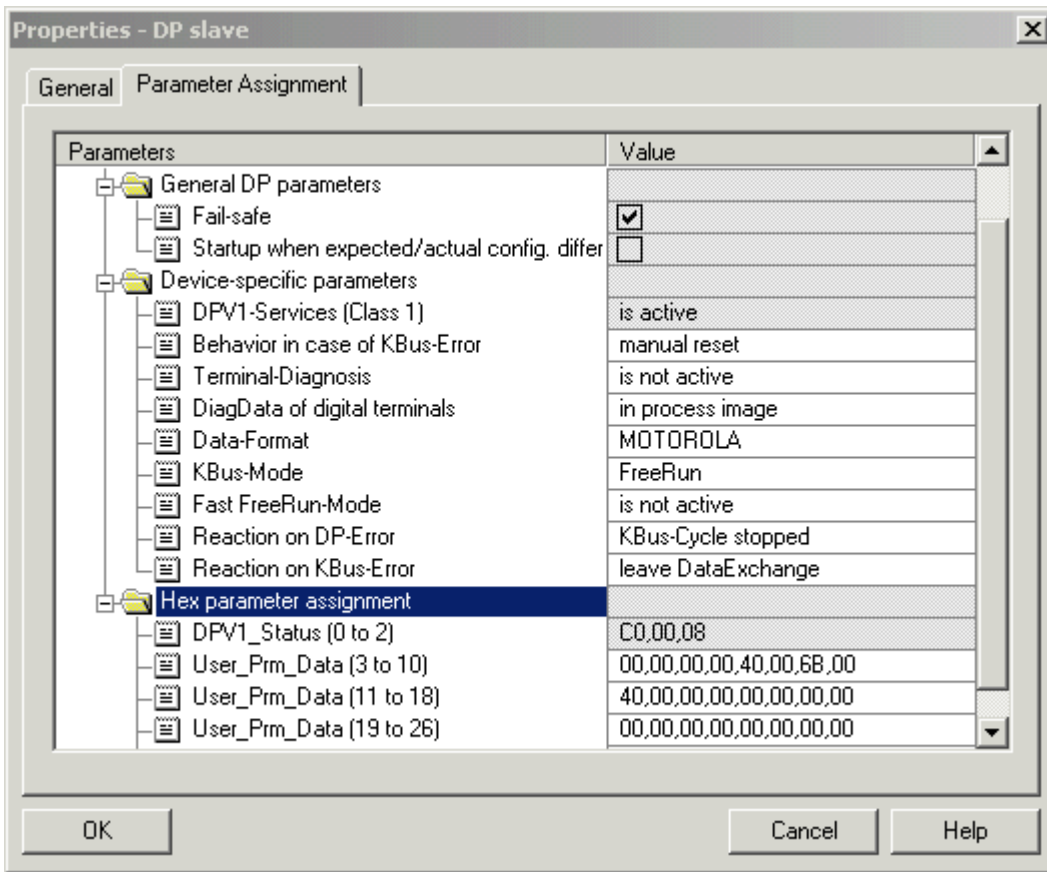


Fig. 31: Parameter data for the BK3120

Parameter data	Name
DPV1 service (class 1)	DPV1 Services [► 60]
Reaction to Bus Terminal error	Reaction to Bus Terminal error [► 73]
Terminal bus diagnostics	PROFIBUS diagnosis [► 74]
Digital terminal diagnostic data	Digital Bus Terminal diagnostics [► 74]
Data format	Data format [► 38]
K-Bus mode	K-bus update [► 57]
Fast FreeRun mode	Fast FreeRun mode [► 57]
Reaction to DP errors	Reaction to fieldbus error [► 38]
Reaction to K-bus errors	Reaction to K-bus errors [► 38]

Configuration of the BK3120 module with digital inputs/outputs only

Sample 1:

1 x BK3120

10 x KL1xx4

1 x KL9100 (is not entered, as this Bus Terminal is entirely passive)

11 x KL2xx4

1 x KL9010 (is not entered, as this Bus Terminal is entirely passive)

The sum total of digital bytes must be added together and entered.

Digital inputs

10 x KL1xx4, i.e. 10 x 4 bits = 40 bits

40 bit / 8 = 5 bytes, i.e. enter 5 x 8 bit or 1 x 40 bit or 1 x 8 bit + 1 x 32 bit, etc. (see Fig. *Example for entering individual bytes* and Fig. *Example for entering contiguous bytes*)

Digital outputs

11 x KL2xx4, i.e. 10 x 4 bit = 44 bit

44 bit / 8 = 5.5 bytes, rounded up to 6 bytes, i.e. enter 6 x 8 bit or 1 x 48 bit or 1 x 8 bit + 1 x 40 bit etc. (see Fig. Example for entering individual bytes and Fig. Example for entering contiguous bytes)

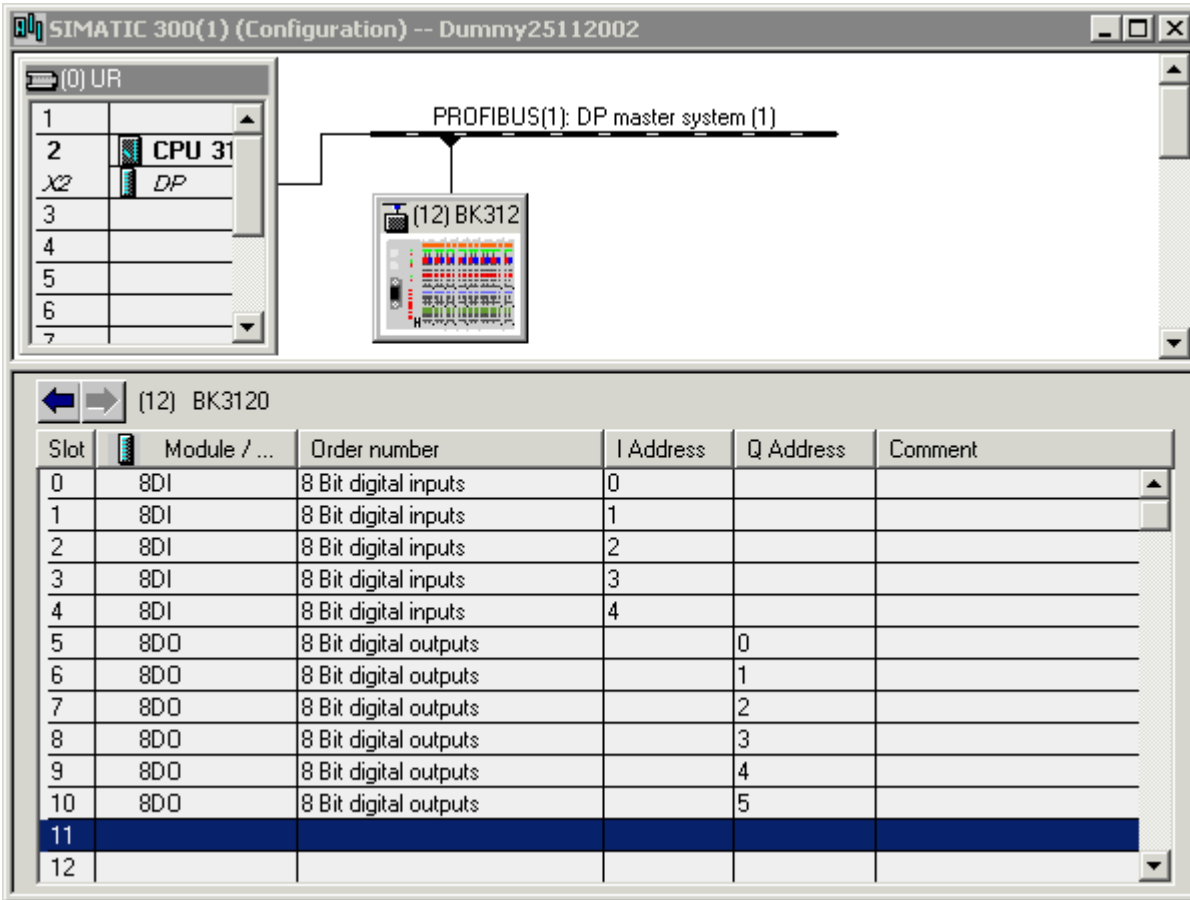


Fig. 32: Example for entering individual bytes.

Maximum config data



Each individual byte requires one byte of ConfigData. In the BK3120 a maximum of 64 bytes of configuration data is available.

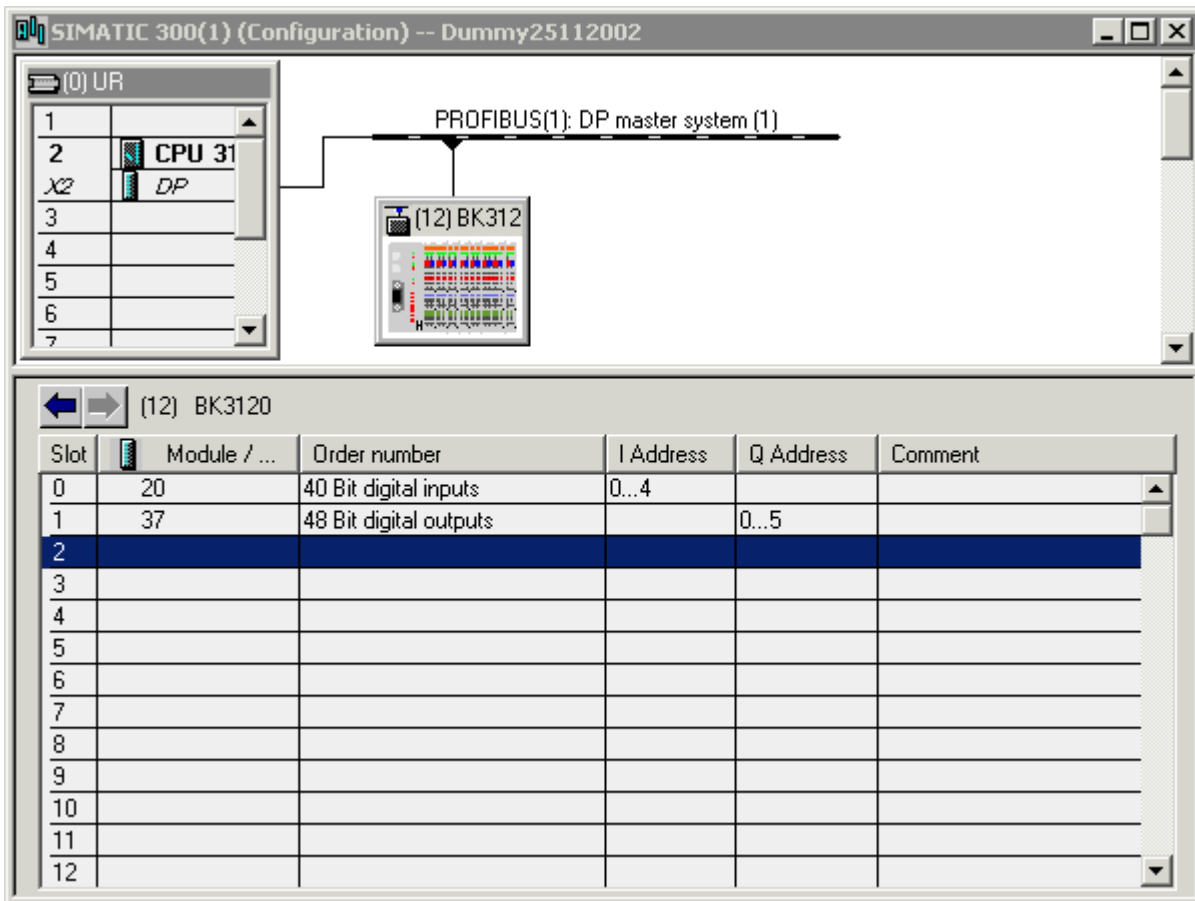


Fig. 33: Example for entering associated bytes.

Configuration of the BK3120 module with complex and digital input/outputs

Byte-oriented modules are the first to be mapped into the process image, and for this reason all the complex modules must first be entered in the sequence in which they are plugged into the Bus Coupler. For some byte-oriented Bus Terminals, it is possible to distinguish between compact and complex mapping.

Compact - only user data

Complex - user data plus status (for extended diagnosis) and control (for register communication)

Finally the digital signals are entered and rounded up to a whole byte.

Example 2.a:

1 x BK3120

2 x KL1012

1 x KL2022

1 x KL3312 compact mapping

1 x KL9010

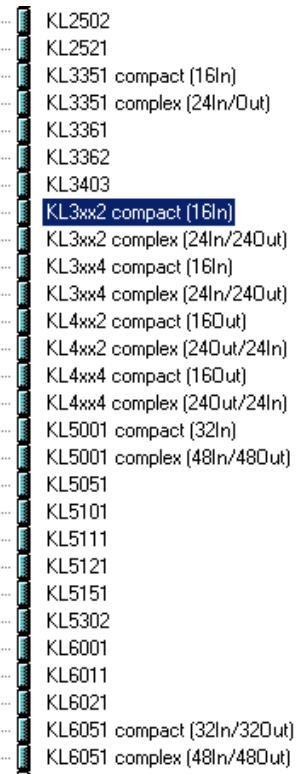
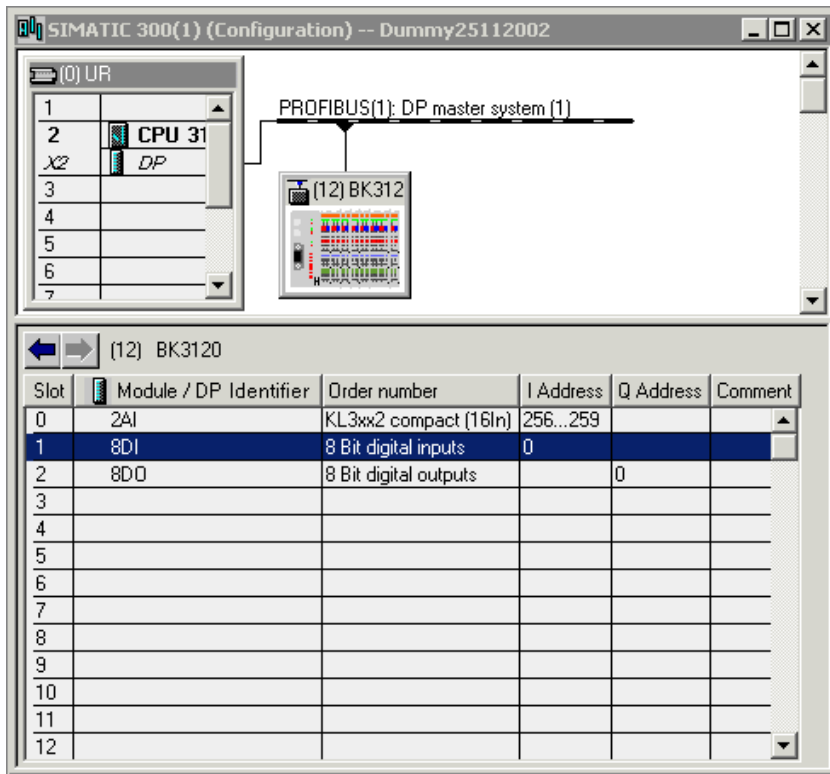


Fig. 34: Example for compact representation of the Bus Terminal KL3312

Example 2.b:

- 1 x BK3120
- 2 x KL1012
- 1 x KL2022
- 1 x KL3312 complex mapping
- 1 x KL9010

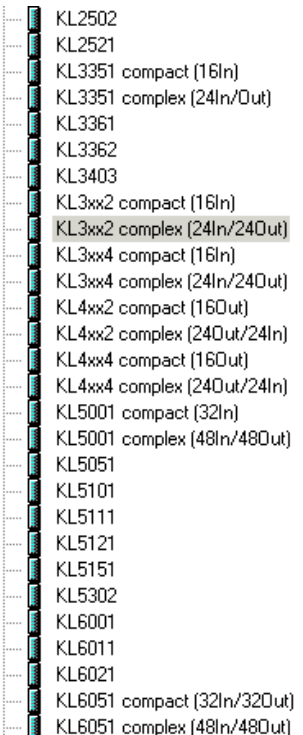
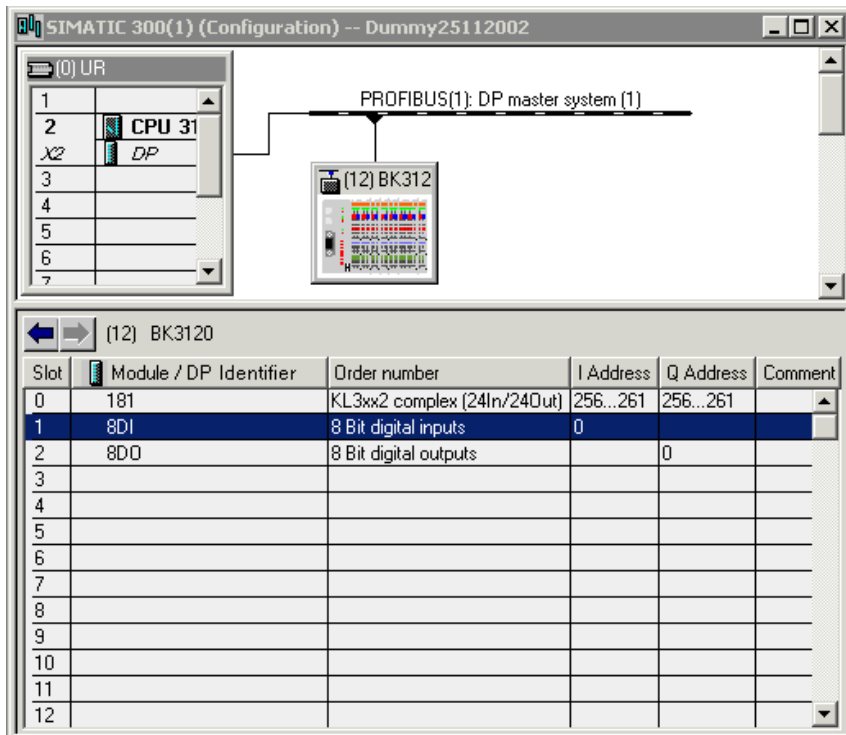


Fig. 35: Example for compact representation of the Bus Terminal KL3312

5 PROFIBUS DP communication

5.1 DataExchange - cyclic data exchange

5.1.1 Process data, process image

The Bus Coupler includes different memory areas, each having a capacity of 256 words. Telegrams passing over the Lightbus can specifically access any desired memory cell. The control and status bytes in the Lightbus telegrams can be used to distinguish between two relevant regions of the memory and to address them separately. In order to initiate a Bus Coupler update, the value in the control and status bytes must be 0x10, while the data byte must contain the constant 80hex. It is possible to access the Bus Coupler data after this. For this purpose the control and status byte contains the value 0x30. Two bytes can be written and two bytes can be read simultaneously with one access. The process is described in detail in the following sections.

After being switched on, the Bus Coupler determines the configuration of the inserted input/output terminals. The assignment of the physical slots for the input/output channels and the addresses in the process image is carried out automatically by the Bus Coupler.

The Bus Coupler creates an internal assignment list, in which the input/output channels have a specific position in the process image of the Bus Coupler. A distinction is made here according to inputs and outputs, and according to bit-oriented (digital) and byte-oriented (analog or complex) signal processing.

Two groups are created, one for inputs and the other for outputs. Each group has the byte-oriented channels in ascending sequence, starting from the lowest address, and these are followed by the bit-oriented channels.

Digital signals (bit-oriented)

The digital signals are bit-oriented. This means that one bit in the process image is assigned to each channel. The Bus Coupler creates a memory area containing the current input bits, and ensures that the bits in a second (output) memory area dedicated to the output channels are written out immediately, following the update command.

The details of the assignment of the input and output channels to the controller's process image is explained fully with the aid of an example in the appendix.

Analog signals (byte-oriented)

The processing of analog signals is always byte-oriented. Analog input and output values are represented in memory by two bytes each. Values are represented in SIGNED INTEGER format. The number 0 stands for the input/output value 0 V, 0 mA or 4 mA. The maximum value of an output or input value is represented, according to the standard settings, by 0x7FFF. The intermediate values are correspondingly proportional. A range with a resolution of 15 bits is not achieved for all inputs and outputs. If the actual resolution is 12 bits, the last three bits have no effect in outputs, while as inputs they are read as 0. Each channel also has a control and status byte. The control and status byte is the most significant byte in the most significant word. An analog channel is represented by 4 bytes in the process image, of which 3 bytes are used. In the BK3000 and BK4000 only 2 bytes are occupied in the process image of the corresponding bus system for each analog channel. The Bus Terminal's control and status bytes can also be included through appropriate configuration of the Bus Coupler and Bus Terminals.

Special signals and interfaces

The Bus Coupler supports Bus Terminals with other interfaces such as RS232, RS485, incremental encoder and others. These signals can be considered similarly to the analog signals named above. For some special signals the bit width of 16 is not sufficient. The Bus Coupler can support any byte width. It is necessary to consider how data consistency is ensured when accessing these values. This means that update commands must not be issued nor must the Bus Coupler be placed into the *free running* mode between the accesses.

Default assignment of the inputs and outputs to the process image

Once it has been switched on, the Bus Coupler finds out how many Bus Terminals are inserted, and creates an assignment list. The analog and digital channels, divided into inputs and outputs, are assembled into separate parts of this list. The assignment starts on the left next to the Bus Coupler. The software in the Bus Coupler collects consecutively the individual entries for each of the channels in order to create the assignment list counting from left to right. Four groups are distinguished in the assignment:

Group	Functional type of the channel	Assignment
1	analog outputs	byte-wise
2	digital outputs	bit-wise
3	analog inputs	byte-wise
4	digital inputs	bit-wise

All complex Bus Terminals are represented by analog inputs or outputs.

Overview of the distribution of the process image within the Bus Coupler

Output data in the Bus Coupler

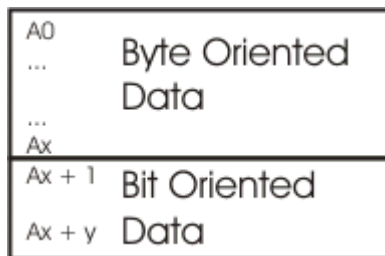


Fig. 36: Output data in the Bus Coupler

Input data in the Bus Coupler

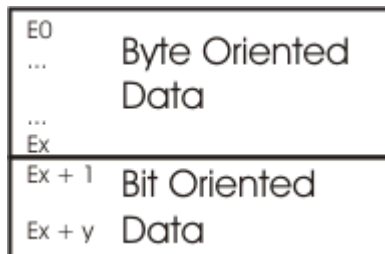


Fig. 37: Input data in the Bus Coupler

5.1.2 K-bus Cycle

The K-bus cycle can be set to run freely (*FreeRun mode* [▶ 57]) or synchronously (*synchronous mode* [▶ 58]) with respect to the DP cycle. The K-bus cycle for the DP coupler consists of the following parts:

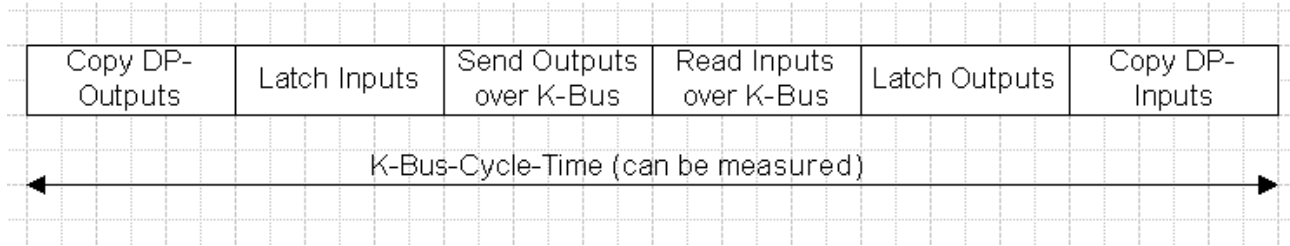


Fig. 38: Configuration of the K-bus cycle for the DP couplers

The K-bus cycle time can be calculated with a precision of around 10 % using the following formula (4-channel terminals or terminals with more than 6 bytes data (exception: ASI terminal KL6201: more than 12 bytes of data) require two or more K-bus cycles).

$$T_{cyc} \text{ (in } \mu\text{s)} = \text{number of K-Bus cycles} \times (600 + \text{number of digital channels} \times 2.5 + \text{number of analog input channels} \times 32 + \text{number of analog output channels} \times 42)$$

The K-bus cycle time can be read via *DPV1* [▶ 64]. If TwinCAT is used, this is possible on the "Beckhoff" tab of the DP coupler in the System Manager.

K-bus modes

The K-bus mode (the type of synchronisation between the K-bus cycles and the DP cycle) is set via the *UserPrmData* [▶ 38]:

Byte 9, bit 4	Byte 9, bit 6	Byte 12, bit 0	Byte 12, bit 1	K-bus mode
0 _{bin}	1 _{bin}	0 _{bin}	0 _{bin}	Slow FreeRun
1 _{bin}	1 _{bin}	0 _{bin}	0 _{bin}	Fast FreeRun
0 _{bin}	0 _{bin}	0 _{bin}	0 _{bin}	Synchronous
0 _{bin}	0 _{bin}	1 _{bin}	0 _{bin}	Synchronous with optimized input update, one cycle
0 _{bin}	0 _{bin}	0 _{bin}	1 _{bin}	Synchronous with optimized input update, two cycles

FreeRun mode

Slow FreeRun (default setting)

In the *FreeRun* mode there is no synchronisation between the K-bus cycle and the DP cycle. It is a characteristic feature of the *Slow FreeRun* mode that the K-bus cycle is called from the main task. Acyclic communication or events result in heavy jitter in the K-bus cycle (*KS2000*, *DPV1*, terminal diagnosis, etc.), because all of these functions are also called from the main task.

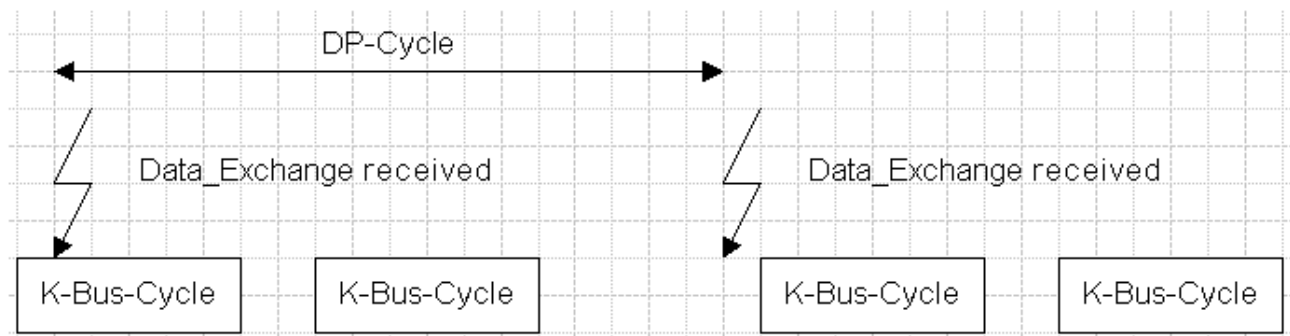


Fig. 39: K-bus - Slow FreeRun mode (default setting)

Fast FreeRun

To avoid the jitter resulting from acyclic communication or events and to achieve fast K-bus update times, the *Fast FreeRun* mode can be activated. The K-bus cycle is called by a higher priority task, controlled by a timer. At the end of the K-bus cycle the low-priority tasks (DPV1, KS2000 interface, etc.) are assigned computing time corresponding to 12.5 % of the preceding K-bus cycle duration, before the next K-bus cycle is started. In fast FreeRun mode therefore the inputs and outputs are up-to-date, but are not synchronized to the DP cycle:

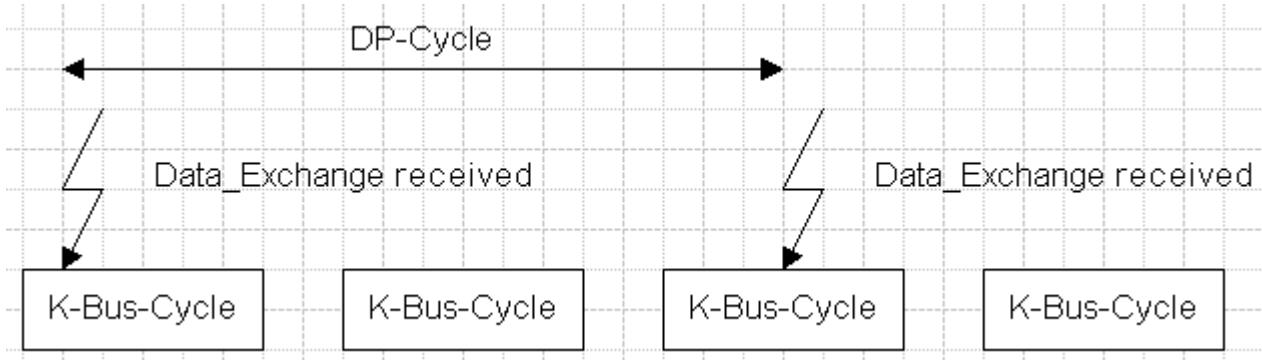


Fig. 40: K-bus mode fast FreeRun

Synchronous mode

As explained in the table above, there are three different synchronous modes.

Standard synchronous mode

In standard synchronous mode the K-bus cycle is always started immediately following reception of the *Data_Exchange* telegram from the DP master. The outputs are therefore generated as quickly as possible, while the input cycles are always one DP cycle old.

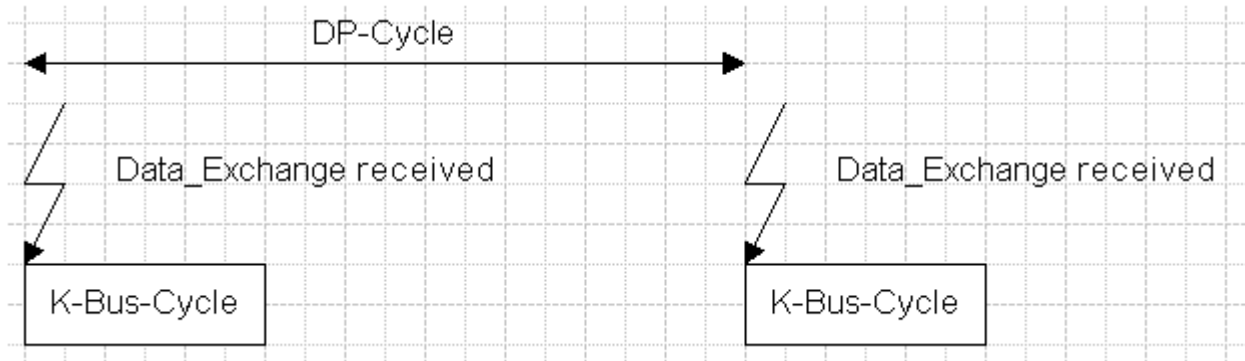


Fig. 41: K-bus - standard synchronous mode

It is important here to ensure that the duration of the K-bus cycle plus approx. 20 % (to allow for the lower priority processes on the coupler) is shorter than the DP cycle time (which, under TwinCAT, means the cycle time of the associated task).

Synchronous mode with optimized input update (one cycle)

In optimized input update, the start of the K-bus cycle can be delayed following reception of the *Data_Exchange* telegram, so that the inputs are more up-to-date than they are in standard synchronous mode, whereas generation of the outputs is more severely delayed. It is important here to ensure that the duration of the K-bus cycle, plus the delay time, plus approx. 20 % (to allow for the lower priority processes on the coupler) is shorter than the DP cycle time (which, under TwinCAT, means the cycle time of the associated task).

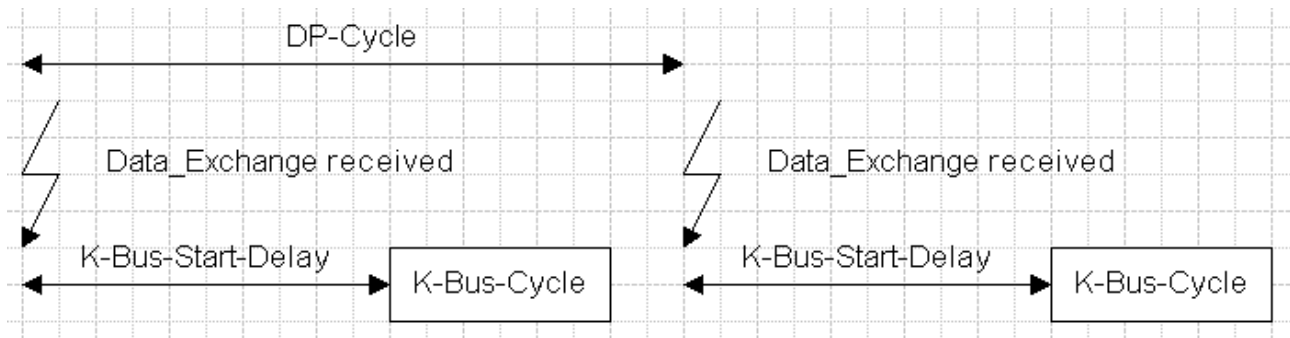


Fig. 42: K-bus - synchronous mode with optimized input update (one cycle)

The delay time is set by means of the UserPrmData [▶ 38] (in μs , in Motorola format). The extended GSD file of the Bus Coupler is, however, necessary for this:

Byte	Value: Description
13	Delay time (in μs) high byte
14	Delay time (in μs) low byte

Synchronous mode with optimized input update (two cycles)

In the third mode of synchronous operation, the advantages of the other two operating modes are combined. Two K-bus cycles are carried out within one DP cycle. The first cycle begins immediately after reception of the Data_Exchange telegram from the master, which means that the outputs are generated as quickly as possible. The second cycle is started after a delay time that begins after completion of the first cycle has elapsed, so that the inputs are as recent as possible. It is important here to ensure that two times the duration of the K-bus cycle, plus the delay time, plus approx. 20 % (to allow for the lower priority processes on the coupler) is shorter than the DP cycle time (which, under TwinCAT, means the cycle time of the associated task).

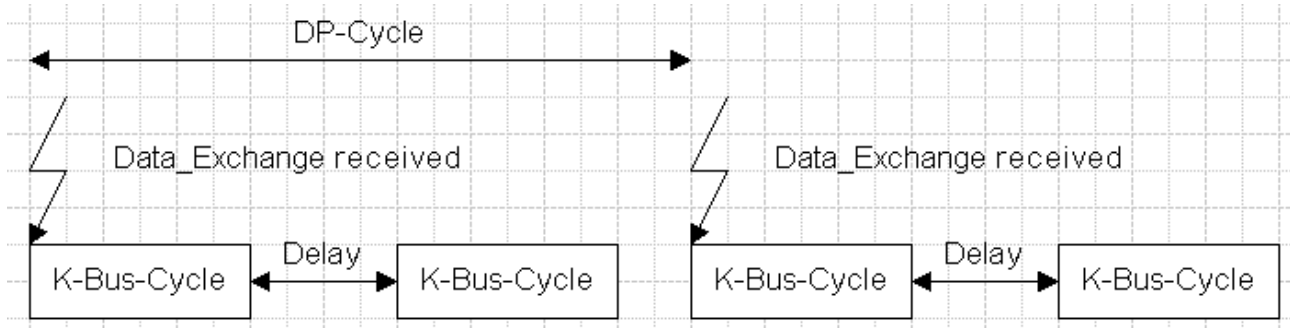


Fig. 43: K-bus - synchronous mode with optimized input update (two cycles)

The delay time is set by means of the UserPrmData [▶ 38] (in μs , in Motorola format). The extended GSD file of the Bus Coupler is, however, necessary for this:

Byte	Description
13	Delay time (in μs) high byte
14	Delay time (in μs) low byte

Dummy output byte

The Bus Coupler's PROFIBUS DP ASIC can only generate an interrupt after reception of a Data_Exchange telegram if output data has been received. This means that at least one output byte must be transferred via DP in synchronous mode. If only input terminals are plugged in, and no output data is therefore present, a dummy output byte can be configured. It is activated in the UserPrmData [▶ 38], and must be entered as the module in the CfgData. The extended GSD file for the Bus Coupler is, however, necessary for this:

Byte	Bit	Value	Description
3	5	1 _{bin}	Dummy output byte activated

It is also necessary for the dummy output byte to be configured in the CfgData before the complex terminals:

CfgData	DP modules
0x20	Dummy output byte

K-bus cycle counter

In order for the master to be able to check reliably whether precisely one (or two) K-bus cycles are always being carried out during one DP cycle, a K-bus cycle counter can be transferred in the input data from the Bus Coupler to the master. This is incremented after each K-bus cycle (0 is omitted, so that 1 follows after 255). The K-bus cycle counter must be activated in the UserPrmData and entered as a module in the CfgData. The extended GSD file for the Bus Coupler is, however, necessary for this:

Byte	Bit	Value	Description
3	3	1 _{bin}	K-bus cycle counter activated

It is also necessary for the K-bus cycle counter byte to be configured in the CfgData before the complex terminals:

CfgData	DP modules
0x10	K-bus cycle counter

5.2 DPV1 - acyclic data transfer

5.2.1 DPV1 Interface

By default, one MSAC_C1 connection and one MSAC_C2 connection with 52 bytes of data (4 bytes DPV1 header plus 48 bytes of user data) are supported. The MSAC_C1 connection is established along with cyclic connection, and can be activated via the [UserPrmData](#) [► 38]:

Byte	Bit	Value: Description
0	7	1: MSAC_C1 connection is activated

The MSAC_C2 connection can be used either by the C1 master (which communicates with the slave cyclically) or by a C2 master (which then only communicates with the slave acyclically), and has its own establishment of connection. The parameters at the establishment of the MSAC_C2 connection (Feature_Supported, Profile_Feature_Supported, Profile_Ident_Number, etc.) are not examined, and the parameters of the request are mirrored in the response.

[Slot Number](#) [► 61] = 0 addresses PROFIBUS coupler data, [Slot Number](#) [► 61] > 0 addresses the data of the function module(s).

PROFIBUS coupler data (Slot_Number = 0)

The data associated with the PROFIBUS coupler is addressed via an index:

Index	Access	Description
1-2	R/W	Module assignment in multi-configuration mode [► 77]
5	R	Firmware information [► 63]
9-19	R/W	Device configuration [► 63] (Table 9)
90	R	K-bus status [► 64] (Table 90)
98	R/W	Internal cycle time [► 64]
99	W	Commands: local bus reset [► 73], starting or stopping the internal cycle time measurement [► 64]

Function module data (Slot_Number > 0)

Depending on the type of function module, access is made either to the registers (max. 4 channels, each with 64 registers) or to the parameters (only supported by a few function modules, where the quantity of data is insufficient for the register model)

Accessing registers

Index	Access	Length	Description
0-63	R(/W)	2	Registers 0-63 of the channel 1 in the function module
64-127	R(/W)	2	Registers 0-63 of the channel 2 in the function module
128-191	R(/W)	2	Registers 0-63 of the channel 3 in the function module
192-254	R(/W)	2	Registers 0-63 of the channel 4 in the function module

Accessing parameters

Index	Access	Length	Description
0	R(/W)	4-32 (must be divisible by 4)	Parameters 0x0000-0x0007 of the function module
1	R(/W)	4-32 (must be divisible by 4)	Parameters 0x0008-0x000F of the function module
...	
127	R(/W)	4-32 (must be divisible by 4)	Parameters 0x03F8-0x03FF of the function module

5.2.2 Assignment of the DPV1 slot number

The Slot_Number = 0 addresses the data of the Bus Coupler, while Slot_Number > 0 addresses the data (registers or parameters (KL6201)) of the complex terminals:

Device	Slot number = 0	Slot number > 0
BK3120, BK3150, BK3500, BK3520	Data in Bus Coupler	Slot_Number = 1: first complex terminal plugged into the Bus Coupler (KL15xx, KL25xx, KL3xxx, KL4xxx, KL5xxx, KL6xxx, KL8xxx) Slot_Number = 2: second complex terminal plugged into the Bus Coupler (KL15xx, KL25xx, KL3xxx, KL4xxx, KL5xxx, KL6xxx, KL8xxx) etc.
BK3x10/LC3100	Data in Bus Coupler	Not present, because neither the BK3x10 nor the LC3100 support complex terminals.

5.2.3 DPV1 at the coupler

5.2.3.1 Module Assignment

The multi-configuration mode [► 77] is possible with a maximum of 128 modules (terminals, IE modules, etc.). The specification of which of the modules configured in the CfgData are indeed inserted can be written with DPV1 Write and read with DPV1 Read.

Slot number	Index	Length	Data	Description		
0	1	1-15	Byte 0 (bit 0,1)	Assignment of module 1 0: DP DataExchange (default) 2: disabled (configured module missing)		
			Byte 0 (bit 2,3)	Assignment of module 2 0: DP DataExchange (default) 2: disabled (configured module missing)		
			Byte 0 (bit 4,5)	Assignment of module 3 0: DP DataExchange (default) 2: disabled (configured module missing)		
			Byte 0 (bit 6,7)	Assignment of module 4 0: DP DataExchange (default) 2: disabled (configured module missing)		
			Byte 1 (bit 0,1)	Assignment of module 5 0: DP DataExchange (default) 2: disabled (configured module missing)		
			...			
			Byte 15 (bit 6,7)	Assignment of module 64 0: DP DataExchange (default) 2: disabled (configured module missing)		
			2	1-15	Byte 0 (bit 0,1)	Assignment of module 65 0: DP DataExchange (default) 2: disabled (configured module missing)
					Byte 0 (bit 2,3)	Assignment of module 66 0: DP DataExchange (default) 2: disabled (configured module missing)
					Byte 0 (bit 4,5)	Assignment of module 67 0: DP DataExchange (default) 2: disabled (configured module missing)
					Byte 0 (bit 6,7)	Assignment of module 68 0: DP DataExchange (default) 2: disabled (configured module missing)
					Byte 1 (bit 0,1)	Assignment of module 69 0: DP DataExchange (default) 2: disabled (configured module missing)
...						
Byte 15 (bit 6,7)	Assignment of module 128 0: DP DataExchange (default) 2: disabled (configured module missing)					

5.2.3.2 Firmware Information

The following firmware information can be read through DPV1. The data is transferred in Intel format (low byte first):

Slot number	Index	Byte	Description
0	5	0-1	Bus Coupler number
		2-3	Software version
		4-5	Manufacturer type (table 0, register 245)
		6-7	Coupler type (table 0, register 246)
		8-9	Bus Coupler type (table 0, register 247)
		10-11	reserved

5.2.3.3 Terminal Composition

The terminal composition can be read by DPV1. A word is transmitted for each terminal containing the terminal number for complex terminals (KL15xx, KL25xx, KL3xxx, KL4xxx, KL5xxx, KL6xxx, KL8xxx), and the length and type information for digital terminals:

Bit	Value	Description
0	1 _{bin}	Digital terminal has inputs
1	1 _{bin}	Digital terminal has outputs
2-7	-	reserved
8-14	X	Length in bits
15	1 _{bin}	Always 1 _{bin} (indicates that the terminal is digital)

Reading the terminal composition

The terminal composition is represented in the DPV1 addressing as follows:

Slot number	Index	Byte	Description
0	9	0-1	Number of the Bus Coupler
		2-3	Value for terminal 1
	
		46-47	Value for terminal 23
	10	0-1	Value for terminal 24
	
		46-47	Value for terminal 47
	11	0-1	Value for terminal 48

	18	46-47	Value for terminal 239
	19	0-1	Value for terminal 240
	
		30-31	Value for terminal 255

Checking the terminal composition

The same data can also be accessed by a DPV1 Write. In this case the Bus Coupler compares the value that has been written with the true value, returning a negative DPV1 Write response if the data does not agree. This permits more precise checking of the terminal configuration than is possible by checking the CfgData. The length must match the actual length of table 9. The calculation should include two bytes for each terminal with process data. The Bus Coupler ID in register 0 of table 9 is not taken into account.

Error codes in the write response

Error_Code_1	Error_Code_2
0xBE	Number of terminals
0xBF	First faulty byte in the written data

5.2.3.4 K-bus status

The K-bus status can be read through DPV1. The data is transferred in Intel format (low byte first):

Slot number	Index	Byte	Description
0	90	0-1	Bit 0: Fieldbus errors
			Bit 1: K-bus error
			Bit 2: Error on the Bus Terminal
			Bit 3: Coupler error
		2-3	In the presence of a coupler error: Error code
		4-5	K-bus error = 0: Bit length of the K-bus
			K-bus error = 1: K-bus error code (-> Diagnostic data [▶ 68])
		6-7	K-bus error = 0: Number of terminals
			K-bus error = 1: Bus Terminal number following which the K-bus error is detected (-> Diagnostic data [▶ 68])

5.2.3.5 Cycle Time Measuring

The duration of the [process data cycle \[▶ 57\]](#) can be measured with DPV1.

The cycle time measurement is started or stopped using DPV1 Write:

Slot number	Index	Length	Data	Description
0	99	4	Byte 0: 0x04	Start the cycle time measurement
			Byte 1: 0x01	
			Byte 2: 0x01	
			Byte 3: 0x00	
0	99	4	Byte 0: 0x04	Stop the cycle time measurement
			Byte 1: 0x01	
			Byte 2: 0x00	
			Byte 3: 0x00	

The minimum, maximum, mean (of the last 200 cycles) and current cycle time can be read with DPV1 Read and reset with DPV1 Write:

Slot number	Index	Length	Data	Description
0	98	8	Byte 0, 1	Minimum cycle time in μ s (INTEL format, low byte first)
			Byte 2, 3	Maximum cycle time in μ s (INTEL format, low byte first)
			Byte 4, 5	Mean cycle time in μ s (INTEL format, low byte first)
			Byte 6, 7	Current cycle time in μ s (INTEL format, low byte first)

6 Diagnostics and error handling

6.1 LEDs

The Bus Coupler has two groups of LEDs for the display of status. The upper group (BK3xx0) or left hand group (LC3100) indicates the state of the fieldbus.

On the upper right hand side of the BK3xx0 Bus Coupler are two more green LEDs that indicate the supply voltage. The left hand LED indicates the presence of the 24 V supply for the Bus Coupler. The right hand LED indicates the presence of the supply to the power contacts. The two K-Bus LEDs (I/O RUN, I/O ERR) are located under the fieldbus LEDs. These indicate the operational state of the Bus Terminals and the connection to these Bus Terminals.

Fieldbus LEDs

The upper three LEDs (or the two LEDs on the left) indicate the operating state of the PROFIBUS communication:

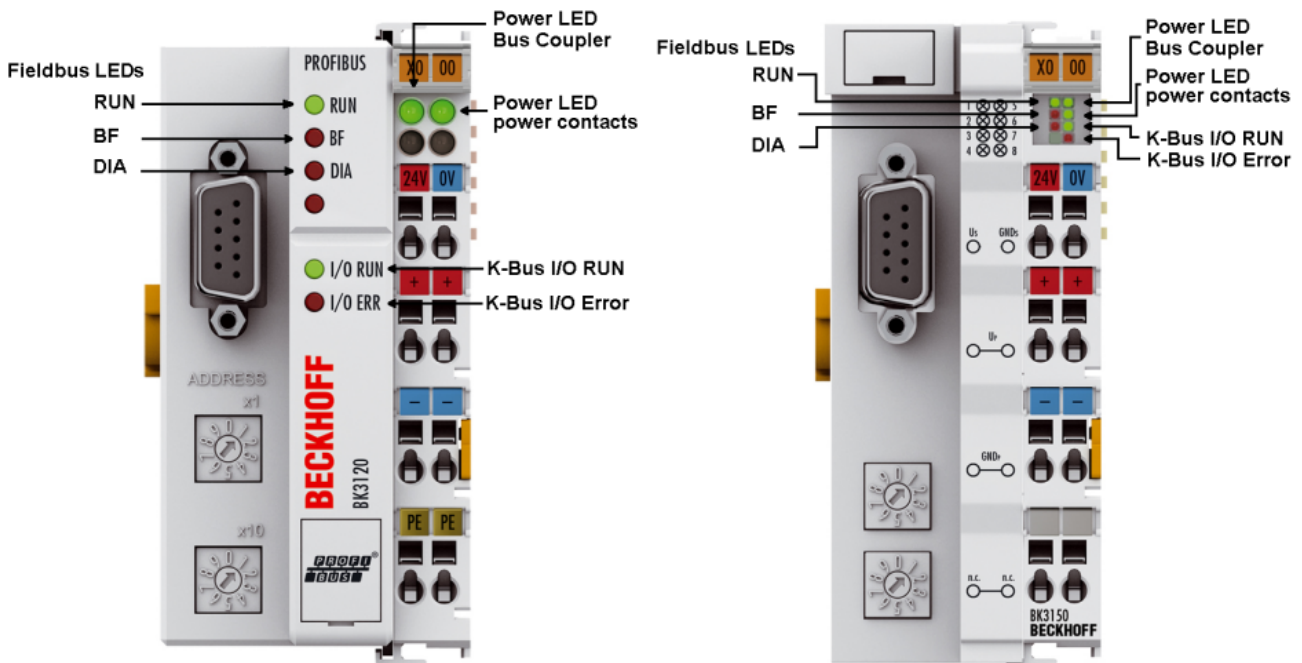


Fig. 44: LEDs BK3120 and BK3150

BK3xx0			Meaning	Remedy
I/O RUN	BF	DIA		
on	off	off	Operating state: RUN, inputs are read and outputs are set	Everything is operating correctly
on	on	off, blinking	1. Bus activity, but slave is already parameterized	Start master
			2. Bus error with reaction to PROFIBUS error: a.) K-bus outputs become 0 or b.) K-bus outputs are retained	Check parameters, configuration (possible error in DP start-up [▶ 71])
off	off	off	Data exchange with the master is not started	PLC start
off	on	on	No bus activity	Start the master, check the bus cable
off	on	off, blinking	Bus error with reaction to PROFIBUS error: K-bus cycle is stopped	Start master, check parameters, configuration (possible error in DP start-up [▶ 71])

DIA-LED blink codes

If an error occurs in the paramétrisation or configuration during DP start-up [► 71], this is indicated both through the fieldbus LEDs and in the diagnostic data.

Flashing Code

fast blinking	Start of the error code
First slow sequence	Error code
Second slow sequence	Error argument (error location)

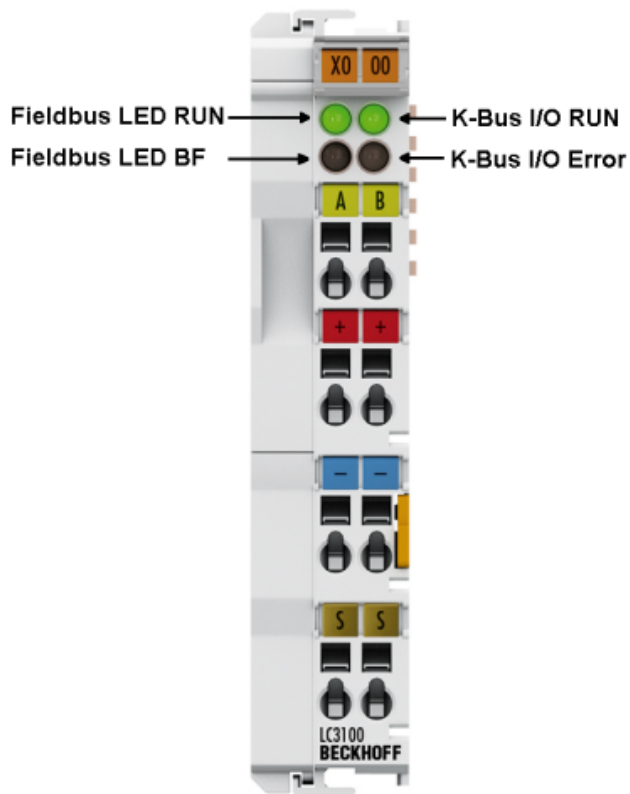


Fig. 45: LEDs LC3100

LC3100					
I/O RUN	BF	RUN	Meaning	Remedy	
on	off	on	Operating state: RUN, inputs are read and outputs are set	Everything is operating correctly	
on	on, blinking	on	1. Bus activity, but slave is already parameterized	Start master	
			2. Bus error with reaction to PROFIBUS error: a.) K-bus outputs become 0 or b.) K-bus outputs are retained	Check parameters, configuration (possible error in DP start-up [► 71])	
off	off	on	Data exchange with the master is not started	PLC start	
off	on	off	No bus activity	Start the master, check the bus cable	
off	on, blinking	on	Bus error with reaction to PROFIBUS error: K-bus cycle is stopped	Start master, check parameters, configuration (possible error in DP start-up [► 71])	

K-bus LEDs (local errors)

Two LEDs, the K-bus LEDs, indicate the operational state of the Bus Terminals and the connection to these Bus Terminals. The green LED (I/O RUN) lights up in order to indicate fault-free operation. The red LED (I/O ERR) flashes with two different frequencies in order to indicate an error. The errors are displayed in the blink code in the following way:

Error type

Error code	Error code argument	Description	Remedy
Persistent, continuous flashing	-	general K-bus error	Check the Bus Terminal strip
1 pulse	0	EEPROM checksum error	Set manufacturer's setting with the KS2000 software
	1	Inline code buffer overflow	Connect fewer Bus Terminals; too many entries in the table for the programmed configuration
	2	Unknown data type	Software update required for the coupler
2 pulses	0	Programmed configuration incorrect	Check programmed configuration for correctness
	n>0	Incorrect table entry Bus Coupler / incorrect table comparison (Bus Terminal n)	Correct table entry / Bus Coupler
3 pulses	0	K-bus command error	No Bus Terminal connected; attach Bus Terminals
			One of the Bus Terminals is defective; halve the number of Bus Terminals attached and check whether the error is still present with the remaining Bus Terminals. Repeat until the defective Bus Terminal is located.
4 pulses	0 n	K-bus data error, break behind Bus Coupler n	Check whether the n+1 Bus Terminal is correctly connected; replace if necessary. Check whether the End Terminal 9010 is connected.
5 pulses	n	K-bus error in register communication with Bus Terminal n	Replace Bus Terminal n
7 pulses	n	BK3x10 or LC3100: unsupported Bus Terminal detected at location n	Only use digital (bit oriented) Bus Terminals, or use a BK3120 Bus Coupler

Error code	Error code argument	Description	Remedy
9 pulses	0	Checksum error in program flash memory	Set manufacturer's setting with the KS2000
13 pulses	0	Runtime K-bus command error	One of the Bus Terminals is defective; halve the number of Bus Terminals attached and check whether the error is still present with the remaining Bus Terminals. Repeat until the defective Bus Terminal is located.
14 pulses	n	Bus Terminal n has the wrong format	Start the coupler again, and if the error occurs again then exchange the Bus Terminal
15 pulses	n	Number of Bus Terminals is no longer correct	Start the coupler again, and if the error occurs again after this, use the KS2000 software to set manufacturer's settings
16 pulses	n	Length of the K-bus data (bit length) is no longer correct. n = bit length after booting	
17 pulses	n	Number of Bus Terminals is no longer correct. n = number of Bus Terminals after booting	
18 pulses	n	Bus Terminal identifier no longer correct after reset (n = Bus Terminal number).	

Error location

The number of pulses indicates the position of the last Bus Terminal before the fault. Passive Bus Terminals, such as a power feed terminal, are not included in the count.

6.2 DP diagnostics

6.2.1 DP Diagnostic Data (DiagData)

The DP diagnostic data consists of six bytes of DP standard diagnosis, along with up to 238 bytes of device-specific diagnostic data. The device-specific diagnostic data for Beckhoff slaves is represented in the DPV1 status message.

When the DP diagnostic data changes, the slave reports this fact to the master, and the master will automatically fetch the changed diagnostic data. This means that DP diagnostic data is not included in the DP process data in real-time, but is always sent to the controller a few cycles later.

In TwinCAT the DP diagnostic data is read from the DP Master interface (FC310x, CX1500-M310) using ADS (see the section describing Slave Diagnosis in the FC310x documentation).

DP standard diagnostic data

Offset	Meaning
0x00.0	StationNonExistent: slave did not reply to the last telegram
0x00.1	StationNotReady: slave still processing the Set_Prm / Chk_Cfg telegram
0x00.2	CfgFault: slave signaling a configuration error
0x00.3	ExtDiag: extended DiagData available and valid
0x00.4	NotSupported: slave does not support a feature requested via Set_Prm or Global_Control
0x00.5	InvalidSlaveResponse: slave response not DP-compatible
0x00.6	PrmFault: slave reports a paramétrisation error
0x00.7	MasterLock: slave currently exchanging data with another master
0x01.0	PrmReq: re-parameterize and reconfigure slave
0x01.1	StatDiag: slave signaling static diagnosis / DPV1 slave application not yet ready for data exchange
0x01.2	PROFIBUS DP slave
0x01.3	WdOn: DP watchdog on
0x01.4	FreezeMode: DP slave in freeze mode
0x01.5	SyncMode: DP slave in sync mode
0x01.6	reserved
0x01.7	Deactivated: DP slave has been deactivated
0x02.0	reserved
0x02.1	reserved
0x02.2	reserved
0x02.3	reserved
0x02.4	reserved
0x02.5	reserved
0x02.6	reserved
0x02.7	ExtDiagOverflow: too much extended data present
0x03	MasterAdd: station address of master with which slave is exchanging data
0x04,0x05	IdentNumber
from 0x06	Device-specific diagnostic data (extended DiagData)

Device-specific diagnostic data (DPV1 status message)

The meaning of the first 4 bytes of the DPV1 status message is specified by the DPV1 standard, while the bytes that follow are manufacturer-specific.

Byte	Bit	Description
6	0-7	The length of the DPV1 status message (including this byte)
7	0-7	StatusType: the StatusType identifies the format of the diagnostic data starting at byte 16 (0x81 : max. 64 modules, 0xA1 : more than 64 modules)
8	0-7	SlotNumber: always 0
9	0-7	Specifier: always 0
10	0	EEPROM checksum error (can be cleared by setting the manufacturers setting through KS2000 or DPV1 [► 60], followed by a power off/power on cycle)
10	4	Unknown module type
10	5	The length of the CfgData is too great (too many modules are inserted)
10	6	The length of the DP input data is too great (too many modules are inserted)
10	7	The length of the DP output data is too great (too many modules are inserted)
11	0-7	Error on an internal bus [► 73] (K-bus, IP-Link, etc.)
12	0-7	Error code on an internal bus (K-bus, IP-Link, etc.)
13	0-7	Error argument on an internal bus (K-bus, IP-Link, etc.)
14	0-7	DP start-up error code [► 71]
15	0-7	DP start-up error argument [► 71]

Errors in the modules (terminals, IP modules, IE module, etc.)

Diagnosis of the modules [► 74] must be activated through the UserPrmData [► 38].

Couplers with a maximum of 64 possible modules

Byte	Bit	Description
16	0-5	Module number (0-63) with an error (bit 6 of the status bytes is set, except for the serial interface modules (KL6001, KL6011, KL6021, IP6002, IP6012, IP6022, IE6002, IE6012, IE6022), where bit 3 of the status byte is set)
16	6-7	Associated channel number (0-3)
17	0-7	Status byte of the faulty channel (bits 0-7)
18	0-5	Module number (0-63) with an error (bit 6 of the status bytes is set, except for the serial interface modules (KL6001, KL6011, KL6021, IP6002, IP6012, IP6022, IE6002, IE6012, IE6022), where bit 3 of the status byte is set)
18	6-7	Associated channel number (0-3)
19	0-7	Status byte of the faulty channel (bits 0-7)
...
60	0-5	Module number (0-63) with an error (bit 6 of the status bytes is set, except for the serial interface modules (KL6001, KL6011, KL6021, IP6002, IP6012, IP6022, IE6002, IE6012, IE6022), where bit 3 of the status byte is set)
60	6-7	Associated channel number (0-3)
61	0-7	Status byte of the faulty channel (bits 0-7)

Couplers with a maximum of more than 64 possible modules

Byte	Bit	Description
16	0-7	Module number (1-255) with an error (bit 6 of the status bytes is set, except for the serial interface modules (KL6001, KL6011, KL6021, IP6002, IP6012, IP6022, IE6002, IE6012, IE6022), where bit 3 of the status byte is set)
17	6-7	Associated channel number (0-3)
17	0-5	Status byte of the faulty channel (bits 0-5)
18	0-7	Module number (1-255) with an error (bit 6 of the status bytes is set, except for the serial interface modules (KL6001, KL6011, KL6021, IP6002, IP6012, IP6022, IE6002, IE6012, IE6022), where bit 3 of the status byte is set)
19	6-7	Associated channel number (0-3)
19	0-5	Status byte of the faulty channel (bits 0-5)
...
60	0-7	Module number (1-255) with an error (bit 6 of the status bytes is set, except for the serial interface modules (KL6001, KL6011, KL6021, IP6002, IP6012, IP6022, IE6002, IE6012, IE6022), where bit 3 of the status byte is set)
61	6-7	Associated channel number (0-3)
61	0-5	Status byte of the faulty channel (bits 0-5)

6.2.2 Errors during DP Start-up

If an error occurs in the paramétrisation (UserPrmData) [▶ 38] or configuration (CfgData) during DP start-up, this is indicated both through the fieldbus LEDs [▶ 65] and in the diagnostic data (DiagData) [▶ 68].

Possible DP start-up errors are identified by an error code and an error argument.

Errors when checking the UserPrmData

Error code 1

Error code 1 indicates that a reserved bit in the UserPrmData has been set to an incorrect value, or that the function corresponding to the bit in the UserPrmData is not supported. The error argument describes which UserPrmData byte has been detected as containing an error (the offset of the faulty byte + 1).

Error code 3

Error code 3 indicates that a combination of functions selected in the UserPrmData is not allowed. The error argument describes the impermissible combination.

Error code argument	Description
1	The <u>Reaction to DP error</u> [▶ 57] cannot be set to "Outputs unchanged" in <u>synchronous mode</u> [▶ 73]
2	The <u>DPV1-MSAC_C1 connection</u> [▶ 60] has been activated by the master, but no DPV1-MSAC_C1 connection is defined
6	The <u>Multi-configuration mode</u> [▶ 77] is not allowed if <u>Checking the CfgData is switched off</u> [▶ 77]
8	<u>Synchronous mode</u> [▶ 57] may only be activated when at least one DP output byte is configured
10	The <u>optimized input cycle</u> [▶ 57] is only possible in <u>synchronous mode</u> [▶ 57]
11	The length of the DP buffer exceeds the size of the DP RAM in the PROFIBUS ASIC
12	<u>Fast-FreeRun mode</u> [▶ 57] may not be activated together with <u>synchronous mode</u> [▶ 57]

Errors when checking the CfgData

Error code 2

Error code 2 indicates that a byte in the CfgData is not correct. The error argument describes which CfgData byte has been detected as containing an error (the offset of the faulty byte + 1).

Error code 5

Error code 5 indicates that the length of the digital outputs (in bytes) calculated from the CfgData is not correct. The error argument contains the expected byte length.

Error code 6

Error code 6 indicates that the length of the digital inputs (in bytes) calculated from the CfgData is not correct. The error argument contains the expected byte length.

Error code 7

Error code 7 indicates a variety of errors when checking the CfgData. The error argument describes the error.

Error argument	Description
1	The length of the CfgData received is not correct
2	The syntax of the CfgData received is not correct
3	The length of the DP input data that has been calculated from the CfgData is too large
4	The length of the DP output data that has been calculated from the CfgData is too large
5..12	Reserve
13	Maximum input length exceeded
14	Maximum output length exceeded
15	Maximum diagnostic data length exceeded (64 bytes) or value below minimum diagnostic data length (16 bytes)
16	Maximum config data length exceeded (240 bytes) or value below minimum config data length (1 byte)
17	Maximum parameter data length exceeded (224 bytes) or value below minimum parameter data length (64 bytes)

Errors during slave start-up

Error code 8

Error code 8 indicates that the length of the DP buffer is greater than the size of the DP RAM in the PROFIBUS ASIC. The error argument contains the difference (divided by 8). DP communication is deactivated.

Error code 9

Error code 9 indicates a variety of errors that may be detected as the device boots. The error argument describes the error.

Error argument	Description
1	The length of the DP input data is too great (too many modules are inserted)
2	The length of the DP output data is too great (too many modules are inserted)
3	The length of the CfgData is too great (too many modules are inserted)

Error code 10*

Error during the register communication. The settings to be written via the UserPrm data were executed incorrectly.

Error argument	Description
x	Problems with terminal x

Error code 11*

Error during the register communication. The settings to be written via the UserPrm data were aborted with a timeout.

Error argument	Description
x	Problems with terminal x

* Only for BK3120 or BK3150 with the GSD file and slot-oriented mapping (E312BECE.GS? or E315BECE.GS?)

6.2.3 Reaction to PROFIBUS Error

A PROFIBUS error (failure of the master, withdrawal of the PROFIBUS plug etc.) is detected after the DP watchdog has elapsed (usually in the region of 100 ms, unless this has been deactivated in the master) or by bus timeout (the baud rate supervision time is set to 10 s).

The reaction at the output data of the coupler can be set in the UserPrmData [▶ 38]:

Byte	Bit	Value	Description
10	0-1	00 _{bin}	Reaction to PROFIBUS error: K-bus cycle is abandoned (default, digital outputs become 0, complex outputs are set to a planned substitute value)
		01 _{bin}	Reaction to PROFIBUS error: K-bus outputs become 0
		10 _{bin}	Reaction to PROFIBUS error: K-bus outputs remain unchanged

6.3 K-bus diagnosis

6.3.1 K-bus interruption

If the K-bus is interrupted, or suffers from a relatively long malfunction, the coupler enters the *K-bus error* state. Depending on the setting made for *Reaction to K-Bus error* in the UserPrmData [▶ 38], the coupler abandons DP data exchange and sets the Stat_Diag bit in the diagnostic data [▶ 68] at the next DP start-up (with the consequence that DP data exchange is not carried out), sets the DP inputs to 0, or leaves the DP inputs unchanged.

Byte	Bit	Value	Description
10	2-3	00 _{bin}	Reaction to K-bus error: DP data exchange is abandoned (default)
		01 _{bin}	Reaction to K-bus error: DP inputs set to 0
		10 _{bin}	Reaction to K-bus error: DP inputs remain unchanged

When the interruption or malfunction on the K-bus has been rectified, the setting of *Response to K-bus error* in the UserPrmData [▶ 38] determines whether the *K-bus error* state is left manually (by means of a K-bus reset), or automatically:

Byte	Bit	Value	Description
7	0	0 _{bin}	Response to K-bus error: manual K-bus reset (default)
		1 _{bin}	Response to K-bus error: automatic K-bus reset

Signaling the K-bus error

A K-bus error is indicated both on the *I/O-ERR* LED and in the DPV1 status message in the DP diagnostic data [► 68] (bytes 11-13).

Byte	Bit	Description
11	0	too many K-bus command errors
11	1	too many K-bus timeouts
11	2	too many K-bus receive errors
11	3	too many K-bus transmit errors
11	4	K-bus reset error
11	5	general K-bus error
12	0-7	K-bus error code
13	0-7	K-bus error argument

K-bus reset

A K-bus reset can be carried out manually by means of a DPV1 Write:

Slot number	Index	Byte	Value
0	99	0	2
		1	1
		2	0
		3	0

6.3.2 Terminal Diagnostics

If terminal diagnosis has been activated, then each channel of a complex terminals is examined to see whether bit 6 in the status has changed (exceptions are the KL6001, KL6011 and KL6021, where the relevant bit is bit 3), and whether the diagnostic bit of each channel of a digital terminal with diagnostics (KL12x2 or KL22x2) has changed. If that is the case, the existence of new diagnostic data is reported to the master, and two bytes of diagnostic information starting at byte 16 of each channel for which a diagnosis is pending are inserted (see Diagnostic data [► 68]).

Terminal diagnosis can be activated in the UserPrmData [► 38]:

Byte	Bit	Value	Description
7	1	1 _{bin}	Terminal diagnosis is active

Digital terminal diagnosis

By default, the diagnostic bits for the digital terminals that have diagnosis (KL12x2 and KL22x2) are transmitted cyclically in the process image. These terminals occupy 4 bits each in both the input and output data. If terminal diagnosis is active, then UserPrmData can be used to specify that only the I/O data for the digital terminals with diagnosis (KL12x2: 2 bit inputs, KL22x2: 4 bit outputs) is to be included in the cyclic process image transfer:

Byte	Bit	Value	Description
7	4	1 _{bin}	Diagnostic data of digital terminals not in the cyclic process image

Real-time capacity of the diagnostic data

When making use of terminal diagnosis, it should always be borne in mind that the diagnostic data always reaches the controller at least one cycle later, and that as a rule access also takes place through different mechanisms from those used for cyclic process data. This means that process data can already be faulty,

but the controller program is only informed of this in the following cycle or the one after that. If the diagnostic bits of digital terminals with diagnostics or the status of complex terminals are mapped to the process image, the control program always has a consistent state between process and diagnostic data. The appropriate setting therefore depends on the way that the diagnosis is to be used. If it is only intended for diagnostic display, transmission within the cyclic process data is unnecessary, but if on the other hand consistency between the process data and the diagnostic data is desired, then the diagnostic data should be transmitted along with the cyclic process data.

Maximum diagnosis data length

If more diagnostic terminal data are active than specified in the maximum diagnostic data length, the ExtDiagOverflow bit of the standard [diagnostic data](#) [► 68] is set. Since older controllers have trouble handling the maximum diagnostic data length of 64 bytes (default setting), the maximum diagnostic data length can be limited in [UserPrmData](#) [► 38]:

Byte	Bit	Description
11	3-6	Maximum length of the diagnostic data. Allowed values: 16, 24, 32, 40, 48, 56, 64

It is only possible to set the maximum diagnostic data length in text form in the extended GSD file.

7 Extended functions

7.1 2-byte PLC Interface

Checking the CfgData can be deactivated if a DP master is not capable of operating with the modules listed in the GSD file. In that case the master can send any CfgData, and as many inputs and outputs are transferred as are described by the CfgData.

Deactivation of the CfgData checking can also be useful if a specific address range is to be reserved in the PLC for future extensions. In that case, more input and output data is to be transferred than is in fact necessary.

Deactivation of the CfgData check can be set in the [UserPrmData \[► 38\]](#):

Byte	Bit	Value	Description
1	0	1 _{bin}	CfgData checking is deactivated

In general, the I/O data from the modules (terminals or IE modules) is written by the coupler in the standard sequence (first the complex, then the digital modules), as is also the case for other fieldbus couplers; this has already been described in connection with the structure of the process image in the coupler. The decision on a module-to-module basis as to whether the module is mapped in compact or complex form, which would otherwise be possible under DP, is omitted when CfgData checking is deactivated. In that case, the setting made in the UserPrmData applies to all modules:

The compact or complex mapping can be set in the [UserPrmData \[► 38\]](#):

Byte	Bit	Value	Description
9	2	0 _{bin}	Analog modules are mapped in compact form (only with the input or output user data)
		1 _{bin}	Analog modules are mapped in complex form (including control/status for register access and the same data length in the inputs and outputs)

The extended GSD file must be used to deactivate CfgData checking and to specify compact/complex mapping textually in the master's configuration tool.

7.2 Word Alignment

In order to obtain the I/O data in the controller's process image in a clear form in controllers with word-oriented process images, it is possible to specify that word alignment is used when the coupler generates its process image. This involves a dummy byte being inserted for every variable that is larger than one byte and which would start on an uneven address.

Word alignment can be set in the [UserPrmData \[► 38\]](#):

Byte	Bit	Value	Description
9	5	1 _{bin}	Word alignment is active

When using the DP modules it is necessary to ensure that only those complex modules that are identified with word alignment are used.

The extended GSD file must be used in order to set word alignment in text form in the master's configuration tool and to be able to select the word alignment module.

7.3 Deactivating the CfgData Check

Checking the CfgData can be deactivated if a DP master is not capable of operating with the modules listed in the GSD file. In that case the master can send any CfgData, and as many inputs and outputs are transferred as are described by the CfgData.

Deactivation of the CfgData checking can also be useful if a specific address range is to be reserved in the PLC for future extensions. In that case, more input and output data is to be transferred than is in fact necessary.

Deactivation of the CfgData check can be set in the [UserPrmData \[► 38\]](#):

Byte	Bit	Value	Description
1	0	1 _{bin}	CfgData checking is deactivated

In general, the I/O data from the modules (terminals or IE modules) is written by the coupler in the standard sequence (first the complex, then the digital modules), as is also the case for other fieldbus couplers; this has already been described in connection with the structure of the process image in the coupler. The decision on a module-to-module basis as to whether the module is mapped in compact or complex form, which would otherwise be possible under DP, is omitted when CfgData checking is deactivated. In that case, the setting made in the UserPrmData applies to all modules:

The compact or complex mapping can be set in the [UserPrmData \[► 38\]](#):

Byte	Bit	Value	Description
9	2	0 _{bin}	Analog modules are mapped in compact form (only with the input or output user data)
		1 _{bin}	Analog modules are mapped in complex form (including control/status for register access and the same data length in the inputs and outputs)

The extended GSD file must be used to deactivate CfgData checking and to specify compact/complex mapping textually in the master's configuration tool.

7.4 Multi-Configuration Mode

Applications of the multi-configuration mode

Multi-configuration mode can be used for the following types of application. A more extensive consideration, considering, in particular, the various implementation levels of the Bus Coupler, is given in the [Requirements of a production machine \[► 82\]](#).

Creating a DP configuration for various implementation levels of the Bus Coupler

If a PLC program is to be used for controlling different configurations of a process, it may make sense to use the same DP configuration even if the terminal configuration is different. In this case the address offsets in the process image do not change, and the DP configuration of the PROFIBUS DP master does not have to be re-saved for each version. With the multi-configuration mode it is now possible to define a maximum configuration for the Bus Coupler, and in this case it will only be necessary to disable those terminals that are not present in accordance with the current implementation level.

Reserved Bus Terminals

Because all the analog terminals are configured first in the DP configuration, before the digital terminals, the consequence of inserting analog terminals at a later stage is that the address offsets of the digital terminals are shifted. The insertion of a digital terminal within the existing terminal structure (which can, for instance, be useful if digital terminals with different input voltages are used) also has the consequence that the offsets of the digital terminals that follow it are shifted. If a digital terminal is inserted before the end terminal however, the offset of the existing terminals are not shifted. With multi-configuration mode it is now possible to configure additional terminals as reserves at any location within the terminal structure.

Assigning the Bus Terminals to freely chosen process image addresses

Because digital terminals are always grouped into bytes, which therefore means that the smallest DP configuration module is an 8-bit module, a difficulty arises when the associated terminals are to be distributed over a number of bytes in the PLC process image. This is because in the PLC it is usually only possible to assign addresses for each DP configuration module. With multi-configuration mode it is now possible to configure additional digital terminals as "dummy" terminals at any desired locations, enabling the address offsets of the other terminals to be shifted in the PLC process image.

Setting the multi-configuration mode

Multi-configuration mode is activated via the [UserPrmData \[► 38\]](#):

Byte	Bit	Description
3	4	1: Multi-configuration mode is active

Rules for multi-configuration mode

Multi-configuration mode requires a few additional rules to be observed, in addition to those for standard configuration:

- Only one DP module may be configured for each analog terminal
- The digital terminals are to be declared as KLxxx Multi-Cfg mode modules at their true position
- The digital terminals are to be declared after the analog modules moreover as input/output sum modules, corresponding to their bit width, as is also the case for standard configuration in the process image.
- All modules for the maximum configuration, including the reserve modules, are to be declared
- Modules that are not inserted must be disabled

Enabling/disabling Bus Terminals

Those Bus Terminals that are present in the DP configuration, but that are not in fact plugged in, must be disabled. This can be done in the [UserPrmData \[► 38\]](#), via DPV1, KS2000 or through the 2-byte PLC interface.

Making the setting through DPV1 or through the 2-byte PLC interface has the advantage that the terminal assignment for the multi-configuration mode can usually be made directly from the PLC program, without having to change the DP configuration of the master.

As long as the inserted Bus Terminals do not agree with the non-disabled Bus Terminals to be expected from the DP configuration, the Bus Terminal will normally set the *Stat_Diag* bit in the diagnostic data, with the consequence that it is not yet ready for cyclic data exchange.

If, however, the enabling and disabling is to be carried out via the 2-byte PLC interface, it is a precondition for function of the 2-byte PLC interface that the coupler is in cyclic data exchange mode. For that reason it is also possible to deactivate remaining in the *Stat_Diag* state:

Byte	Bit	Description
3	6	1: In multi-configuration mode the coupler also enters the data exchange even when the configuration is not consistent, although K-bus cycles are not yet executed

Enabling/disabling via UserPrmData

The assignment of the terminals (a maximum of 128 terminals is possible) is entered from byte 15 to byte 30 and from byte 41 to byte 56 of the [UserPrmData \[► 38\]](#). Two bits are reserved here for each terminal, indicating whether the relevant terminal is enabled (value 0) or disabled (value 2). If the UserPrmData is to be displayed as text in the DP configuration tool, then the parameters *Assignment of module x* are to be set to *DP DataExchange (enabled)* or *Multi-Config. mode (disabled)*.

Byte	Bit	Description
15	0,1	Assignment for terminal 1 0: DP DataExchange (default) 2: disabled (Multi-Config mode)
	2,3	Assignment for terminal 2 0: DP DataExchange (default) 2: disabled (Multi-Config mode)
	4,5	Assignment for terminal 3 0: DP DataExchange (default) 2: disabled (Multi-Config mode)
	6,7	Assignment for terminal 4 0: DP DataExchange (default) 2: disabled (Multi-Config mode)
...
30	6,7	Assignment for terminal 64 0: DP DataExchange (default) 2: disabled (Multi-Config mode)
41	0,1	Assignment for terminal 65 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
...
56	6,7	Assignment for terminal 128 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)

Enabling/disabling via DPV1 Write

The terminals are enabled/disabled through Slot_Number 0 and Index 1 or 2:

Index	Byte	Bit	Description
1	0	0,1	Assignment for terminal 1 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
		2,3	Assignment for terminal 2 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
		4,5	Assignment for terminal 3 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
		6,7	Assignment for terminal 4 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)

2	15	6,7	Assignment for terminal 64 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
	0	0,1	Assignment for terminal 65 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
	
15	6,7	Assignment for terminal 128 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)	

Enabling/disabling via the 2-byte PLC interface or through KS2000

The terminals are enabled or disabled through table 1, registers 0-31:

Register	Bit	Description
0	0,1	Assignment for terminal 1 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
	2,3	Assignment for terminal 2 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
	4,5	Assignment for terminal 3 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
	6,7	Assignment for terminal 4 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
	8,9	Assignment for terminal 5 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
	10,11	Assignment for terminal 6 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
	12,13	Assignment for terminal 7 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
	14,15	Assignment for terminal 8 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)
...
31	14,15	Assignment for terminal 128 0: DP-DataExchange (Default) 2: disabled (Multi-Config-Mode)

i Note the size of the Cfg data

It can happen under multi-configuration mode that the CfgData exceeds 64 bytes. In such a case, the [CfgData \[► 80\]](#) must be enlarged.

7.5 Changing the Size of the Process Data

Exceeding the input data length (InputData)

By default, a maximum of 128 bytes of input data is set on the Bus Coupler.

The maximum lengths of the DP buffers can be changed, although the amount by which a length is increased has to be subtracted from another, and the sizes must only be modified in 8-byte steps:

Exceeding the output data length (OutputData)

By default, a maximum of 128 bytes of output data is set on the Bus Coupler.

The maximum length of the DP buffer can be changed. The amount, however, by which one length is increased must be taken away from another, and it must be noted that the sizes can only be changed in 8-byte steps:

Exceeding the configuration data length (CfgData)

By default, a maximum of 64 bytes of configuration data is set on the Bus Coupler. Normally, this is only a problem in very rare cases. In multi-configuration mode, however, this limit is reached with no more than a 30 digital terminals, because each KLxxxx MultiCfgMode module occupies two bytes in the configuration data, on top of which there is at least one sum byte for digital inputs or for digital outputs.

The maximum lengths of the DP buffers can be changed, although the amount by which a length is increased has to be subtracted from another, and the sizes must only be modified in 8-byte steps:

Maximum DP buffer sizes

DP buffer	Maximum sizes under default settings
Inputs	128 bytes
Outputs	128 bytes
Diagnostic data	64 bytes
Configuration data	64 bytes

Setting via the 2-BYTE PLC interface or KS2000

The maximum DP buffer sizes can be modified in Table 100, although it is necessary for the Bus Coupler to be reset (power off/power on, or a software reset) before the new value is adopted:

Register	Description
2	maximum length of input data
3	maximum length of output data
4	maximum length of diagnosis data
5	maximum length of configuration data

Setting via UserPrmData

The Bus Coupler's reset is carried out automatically if the DP buffers are set using [UserPrmData \[► 38\]](#):

Byte	Bit	Description
12	4-7	15 dec or 0xF hex: the maximum DP buffer lengths are changed using the values from UserPrmData 37-40
37	0-7	maximum length of input data
38	0-7	maximum length of output data
39	0-7	maximum length of diagnosis data
40	0-7	maximum length of configuration data

Example 1: Not enough configuration data

```
128 bytes input
128 bytes output
80 bytes CfgData
48 bytes diagnosis data
```

Example 2: Not enough input data

```
160 bytes input
96 bytes output
64 bytes CfgData
64 bytes diagnosis data
```

7.6 Bus Coupler versions in multi-configuration mode

Structure of a production machine

Production machines often consist of a machine part that is always present in the machine and of machine extensions that may be added as options. This division also usually applies as well both to the software (the control program) and to the hardware (the necessary process signals via Beckhoff Bus Terminals) associated with the machine. A machine, with machine extensions A, B and C, whose process signals are to be read or output over the PROFIBUS DP through Beckhoff Bus Couplers BK3110, BK3120 or BK3520, could be structured as follows.

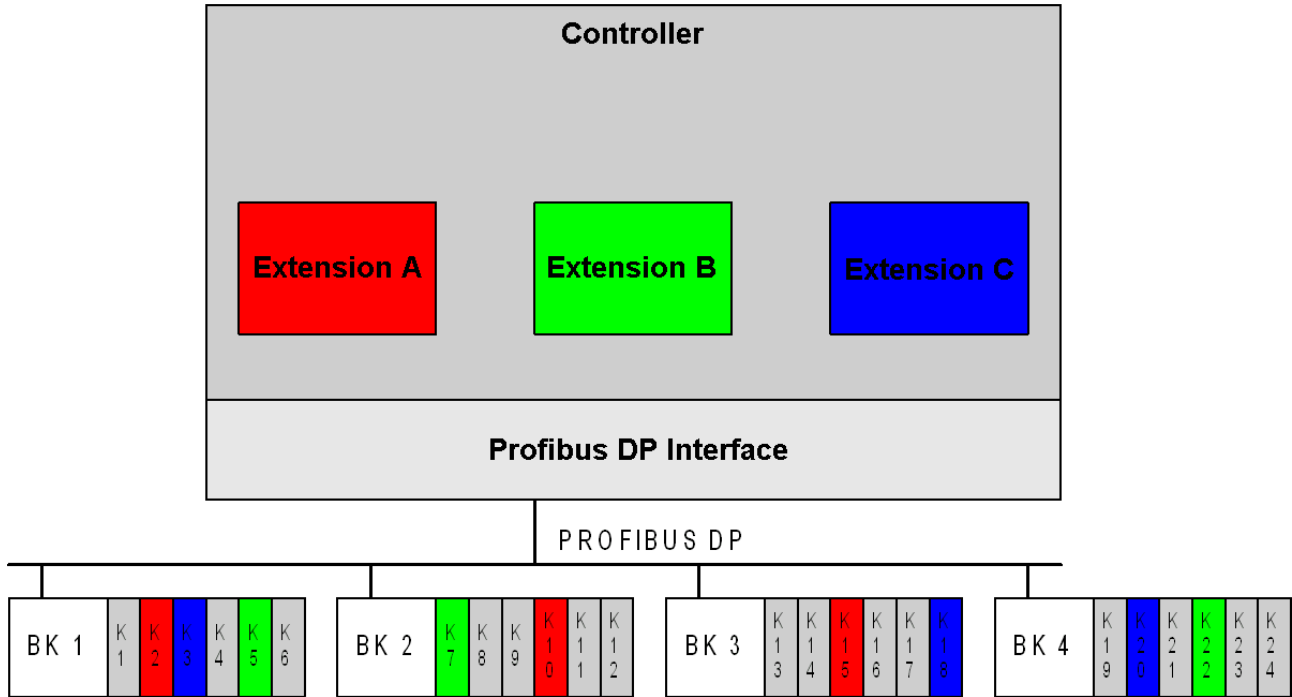


Fig. 46: Representation of a production machine

The machine illustrated consists of a controller (e.g. TwinCAT, S7-400, etc.), a PROFIBUS DP master interface (e.g. FC3101, CP???, etc.) that sends or receives the process signals over the PROFIBUS DP, and of Bus Couplers with Bus Terminals that form the interface to the machine process. The areas shown in grey relate to machine parts that are always present. The machine extensions A, B and C are shown in red, green and blue. It can be seen that each machine extension is associated both with software modules within the control program and process signals that are connected to the controller via Bus Terminals.

Because the machine builder will not want to maintain eight different control programs for all possible combinations of the machine extensions, it is helpful if the control program is designed in such a way that the necessary software modules are activated according to whichever machine extensions are in fact being used. In order to create a control program suited to all implementation levels of the machine it is however necessary for the same process signals always to appear at the same addresses in the controller's process image, independently of which process signals are in fact present in the relevant implementation level. For conventional DP slaves, a different configuration of the PROFIBUS DP master interface is necessary in such cases. The following sections explain how this problem can be solved with Beckhoff Bus Couplers, using a single configuration of the PROFIBUS DP master interface.

The advantage of this solution is that two machine configurations only differ in terms of the hardware used (machine components and Bus Terminals), but not in terms of the software. If the machine is upgraded, it is only necessary for the additional Bus Terminals to be inserted and wired-up, and for the relevant extension to be activated (e.g. via the man-machine interface to the machine). Software changes are no longer required.

Process image interfaces

The interfaces between controller, PROFIBUS DP master interface, Bus Coupler and Bus Terminals form process images, in which the process signals are stored according to certain algorithms.

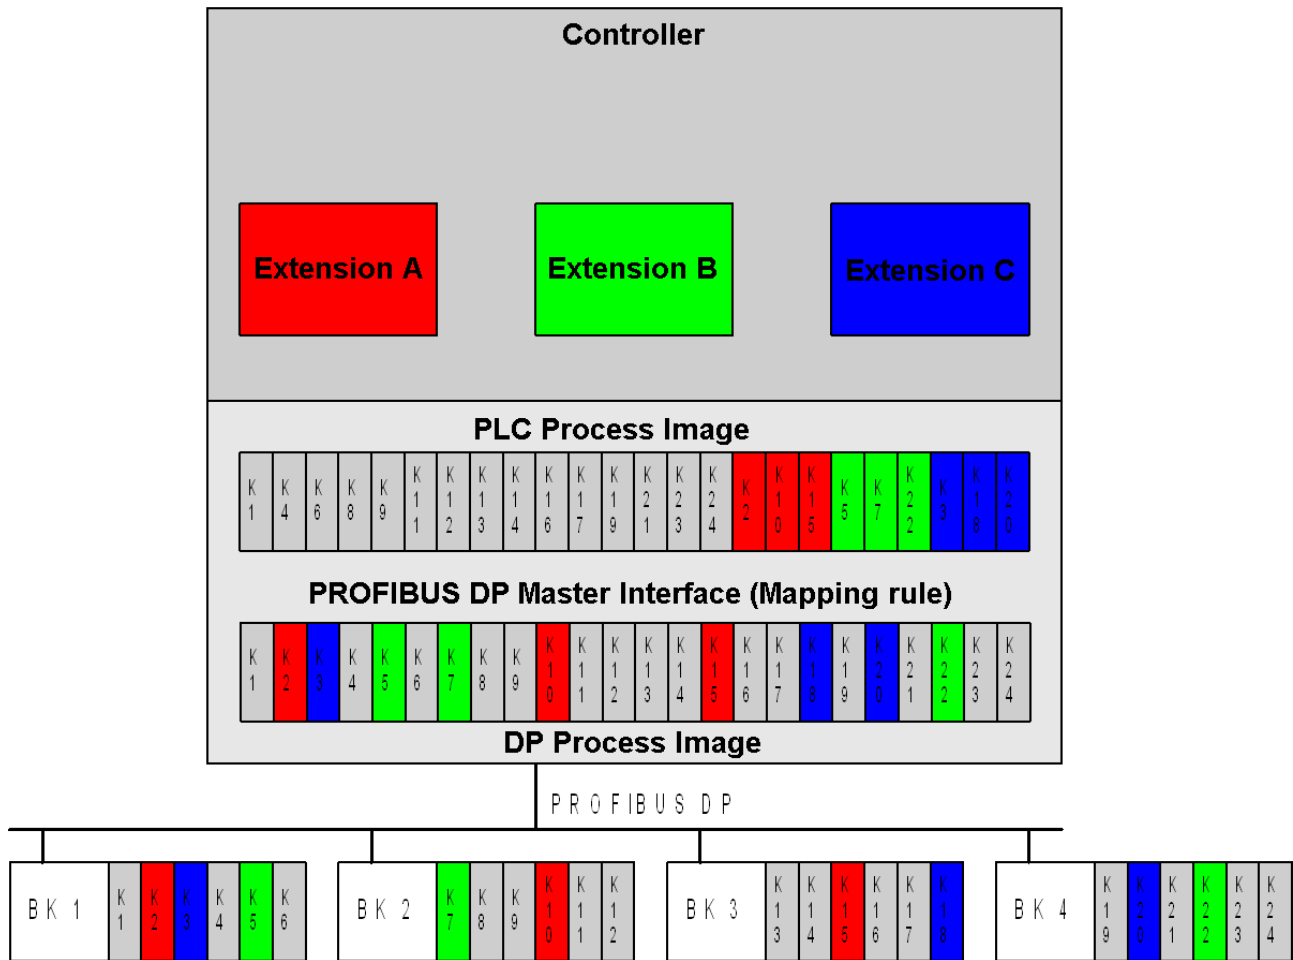



Fig. 47: Process image of the production machine

The process signals of a DP slave (Bus Coupler BK3110, BK3120 or BK3520) are always transferred in a Data_Exchange telegram, in which the outputs are sent by the DP master and the inputs are received in the associated telegram response. In the PROFIBUS DP master interface, the process images exchanged with the Bus Couplers are mapped to the process images of the control according to a mapping rule.

Process images of the machine configurations

As shown in the two examples in the figure below, the mapping rule in the PROFIBUS DP master interface changes, depending on which machine extensions are used (there are two examples here).

Only Extension A

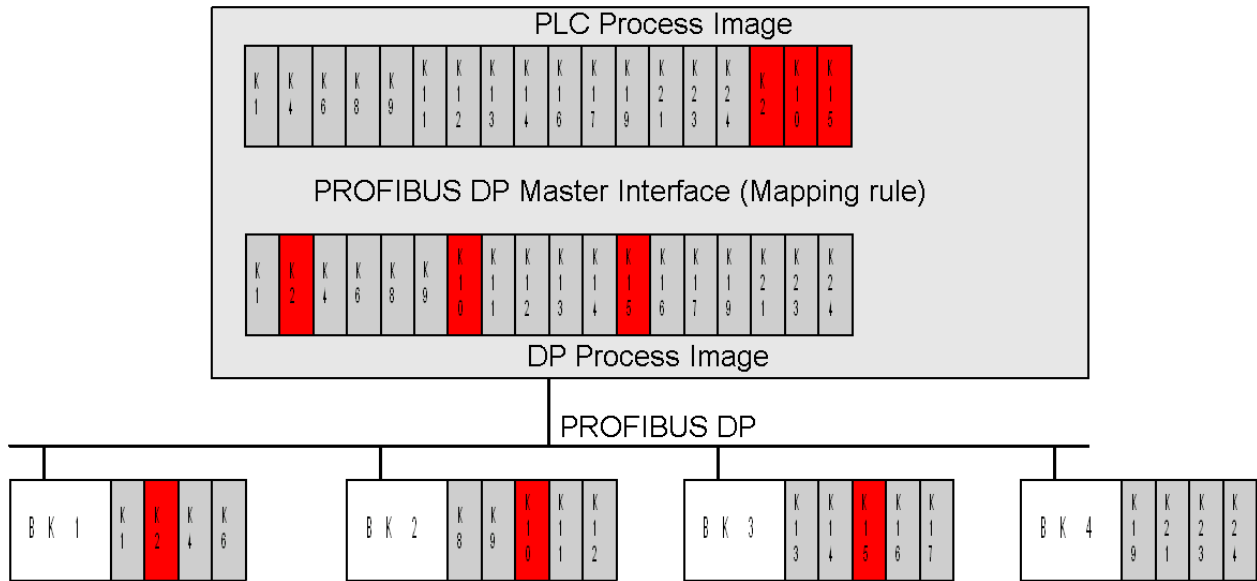

Only Extension B

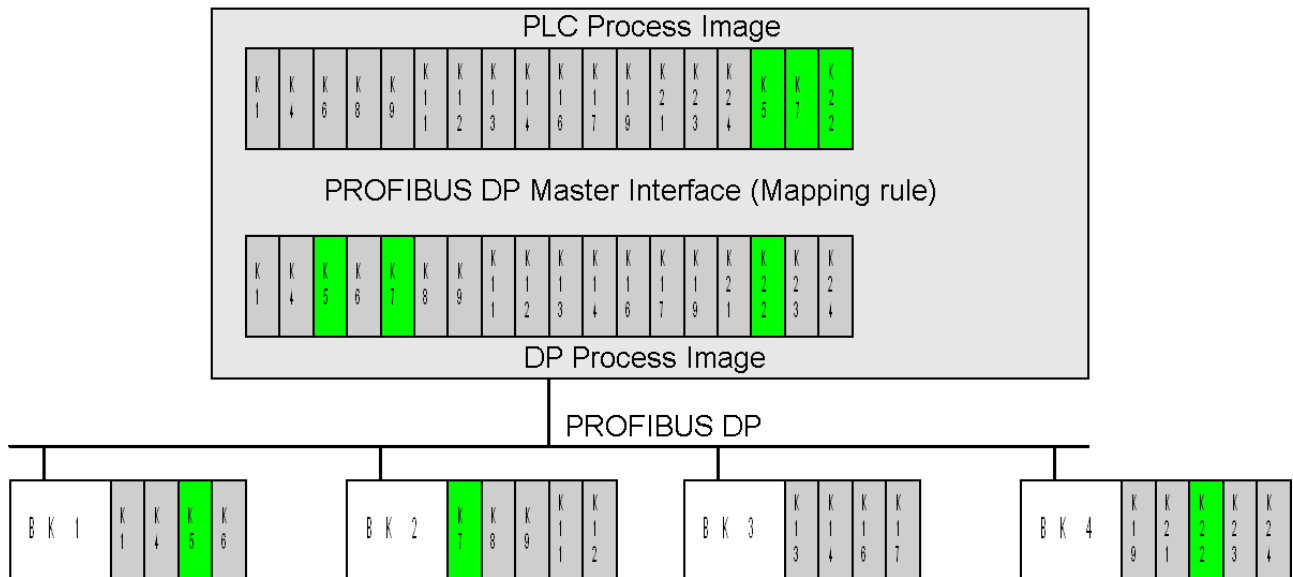


Fig. 48: Process images of the two different machine configurations

In order to solve the problem of the changed mapping rule, a facility is provided in the BK3110, BK3120 and BK3520 Bus Couplers through which the mapping can be carried out in the Bus Coupler (multi-configuration mode), so that they always exchange the same process image with the PROFIBUS DP master, independently of the Bus Terminals present:

Setting the Bus Terminal extension in the Bus Coupler


So that the same process image can always be transferred between the PROFIBUS DP master and the Bus Coupler, independently of the implementation level of the machine or of the Bus Terminals, the maximum Bus Terminal implementation for the Bus Coupler is always configured in the PROFIBUS DP master under multi-configuration mode. This PROFIBUS DP configuration is sent from the PROFIBUS DP master to the Bus Coupler when the PROFIBUS DP bus is starting up. This then compares the received PROFIBUS DP configuration with the bus terminals that are actually present.

If the Bus Coupler is not already being operated with the maximum Bus Terminal implementation level, the PROFIBUS DP configuration will not agree with the Bus Terminal structure that it finds. So that the Bus Coupler can nevertheless represent the process signals from the connected Bus Terminals in the process image that is to be exchanged with the PROFIBUS DP master, the mapping rule is now required.

Because the Bus Coupler maps the process signals from the Bus Terminals into the DP process image according to a fixed algorithm (first complex, then digital terminals, each in the sequence in which they are plugged in), the only information that is missing is that of which of the Bus Terminals that are included in the PROFIBUS DP configuration are indeed truly present. This information can be transmitted via the acyclic DPV1 Write, or through the 2-byte PLC interface for those PROFIBUS DP master interfaces that do not support PROFIBUS DPV1. The acyclic DPV1 Write is usually available through function blocks (TwinCAT: ADS-Write, S7 400: SFB 52 (read) and SFB53 (write)) from the controller program. The 2-byte PLC interface of the Bus Coupler is mapped directly into the controller's process image. As soon as a machine extension is activated or deactivated, the controller program can therefore activate or deactivate the associated Bus Terminals.

Example as above, where deactivated terminals are marked in yellow:

Only Extension A

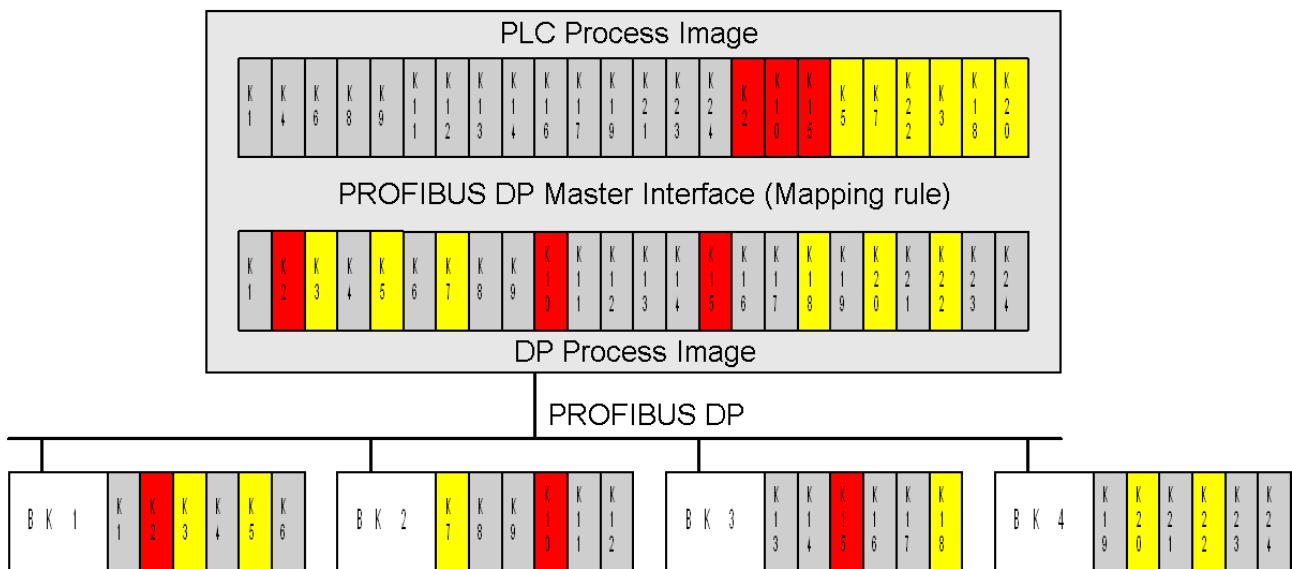

Only Extension B

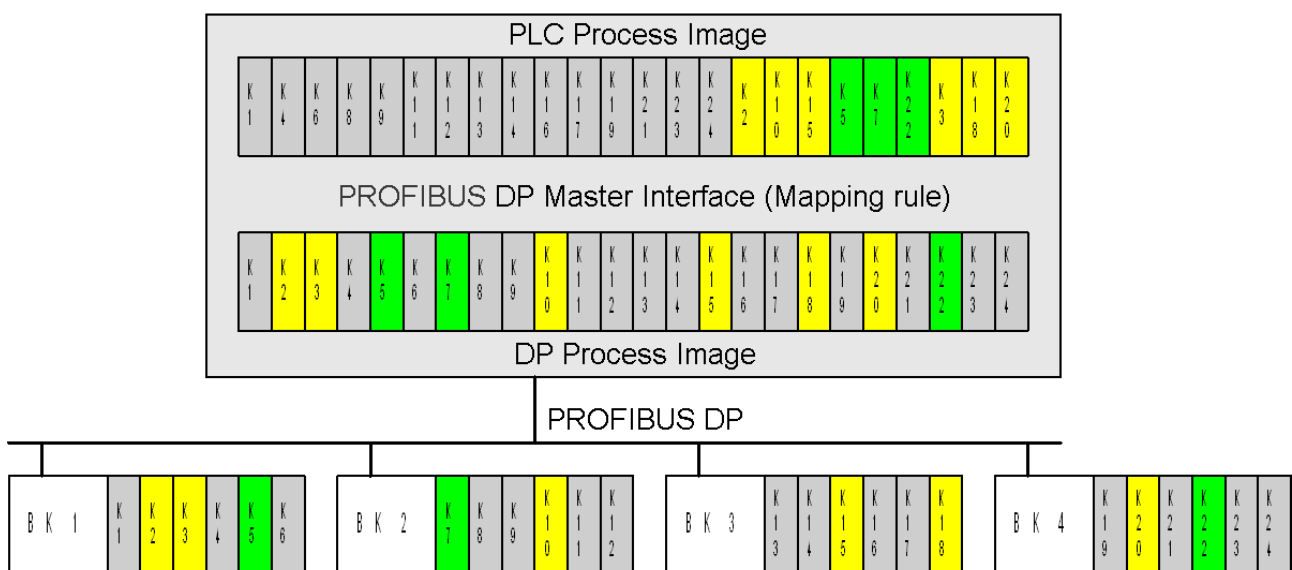


Fig. 49: Process images of the two different machine configurations with deactivated terminals

State transitions in the Bus Coupler

If the PROFIBUS DP configuration received does match the Bus Terminal configuration in multi-configuration mode, the Bus Coupler sets the "static diagnostics" bit in the PROFIBUS DP diagnostic data and delays the execution of a terminal bus cycle (I/O RUN LED remains off). As soon as the terminal assignment (activated/not activated) has been written by the PROFIBUS DP master, the Bus Coupler again carries out an examination of the PROFIBUS DP configuration, and automatically enters cyclic data exchange (the "static diagnosis" bit in PROFIBUS DP diagnostic data is cleared, and the terminal bus cycle is executed cyclically (the I/O-RUN LED goes on during the terminal cycle)). Furthermore, the terminal assignment is stored in the non-volatile memory of the Bus Coupler, so that during a restart of the PROFIBUS DP, the PROFIBUS DP master does not have to write the terminal configuration again.

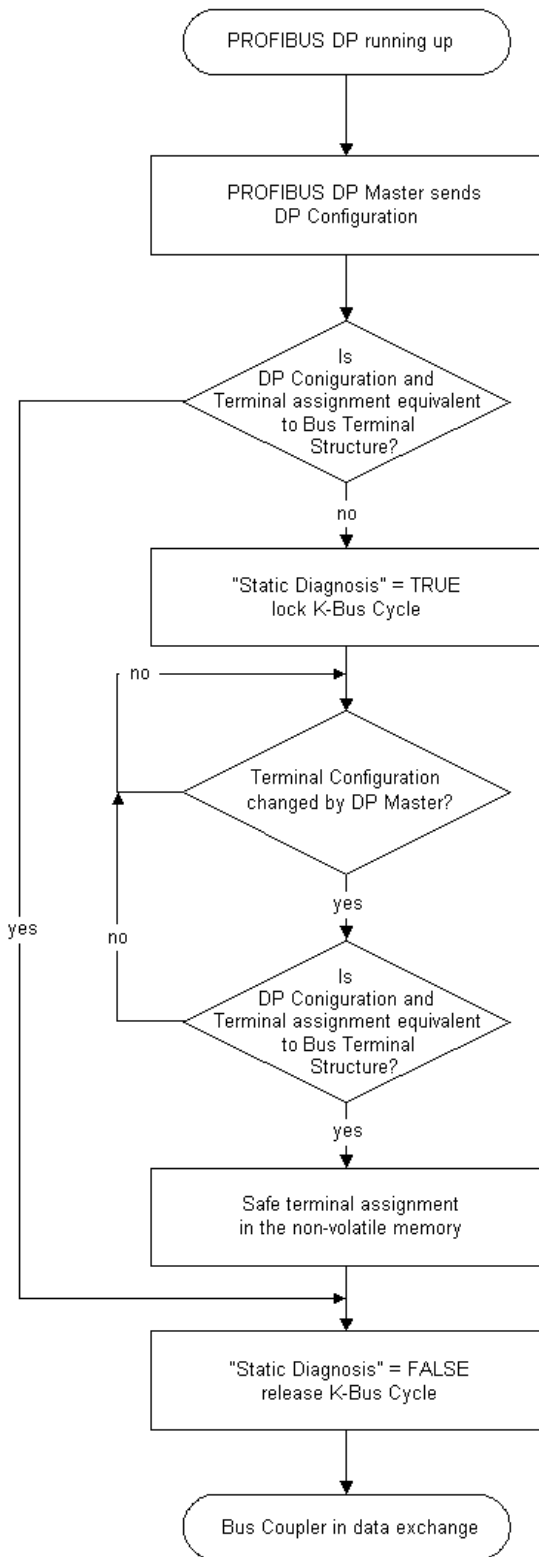


Fig. 50: State transitions in the Bus Coupler

8 Appendix

8.1 General operating conditions

The following conditions must be met in order to ensure flawless operation of the fieldbus components.

Environmental conditions

Operation

The components may not be used without additional protection in the following locations:

- in difficult environments, such as where there are corrosive vapors or gases, or high dust levels
- in the presence of high levels of ionizing radiation

Condition	Permissible range
Permissible ambient temperature during operation	see technical data
Installation position	variable
Vibration resistance	According to EN 60068-2-6
Shock resistance	According to EN 60068-2-27
EMC resistance	According to EN 61000-6-2
Emission	According to EN 61000-6-4

Transport and storage

Condition	Permissible range
Permissible ambient temperature during storage	-25 °C... +85 °C
Relative humidity	95 %, no condensation
Free fall	up to 1 m in the original packaging

Protection classes and types

Condition	Permissible range
Protection class in accordance with IEC 536 (VDE 0106, Part 1)	A protective conductor connection to the mounting rail is necessary!
Protection class conforms to IEC 529	IP20 (protection against contact with a standard test finger)
Protection against foreign objects	Less than 12 mm in diameter
Protection against water	no protection

Component identification

Every supplied component includes an adhesive label providing information about the product's approvals. For example, on the BK2000:

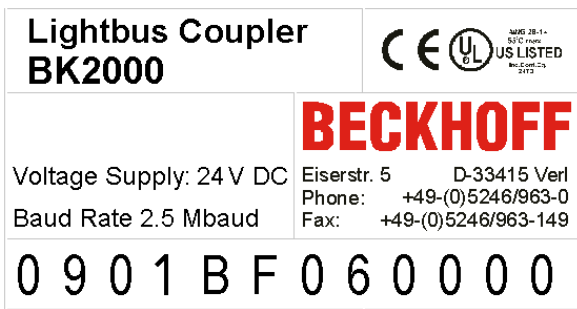


Fig. 51: Sticker with information about the BK2000 Bus Coupler certification

The following information is printed on the label:

Printed item	Meaning for this label
Precise product identification	Lightbus Coupler BK2000
Supply voltage	24 V _{DC}
Data transfer rate	2.5 Mbit/s
Manufacturer	Beckhoff Automation GmbH
CE mark	Conformity mark
UL mark	Mark for UL approval. UL stands for the Underwriters Laboratories Inc., the leading certification Organisation for North America, based in the USA. C = Canada, US = USA, LISTED 22ZA (the test results can be inspected under this entry)
Production identification	From left to right, this sequence of characters indicates the week of production (2 characters), the year of production (2 characters), the software version (2 characters) and hardware version (2 characters), along with any special indications (4 characters). This case therefore is a BK2000 - produced in the 9th calendar week - in the year 2001 - containing the BF firmware version - and using the 6th hardware version - with no special indications

8.2 Approvals

Underwriter laboratories

UL E172151

Conformity mark

CE

Protection class

IP20 conforms to EN60529

8.3 Bibliography

German books

PROFIBUS

- PROFIBUS-DP/DPV1
Basic principles, tips and tricks for users
by Manfred Popp
ISBN: 3778527819

General fieldbus technology

- Gerhard Gruhler (Pub.): **Fieldbuses and device communication systems**
Practical knowledge with comparison options
Franzis Verlag 2001
244 pages
ISBN 3-7723-5745-8

English books

(in preparation)

Standards PROFIBUS-DP

- IEC 61158 and IEC 61784
- DIN 19245, Part 3
- Euronorm EN 50170

Web sites

- <https://www.profibus.com>

8.4 List of Abbreviations

DP

Decentralised periphery. PROFIBUS protocol for fast cyclic data exchange

FMS

PROFIBUS transfer protocol (Fieldbus Message Specification).

Freeze mode

This command makes the slave freeze its inputs

GSD file

German device master file

GSE file

English device master file

IP20, IP65, IP66, IP67

Protection class (contact, water, dust)

K-bus

Terminal Bus: Internal bus for communication between Bus Coupler and Bus Terminals

PNO

PROFIBUS User Organisation (see <https://www.profibus.com>)

Repeater

Provides signal conditioning, connecting individual bus segments

PLC

Programmable logic controller

Sync mode

This command makes the slave hold its outputs unchanged until it receives the Sync telegram.

8.5 Support and Service

Beckhoff and their partners around the world offer comprehensive support and service, making available fast and competent assistance with all questions related to Beckhoff products and system solutions.

Beckhoff's branch offices and representatives

Please contact your Beckhoff branch office or representative for local support and service on Beckhoff products!

The addresses of Beckhoff's branch offices and representatives round the world can be found on her internet pages: <https://www.beckhoff.com>

You will also find further documentation for Beckhoff components there.

Beckhoff Support

Support offers you comprehensive technical assistance, helping you not only with the application of individual Beckhoff products, but also with other, wide-ranging services:

- support
- design, programming and commissioning of complex automation systems
- and extensive training program for Beckhoff system components

Hotline: +49 5246 963 157
Fax: +49 5246 963 9157
e-mail: support@beckhoff.com

Beckhoff Service

The Beckhoff Service Center supports you in all matters of after-sales service:

- on-site service
- repair service
- spare parts service
- hotline service

Hotline: +49 5246 963 460
Fax: +49 5246 963 479
e-mail: service@beckhoff.com

Beckhoff Headquarters

Beckhoff Automation GmbH & Co. KG

Huelshorstweg 20
33415 Verl
Germany

Phone: +49 5246 963 0
Fax: +49 5246 963 198
e-mail: info@beckhoff.com
web: <https://www.beckhoff.com>

Table of figures

Fig. 1	BK3120 and LC3100 - Bus Couplers for PROFIBUS DP	9
Fig. 2	BK3150 - Bus Coupler for PROFIBUS DP	11
Fig. 3	BK3500 and BK3520 - Bus Couplers with optical fiber connection for PROFIBUS DP	12
Fig. 4	Spring contacts of the Beckhoff I/O components	17
Fig. 5	Dimensions, using BK3120 and LC3100 as examples	18
Fig. 6	Release the locking mechanism by pulling the orange tab	19
Fig. 7	Groove and tongue of the housings	19
Fig. 8	Standard wiring	20
Fig. 9	Pluggable wiring	20
Fig. 10	High Density Terminals	21
Fig. 11	Connecting a cable on a terminal point.....	22
Fig. 12	Potential groups of a Bus Terminal block.....	23
Fig. 13	Power contact on the left.....	24
Fig. 14	Power supply connections for BKxx00, BKxx10, BKxx20 and LCxxxx	25
Fig. 15	Power supply connections for BKxx50 and BKxx51	26
Fig. 16	UL identification.....	26
Fig. 17	Potential connection diagram of an EKxxxx.....	27
Fig. 18	Pin assignment M12 socket (-B310)	28
Fig. 19	Pin assignment M12 socket/plug connector (-B318).....	28
Fig. 20	Pin assignment of the PROFIBUS D-sub socket	28
Fig. 21	Pin assignment socket/plug connector Fieldbus Box modules	29
Fig. 22	PROFIBUS cable assignment.....	30
Fig. 23	Start-up behaviour of the Bus Coupler.....	38
Fig. 24	KS2000 configuration software	47
Fig. 25	TwinCAT System Manager	48
Fig. 26	Configuration of the PROFIBUS DP I/O modules - selection of the PROFIBUS DP master PC card	49
Fig. 27	Configuration of the PROFIBUS DP I/O modules - inserting the bus nodes.....	49
Fig. 28	Configuration of the PROFIBUS DP I/O modules - appending the Bus Terminals	50
Fig. 29	Busklemn.bmp	50
Fig. 30	Busklems.bmp.....	50
Fig. 31	Parameter data for the BK3120	51
Fig. 32	Example for entering individual bytes.	52
Fig. 33	Example for entering associated bytes.	53
Fig. 34	Example for compact representation of the Bus Terminal KL3312.....	54
Fig. 35	Example for compact representation of the Bus Terminal KL3312.....	54
Fig. 36	Output data in the Bus Coupler.....	56
Fig. 37	Input data in the Bus Coupler	56
Fig. 38	Configuration of the K-bus cycle for the DP couplers	57
Fig. 39	K-bus - Slow FreeRun mode (default setting).....	57
Fig. 40	K-bus mode fast FreeRun	58
Fig. 41	K-bus - standard synchronous mode	58
Fig. 42	K-bus - synchronous mode with optimized input update (one cycle).....	59
Fig. 43	K-bus - synchronous mode with optimized input update (two cycles).....	59

Fig. 44	LEDs BK3120 and BK3150.....	65
Fig. 45	LEDs LC3100.....	66
Fig. 46	Representation of a production machine	82
Fig. 47	Process image of the production machine	83
Fig. 48	Process images of the two different machine configurations	84
Fig. 49	Process images of the two different machine configurations with deactivated terminals.....	85
Fig. 50	State transitions in the Bus Coupler.....	87
Fig. 51	Sticker with information about the BK2000 Bus Coupler certification	89

More Information:
www.beckhoff.com/BK3120

Beckhoff Automation GmbH & Co. KG
Hülshorstweg 20
33415 Verl
Germany
Phone: +49 5246 9630
info@beckhoff.com
www.beckhoff.com

